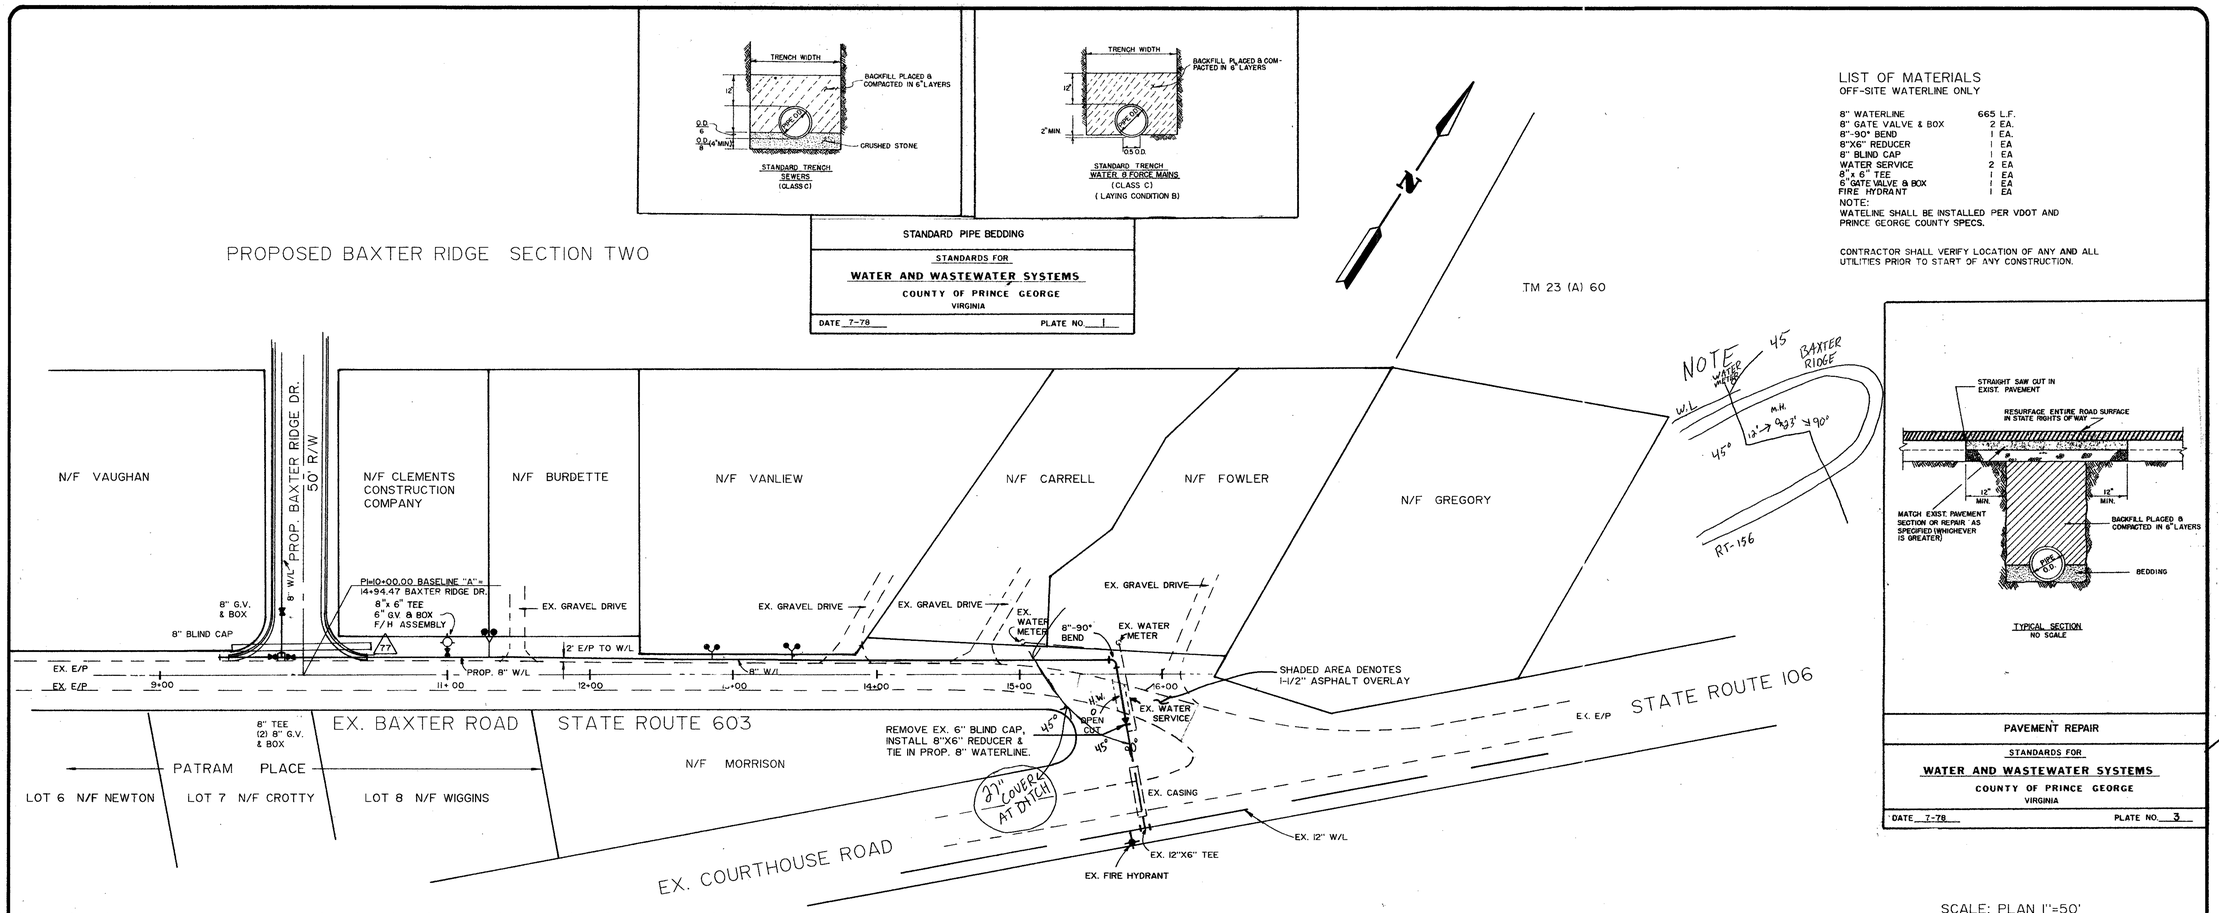

LIST OF MATERIALS
OFF-SITE WATERLINE ONLY

8" WATERLINE	665 L.F.
8" GATE VALVE & BOX	2 EA.
8"-90° BEND	1 EA.
8"X6" REDUCER	1 EA
8" BLIND CAP	1 EA
WATER SERVICE	2 EA
8"x 6" TEE	1 EA
6" GATE VALVE & BOX	1 EA
FIRE HYDRANT	1 EA

NOTE:
WATELINE SHALL BE INSTALLED PER VDOT AND PRINCE GEORGE COUNTY SPECS.

CONTRACTOR SHALL VERIFY LOCATION OF ANY AND ALL UTILITIES PRIOR TO START OF ANY CONSTRUCTION.

PAVEMENT REPAIR
STANDARDS FOR
WATER AND WASTEWATER SYSTEMS
COUNTY OF PRINCE GEORGE
VIRGINIA
DATE 7-78 PLATE NO. 3

SCALE: PLAN 1"=50'
PROFILE
HORZ: 1"=50'
VERT: 1"=5'

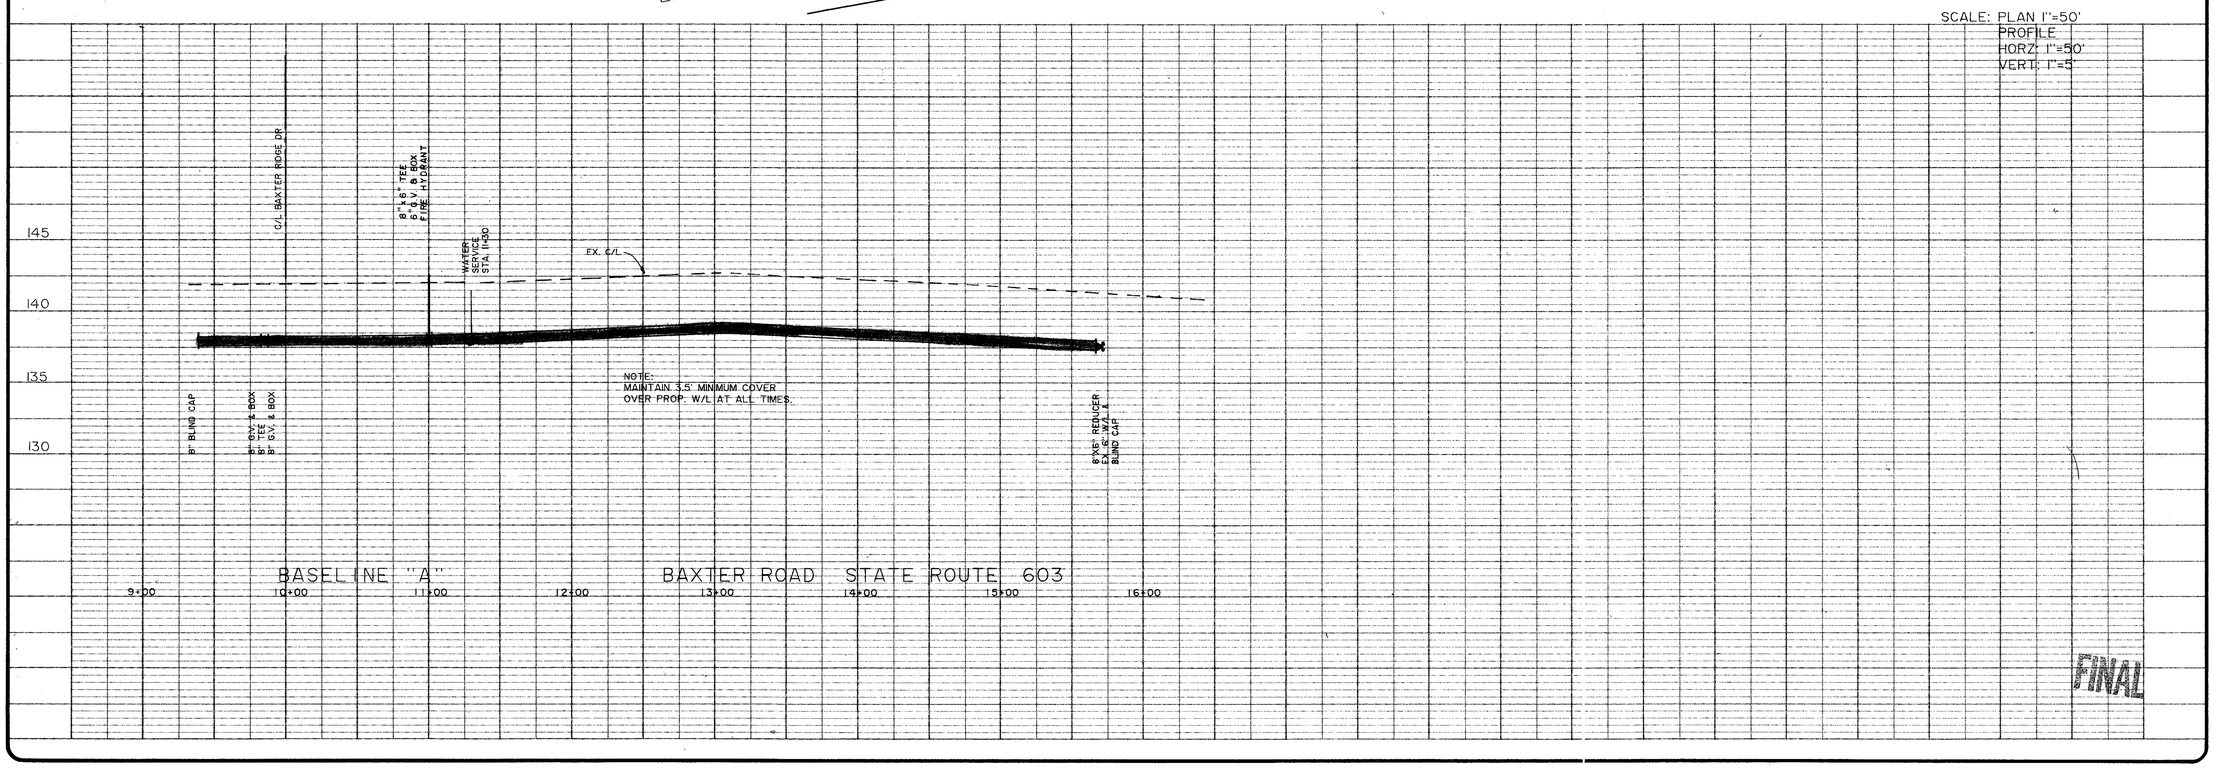

FINAL

CHARLES C. TOWNES & ASSOCIATES, P.C.
Engineers, Planners, Land Surveyors
830 Southlake Boulevard, Suite C
Richmond, Virginia 23236
804-343-7371

COMMONWEALTH OF VIRGINIA
JEFFREY T. COLLINS
No. 013001
PROFESSIONAL ENGINEER

BAXTER RIDGE
SECTION TWO
RIVES DISTRICT
PRINCE GEORGE COUNTY, VIRGINIA

OFFSITE W/L PLAN & PROFILE

REVISIONS	
DATE	ITEM
8/22/94	
9/28/94	

DATE	JULY 12, 1994
SCALE	AS SHOWN
DRAWN BY	RCE
CHECKED BY	
F.B. #	
SHEET #	6 OF 6