SEWER NOTES

1. All construction, materials, and installation shall conform to the latest edition of "Standards for the Design and Construction of Water and Wastewater Systems" of the County of Prince George, Virginia.
2. Contractor shall be responsible for notifying the Director of Public Utilities and scheduling a pre-construction meeting at least 48 hours prior to starting any work on this project. All work shall be subject to inspection by County Inspectors. The Contractor shall be responsible for obtaining all necessary permits.
3. The Contractor shall include in the applicable bid price, the cost of locating and uncovering all sewer manholes after surfacing of roads and to adjust them to final road grades, if necessary. The Contractor shall be responsible for cleaning out of sewer mains for final inspection, if necessary.
4. The location of existing utilities across or along the line of proposed work is not necessarily shown on the plans, and where shown is only approximately correct. The Contractor shall on his own initiative and at no extra cost, locate all underground lines and structures as necessary. The Contractor shall be responsible for any damage to underground structures.
5. Contractor shall call "Miss Utility" toll free at 1-800-552-7001 prior to any digging.
6. All house connections made from manholes shall be of Ductile Iron pipe.
7. Datum for all elevations is National Geodetic Survey.

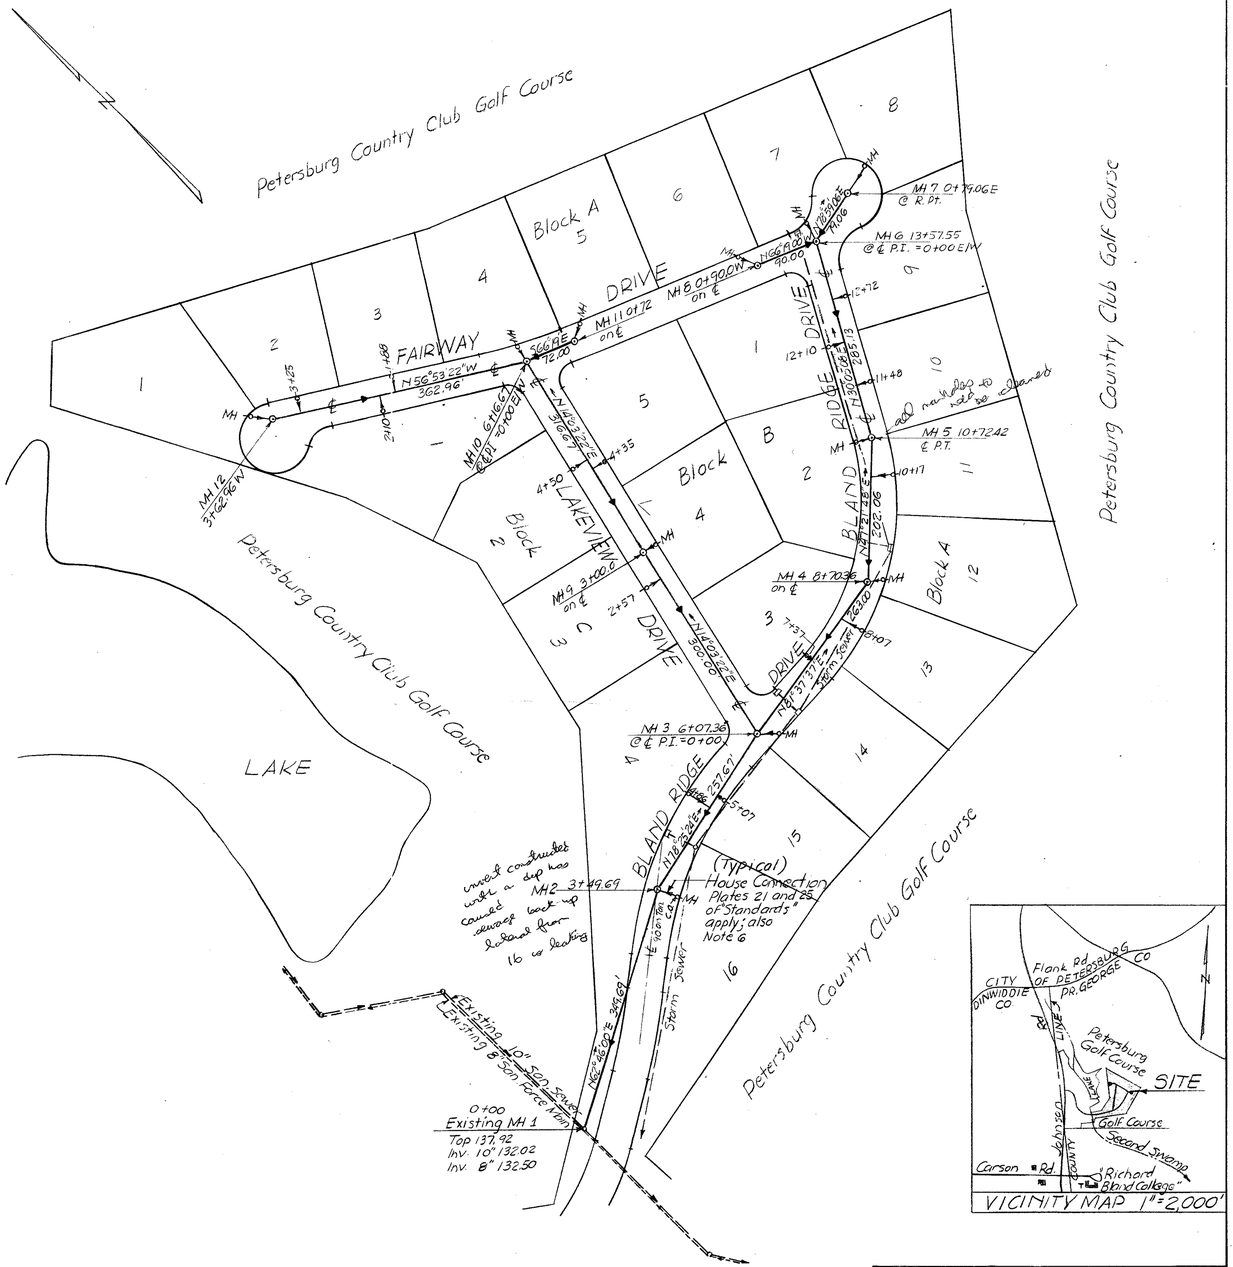

Scale: 1"=100'

COMMONWEALTH OF VIRGINIA
CARL A. WATKINS, JR.
CIVIL ENGINEER
CERTIFICATE No. 1285
CERTIFIED PROFESSIONAL ENGINEER

LAPRADE BROS.
CIVIL ENGINEERS & SURVEYORS
3 W. Cary St. Richmond, Va.

BLAND RIDGE
Rives Dist., Prince George Co., Va.

SANITARY SEWER PLAN

DATE: 10 JUNE 65
DESIGNED: CAW
DRAWN:
CHECKED:

REVISIONS
Δ 28 JUNE 65 (C.O.'s ADDED)

SHEET 1 OF 2

File: