PRINCE GEORGE COUNTY
DEPARTMENT OF PUBLIC UTILITIES

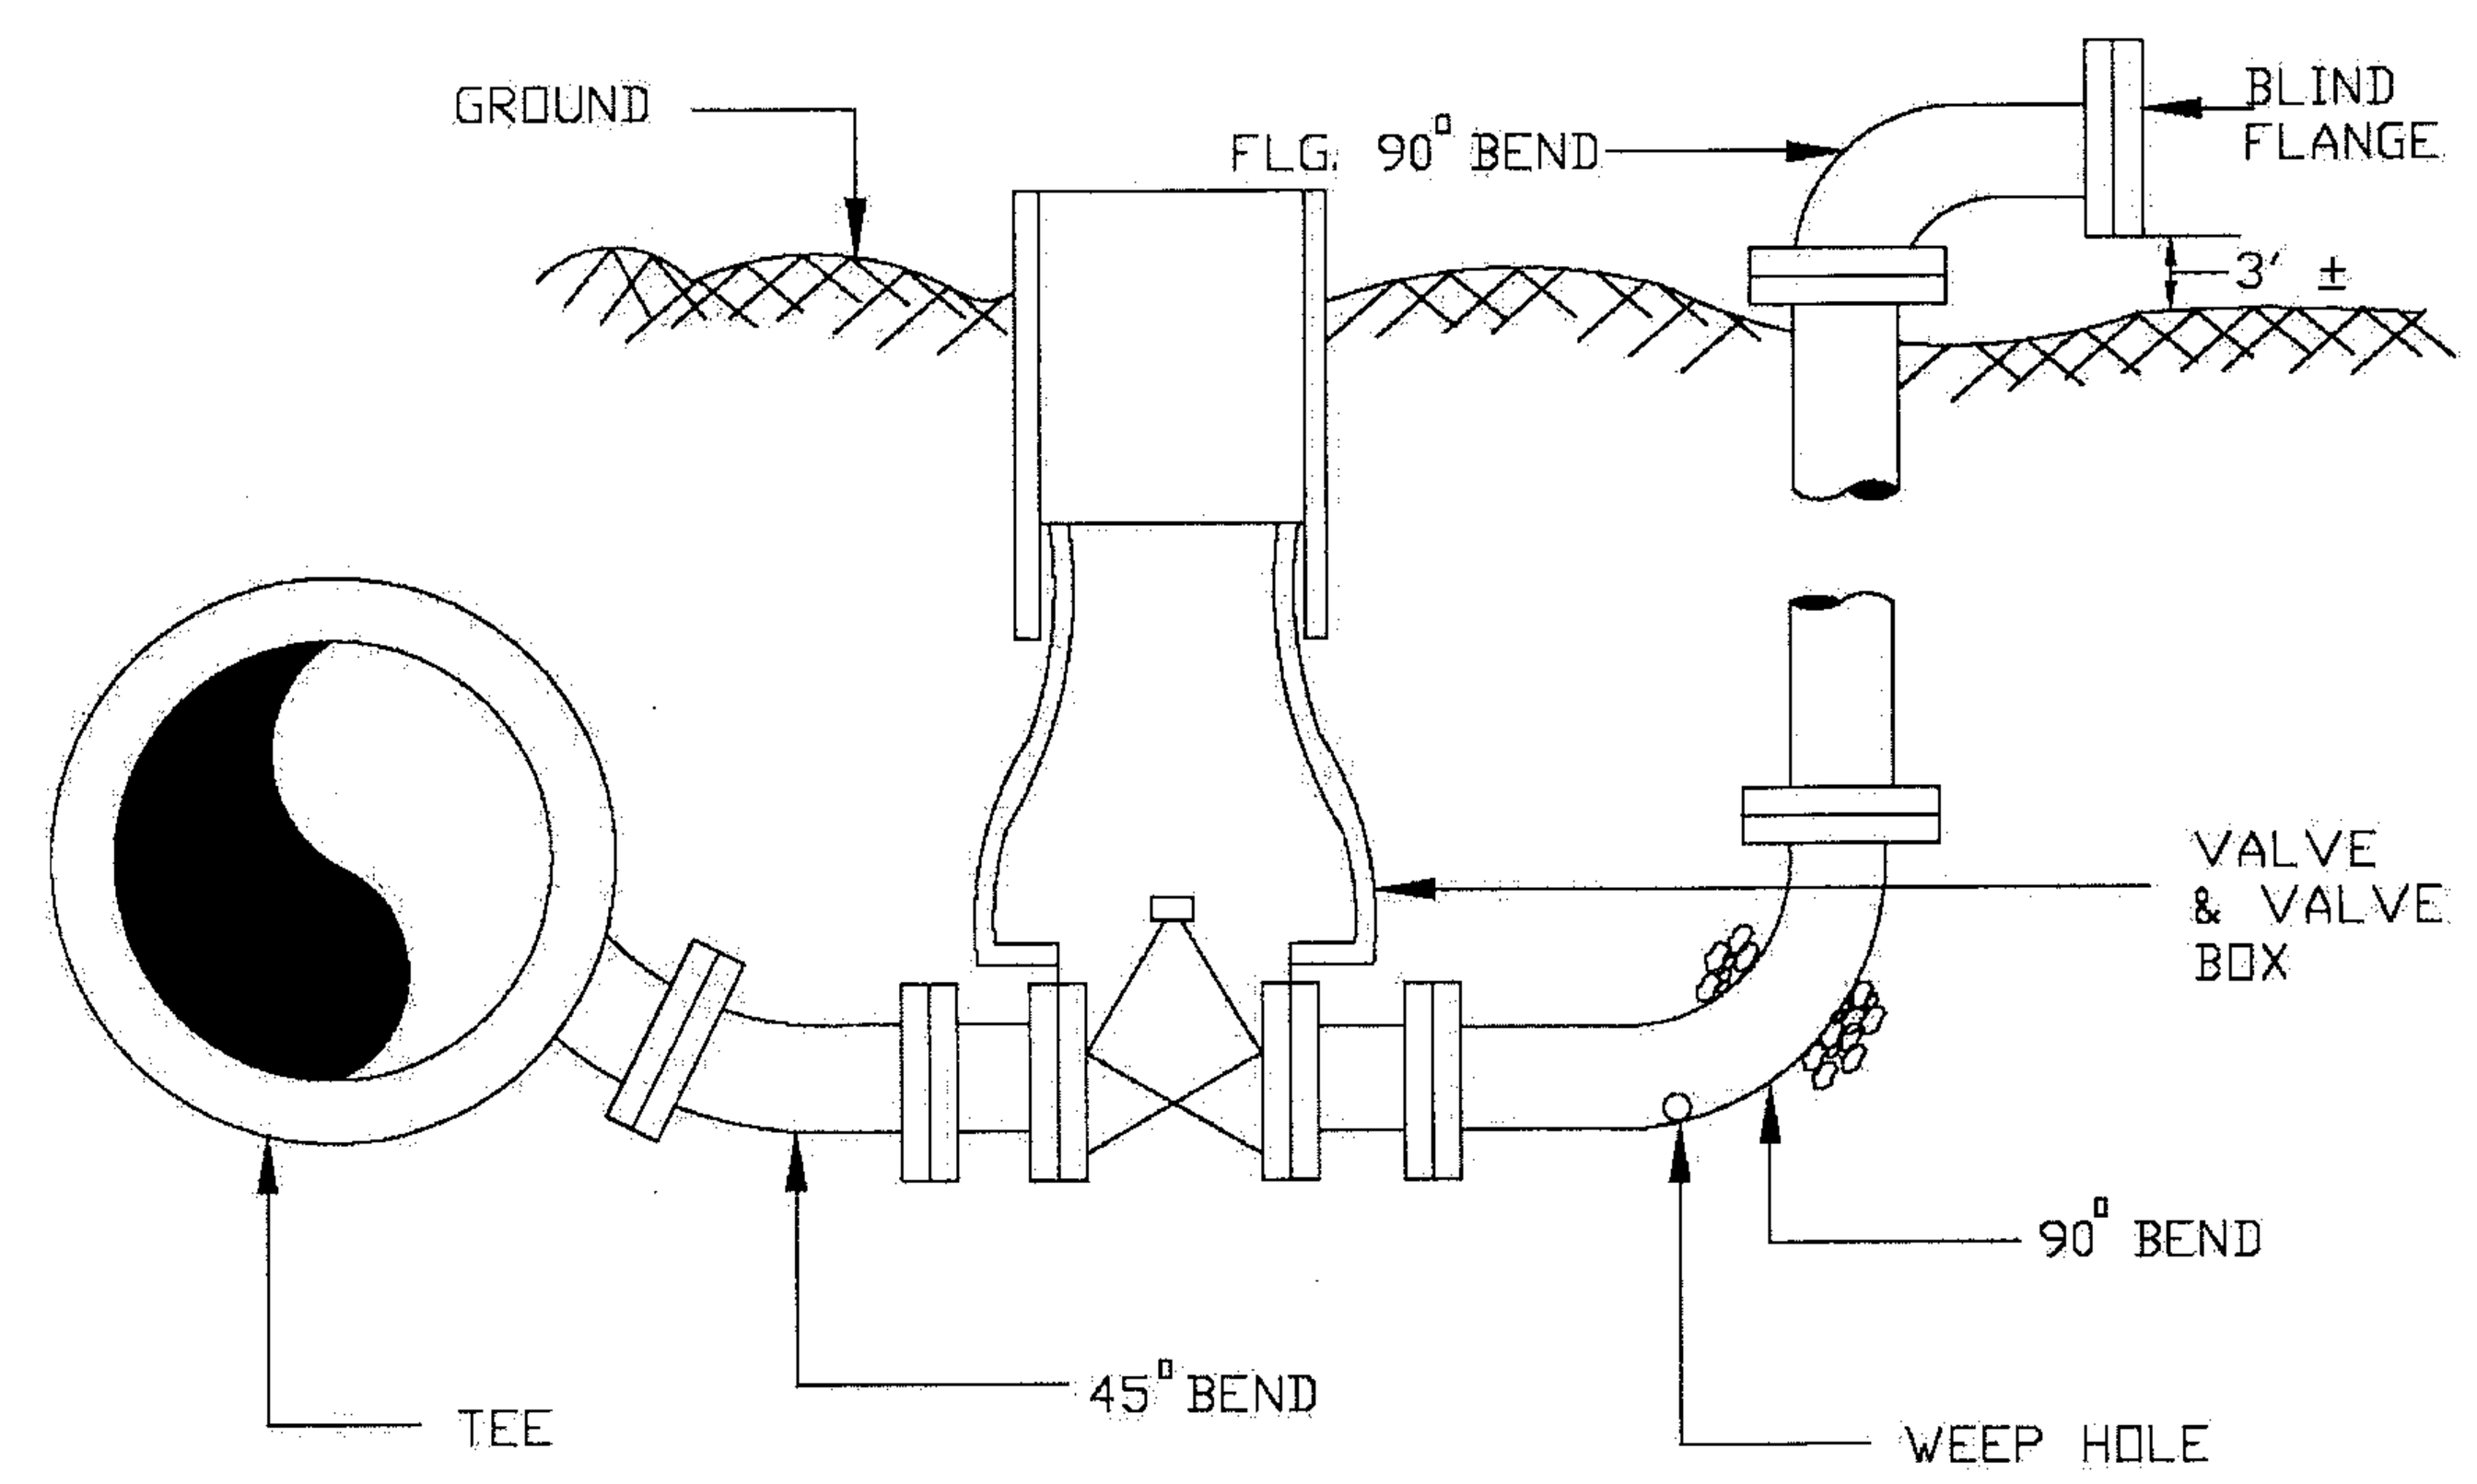

NOTE:

1. THE LARGE BLOW-OFF SHALL BE DRAINED TO PREVENT FREEZING.
2. ALL PIPE AND FITTINGS SHALL BE FLANGED OR M.J. RESTRAIN JOINTS.
3. WEEP HOLE TO BE CUT/DRILLED 2' BELOW GROUND LEVEL TO SUFFICIENTLY ALLOW STAND PIPE TO DRAIN. BACKFILL WITH AT LEASE 1/2 CUBIC YARD OF CLEAN STONE.

DATE JAN. 2008	TYPICAL 4" AND LARGER BLOW-OFF	DRWG. NO. WAT-4
REVISIONS		

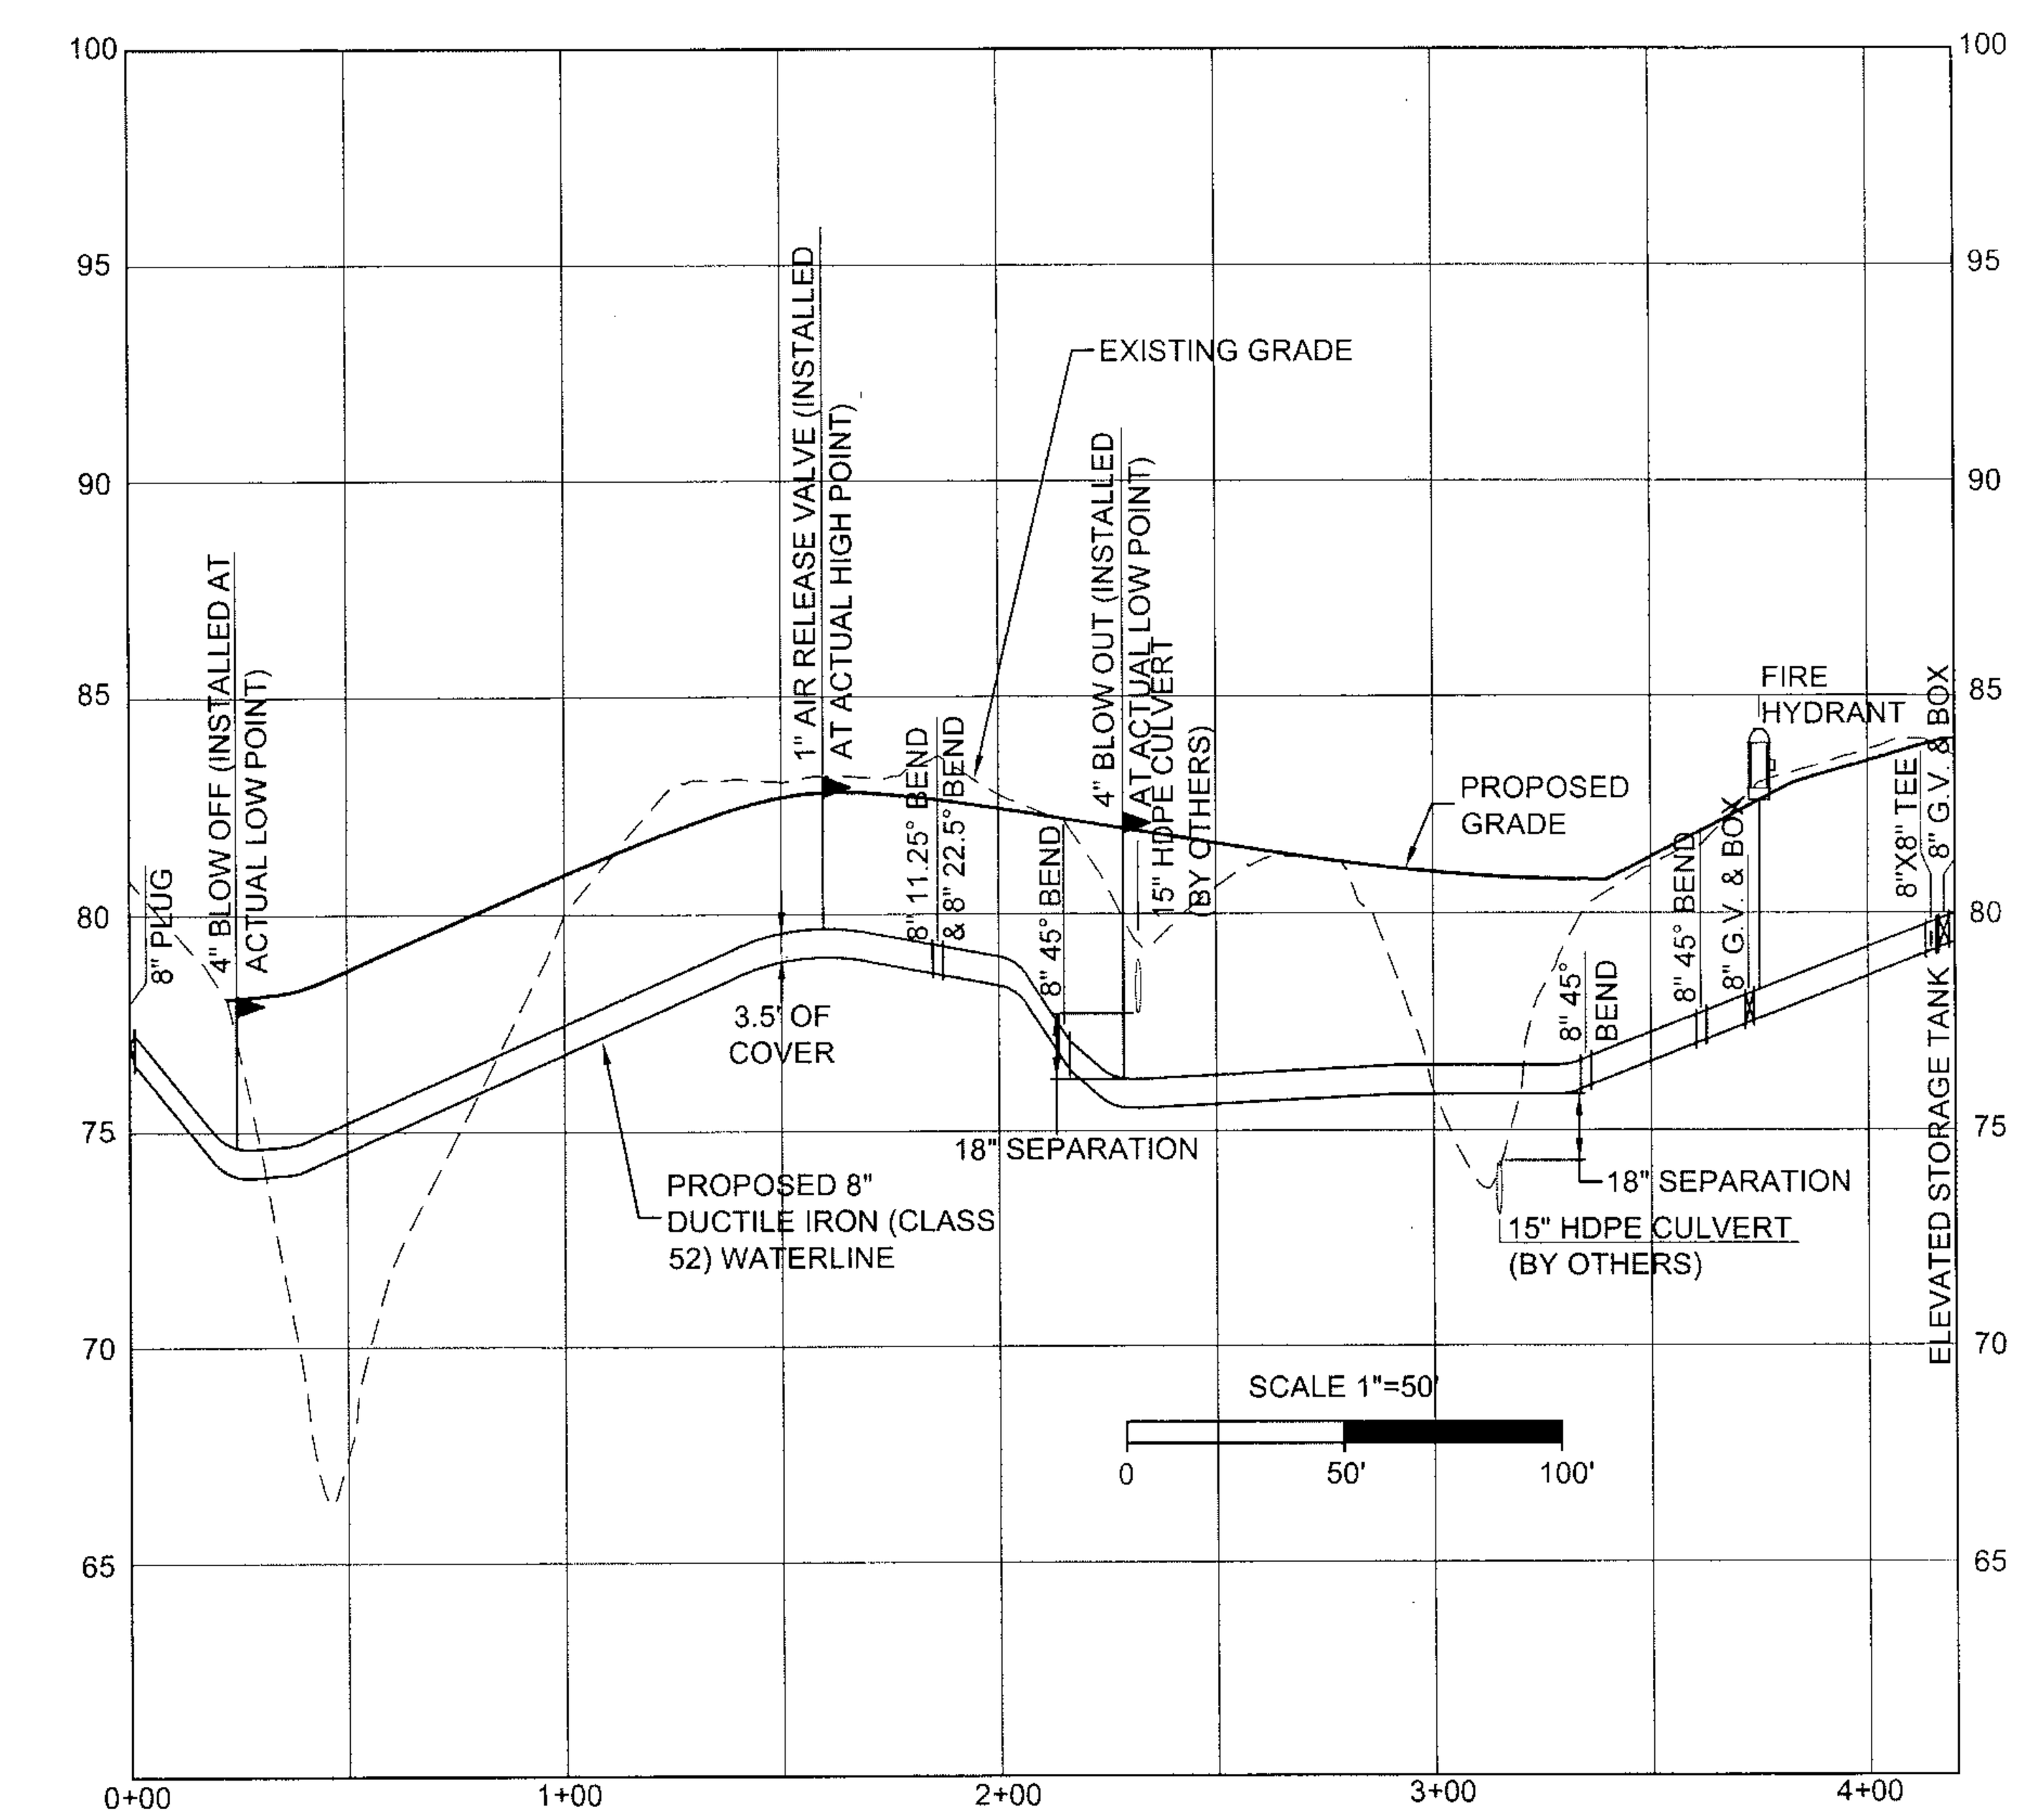

8" WATERLINE PROFILE

SCALE: HORIZ.: 1" = 50', VER.: 1" = 5'

COMMONWEALTH OF VIRGINIA
WESLEY G. HUNNIUS
Lic. No. 040151
12/3/13
PROFESSIONAL ENGINEER

VIRGINIA | NORTH CAROLINA | WEST VIRGINIA

YOUR VISION ACHIEVED THROUGH OURS.

Site Development | Residential | Infrastructure | Technology

DATE	REVISION DESCRIPTION
5/18/10	PER COUNTY COMMENTS
9/30/13	ALL SHEETS
12/3/13	PER COUNTY COMMENTS

DATE 09/30/13
DRAWN BY C. McNAIR
DESIGNED BY C. McNAIR
CHECKED BY
SCALE AS SHOWN

TIMMONS GROUP

CHAPPELL CREEK ELEVATED STORAGE TANK AND WATER SUPPLY SYSTEM
PRINCE GEORGE COUNTY, VIRGINIA
WATERLINE PROFILE

JOB NO. 22791-201
SHEET NO. C2