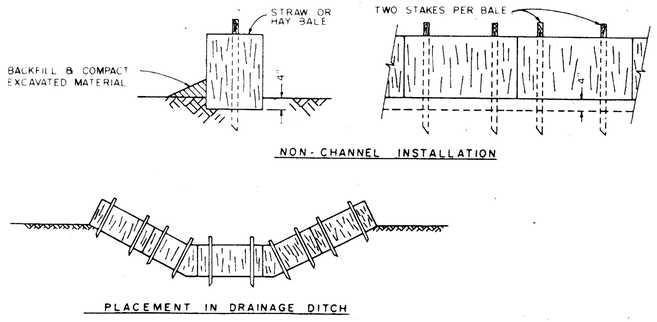

CONSTRUCTION OF TEMPORARY STRAW BALE BARRIERS

NOT TO SCALE

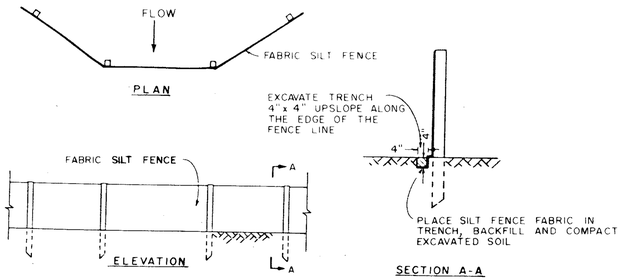

SILT FENCE CONSTRUCTION

NOT TO SCALE

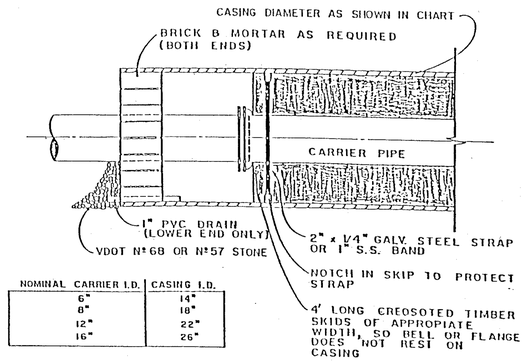

NOMINAL CARRIER I.D.	CASING I.D.
6"	14"
8"	18"
12"	22"
16"	26"

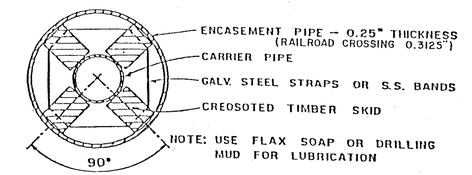

TYPICAL ENCASEMENT DETAIL

NOT TO SCALE

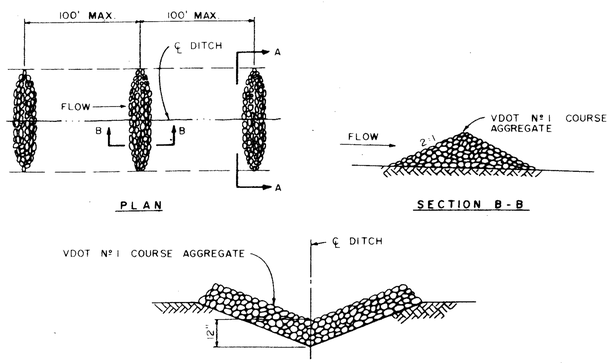

ROCK CHECK DAM

NOT TO SCALE

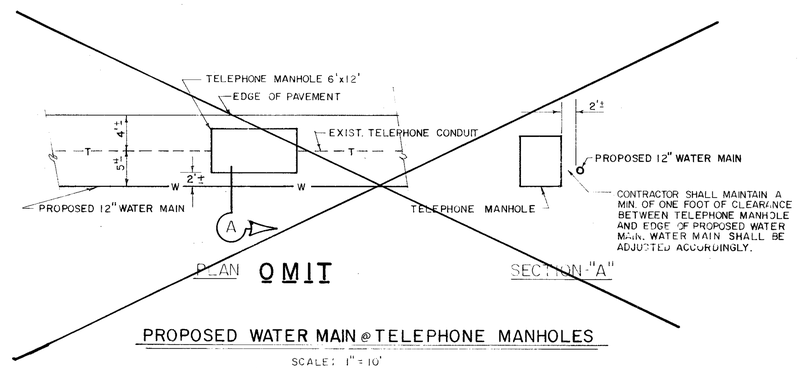

PROPOSED WATER MAIN @ TELEPHONE MANHOLES

SCALE: 1" = 10'

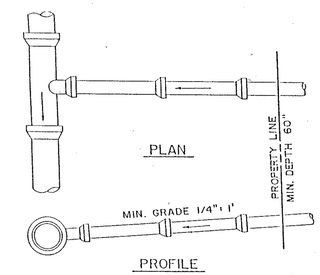

BRANCH HOUSE CONNECTION

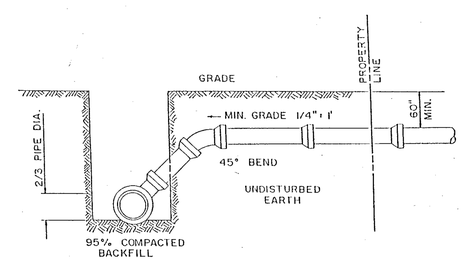

NOTE: 1/8" : 1' GRADE MAY BE USED SUBJECT TO APPROVAL OF TOWN.

WHEN 1/8" : 1' GRADE IS UTILIZED, A CLEAN OUT SHALL BE INSTALLED AT THE PROPERTY.

TEE BRANCH CONNECTION W/ 45° BEND

NOT TO SCALE

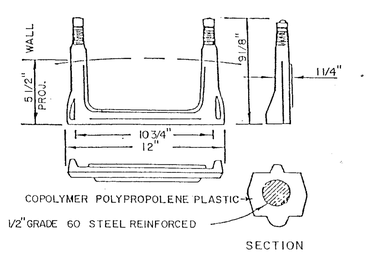

MANHOLE STEP DETAIL

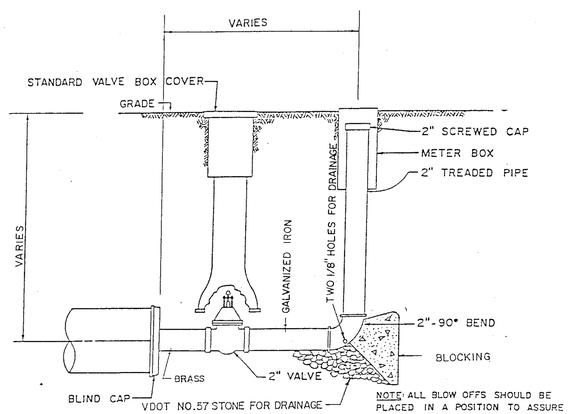

NOTE: ALL BLOW OFFS SHOULD BE PLACED IN A POSITION TO ASSURE NATURAL DRAINAGE AT PROPERTY LINE.

TO BE USED ONLY FOR TEMPORARY DEAD END LINES. A FLUSH HYDRANT IS REQUIRED FOR LINES THAT MAY NEVER BE EXTENDED.

2" BLOW OFF VALVE

NOT TO SCALE

DETAIL

COMMONWEALTH OF VIRGINIA
FREDERICK T. M. PRIBBLE
No. 10055
PROFESSIONAL ENGINEER

DRAPER – ADEN ASSOCIATES, INC. CONSULTING ENGINEERS RICHMOND VIRGINIA	DESIGNED FTP DRAWN NJH CHECKED JNL DATE 2/26/89	COMMONWEALTH ACRES WATER MAINS PRINCE GEORGE COUNTY, VIRGINIA	WATER & EROSION & SEDIMENTATION CONTROL DETAILS	REVISIONS: 8-15-95	SCALE: AS NOTED PLAN Nº T-21511	SHEET 14 OF 14

the american blueprint of columbia