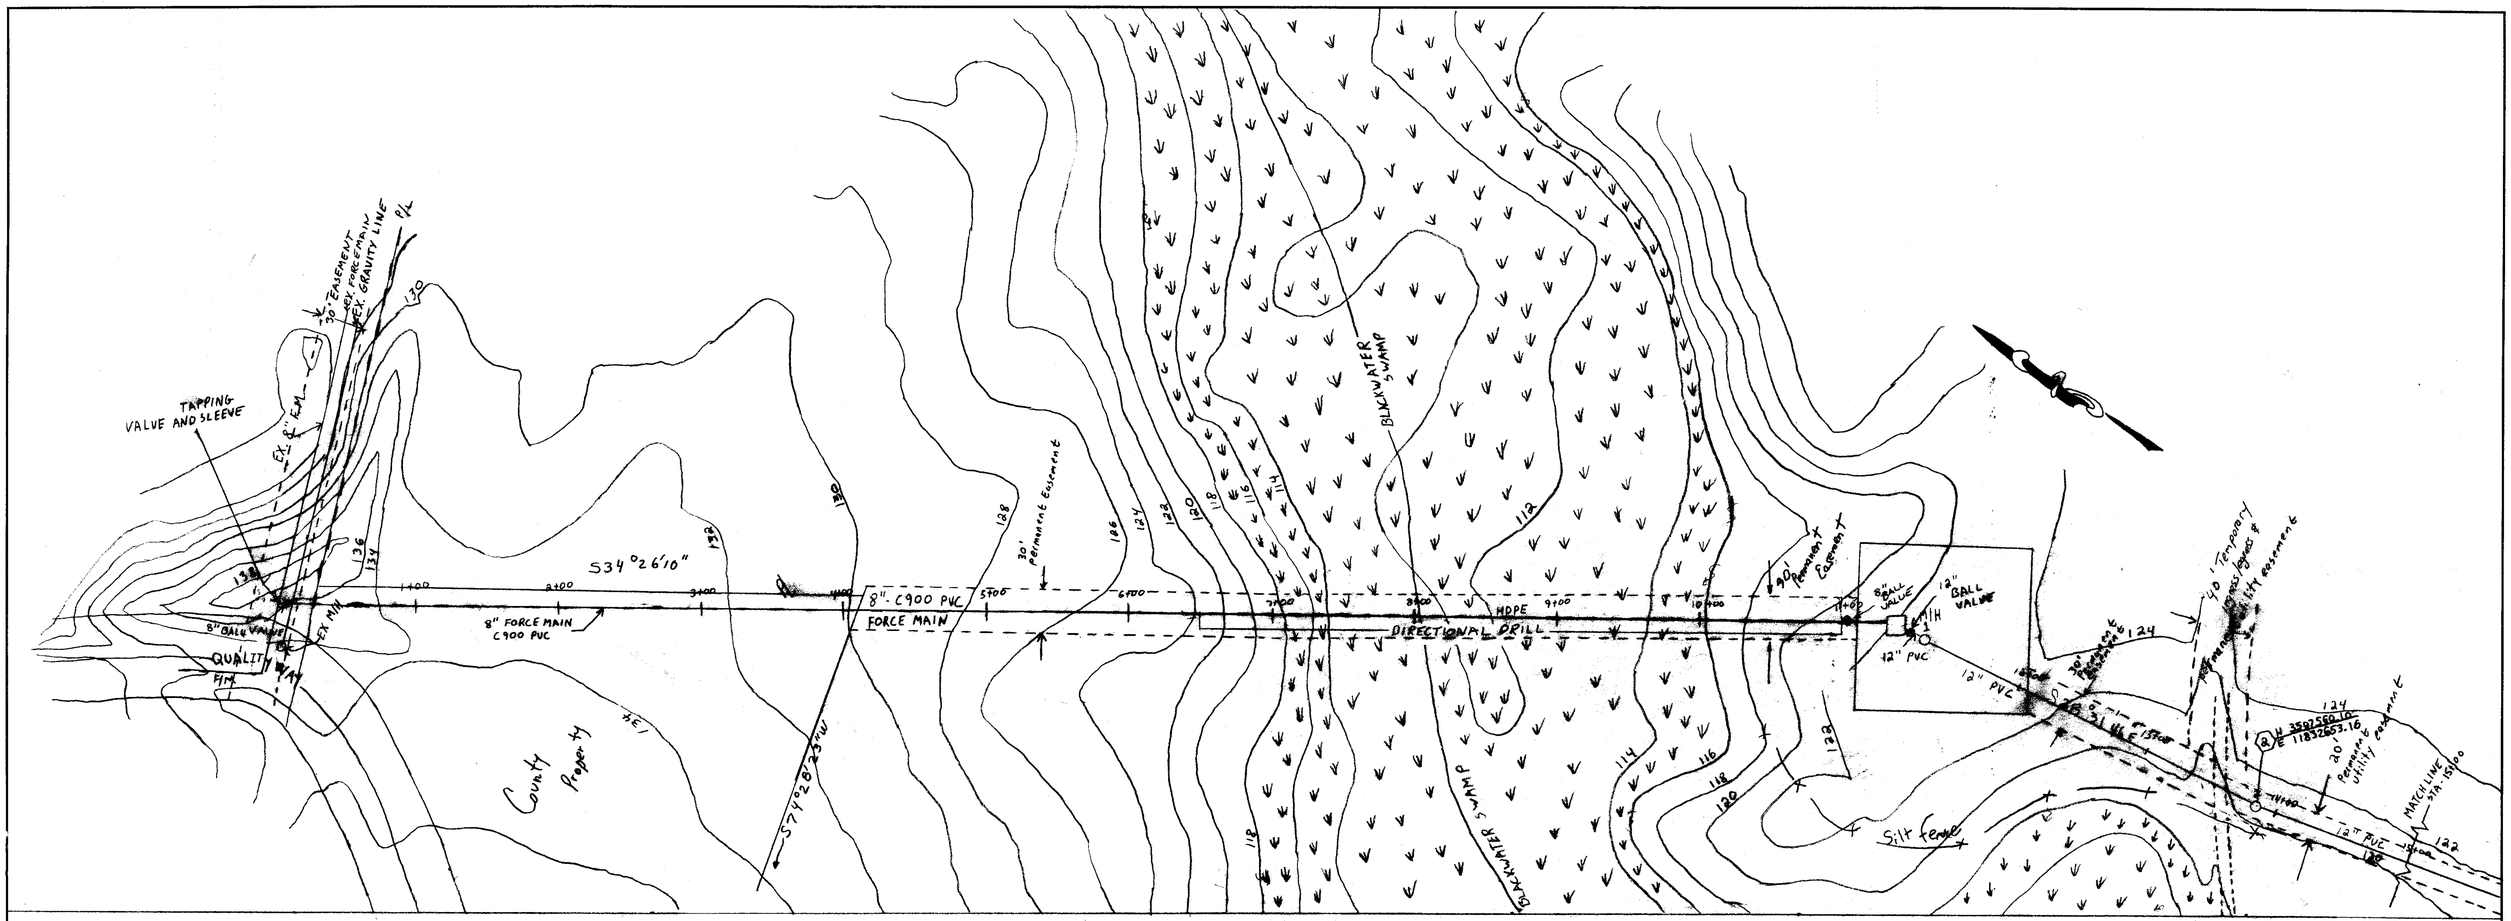

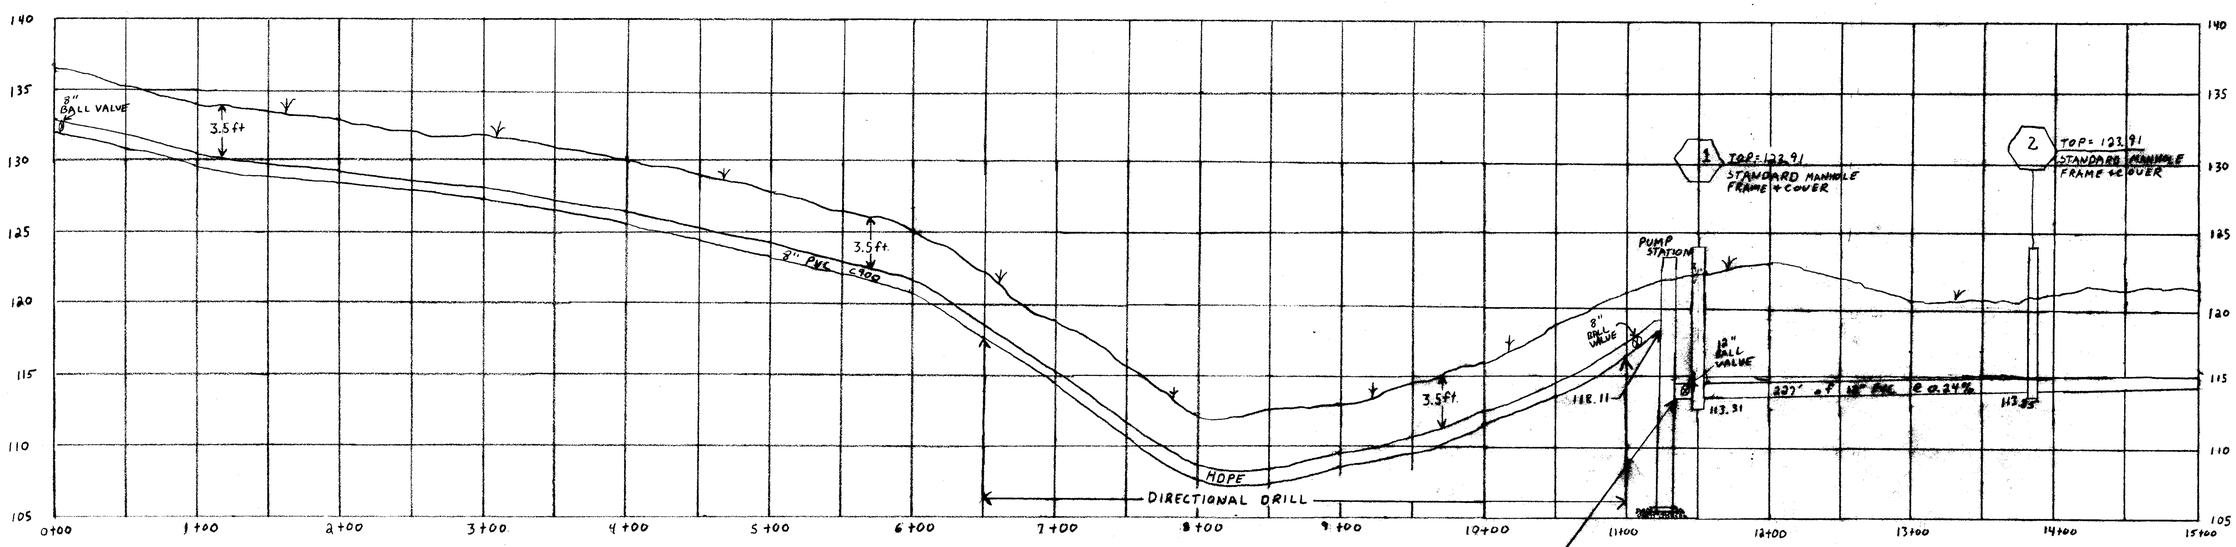

ALL MATERIALS FOR SEWER AND WATER SYSTEMS SHOWN SHALL BE SUPPLIED AND INSTALLED IN ACCORDANCE WITH THE LATEST APPLICABLE SPECIFICATION OF PRINCE GEORGE COUNTY.

CROSSPOINTE CENTRE	GRAVITY SEWER, PUMPING STATION & FORCE MAIN	
SCALE: 1" = 50'	APPROVED BY:	DRAWN BY DME
DATE: 10/27/08		REVISED 2/19/09
PRINCE GEORGE COUNTY, VA.		
DESIGNED BY: STEPHEN E. McBRIDE, COUNTY ENGINEER, PO BOX 68, PRINCE GEORGE, VA. 23875		DRAWING NUMBER 1/4

24X36 PRINTED ON NO. 1000H CLEARPRINT