

NOTES, QUANTITIES, & LEGEND (COVER) PLAN - PROFILE

SHEET INDEX

GENERAL NOTES

OWNER AND DEVELOPER:

JAMES E. CUDDIHY JR. 201 EAST RANDOLPH ROAD HOPEWELL, VIRGINIA 23860 PHONE: (804) 458-1244

- 2. ZONING: ← R-2 & B-1
- 4. TAX MAP NUMBER: PART OF 13 (6) 2 & 3

APPROXIMATE MATERIAL QUANTITIES


SEWER

WATER

6" C-900 PVC F.M. 6" D.I. CL. 52 F.M. 11 1/4" BEND 22 1/2" BEND 45" BEND 90" BEND 6" PLUG	1800 LF 380 LF 1 EA 2 EA 1 EA 1 EA	8" C-900 PVC 8" D.I. CL 52 11 1/4' BEND 22 1/2' BEND 45' BEND 90' BEND 6"x6" T.S. & VALVE 8"x6" REDUCER 8"x8" TEE 8" G.V. 8" PLUG 2" B.O. 2" PLUG	1965 LF 380 LF 3 EA 1 EA 1 EA 1 EA 1 EA 1 EA 1 EA
	•	2" PLUG 2" TAPPING SLEEVE &	

2" MANUAL AIR RELEASE VALVE | EA QUANTITIES AS SHOWN ARE APPROXIMATE ONLY. CONTRACTORS SHOULD MAKE THEIR OWN TAKEOFFS.

REVISIONS SHEET NUMBERS SHEET NUMBERS DATE 2-10-93

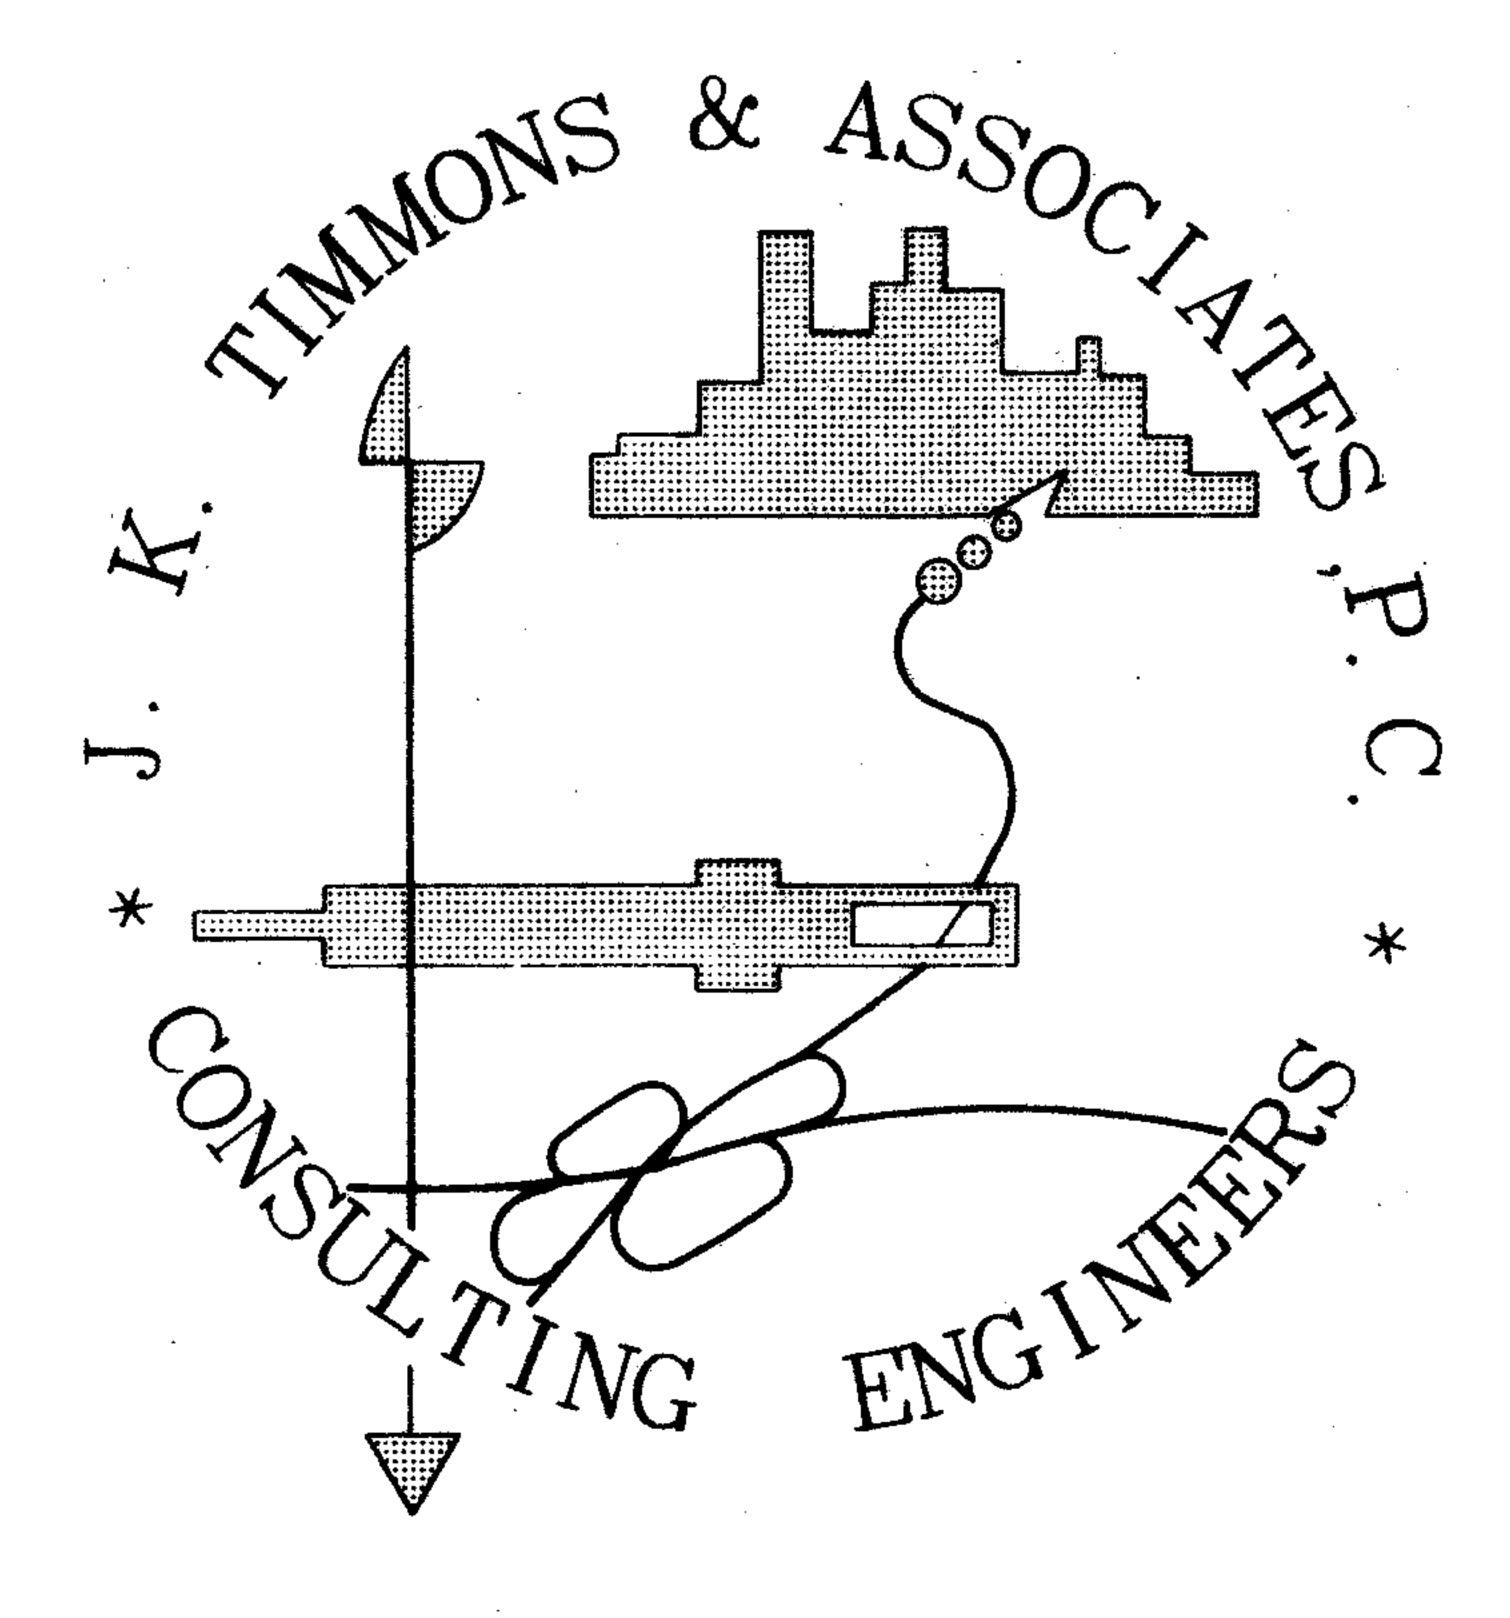


DATE: JULY 19, 1990

CONSTRUCTION NOTES

- ALL MATERIAL FOR SEWER AND WATER SYSTEMS SHOWN SHALL BE SUPPLIED AND INSTALLED IN ACCORDANCE WITH THE LATEST APPLICABLE SPECIFICATIONS OF PRINCE GEORGE COUNTY.
- ALL WORK SHALL BE SUBJECT TO INSPECTION BY UTILITY DEPARTMENT OFFICIALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFICATION OF APPROPRIATE COUNTY OFFICIALS 48 HOURS PRIOR TO START OF WORK.
- MINIMUM CLEAR OVER FOR ALL WATER PIPES SHALL BE 3.5 FEET.
- 4. THE UTILITY CONTRACTOR IS RESPONSIBLE FOR OBTAINING ANY HIGHWAY PERMITS AND SENDING A COPY TO THE COUNTY PRIOR TO START OF CONSTRUCTION.
- . THE CONTRACTOR WILL INSTALL ALL WATER CONNECTIONS AND WATER METERS.
- 6 FIRE HYDRANT PUMPER CONNECTIONS SHALL FACE IN THE DIRECTION OF THE ARROW.
- CONTRACTOR SHALL VERIFY LOCATION AND ELEVATION OF ALL UNDERGROUND UTILITIES SHOWN ON THE PLANS IN AREAS OF CONSTRUCTION PRIOR TO STARTING WORK. CONTACT ENGINEER IMMEDIATELY, IF: LOCATION OR ELEVATION IS DIFFERENT FROM THAT SHOWN ON PLANS, OR IF: THERE APPEARS TO BE A CONFLICT, AND UPON DISCOVERY OF ANY UTILITY NOT SHOWN ON THE PLAN. CALL " MISS UTILITY " OF CENTRAL VIRGINIA: 1-800-552-7001 (TOLL FREE).
- CONTRACTOR TO MAINTAIN 3.5' OF COVER OVER FIRE HYDRANT LATERAL AT DITCH LINE CROSSING.
- ALL WATER LINE VALVES MUST BE LOCATED ON THE TEE OR CROSS WHEN APPLICABLE.
- 10 THE ENGINEER WILL CERTIFY THAT THE GRADES ARE WITHIN 6" OF SUBGRADE BEFORE WATER LINE CONSTRUCTION CAN BEGIN.
- 11 WATER AND SEWER ALIGNMENT HAVE NOT BEEN TESTED FOR THE PRESENCE OF ROCK.
- 12 DATUM FOR ALL ELEVATIONS IS U.S.C. & G.
- 13 STAKING SHALL BE DONE ONLY BY A CERTIFIED LAND SURVEYOR. DO NOT STAKE FROM THESE PLANS. ENGINEER WILL FURNISH A DETAILED STAKING SHEET UPON REQUEST.

EROSION CONTROL NOTES


- ALL DISTURBED AREAS TO BE SEEDED WITHIN 15 DAYS AFTER ROUGH GRADING IS COMPLETED.
- THE PRINCE GEORGE ENGINEERING OFFICE WILL BE NOTIFIED 24 HOURS IN ADVANCE OF ANY PLANS TO BEGIN CLEARING AND GRADING OPERATIONS.
- THE PRINCE GEORGE COUNTY ENGINEERING DEPARTMENT AND ALL OTHER INTERESTED COUNTY AGENCIES SHALL MAKE A CONTINUING REVIEW AND EVALUATION OF THE METHOD USED AND THE OVERALL EFFECTIVENESS OF THE EROSION AND SEDIMENT CONTROL PROGRAM. AN APPROVED EROSION AND SEDIMENT CONTROL PLAN MAY BE AMENDED BY THE PLAN APPROVING AUTHORITY IF ON SITE INSPECTION INDICATES THAT THE APPROVED CONTROL MEASURES ARE NOT EFFECTIVE IN CONTROLLING EROSION AND SEDIMENTATION OR BECAUSE OF CHANGED CIRCUMSTANCES THE APPROVED PLAN CANNOT BE CARRIED OUT.

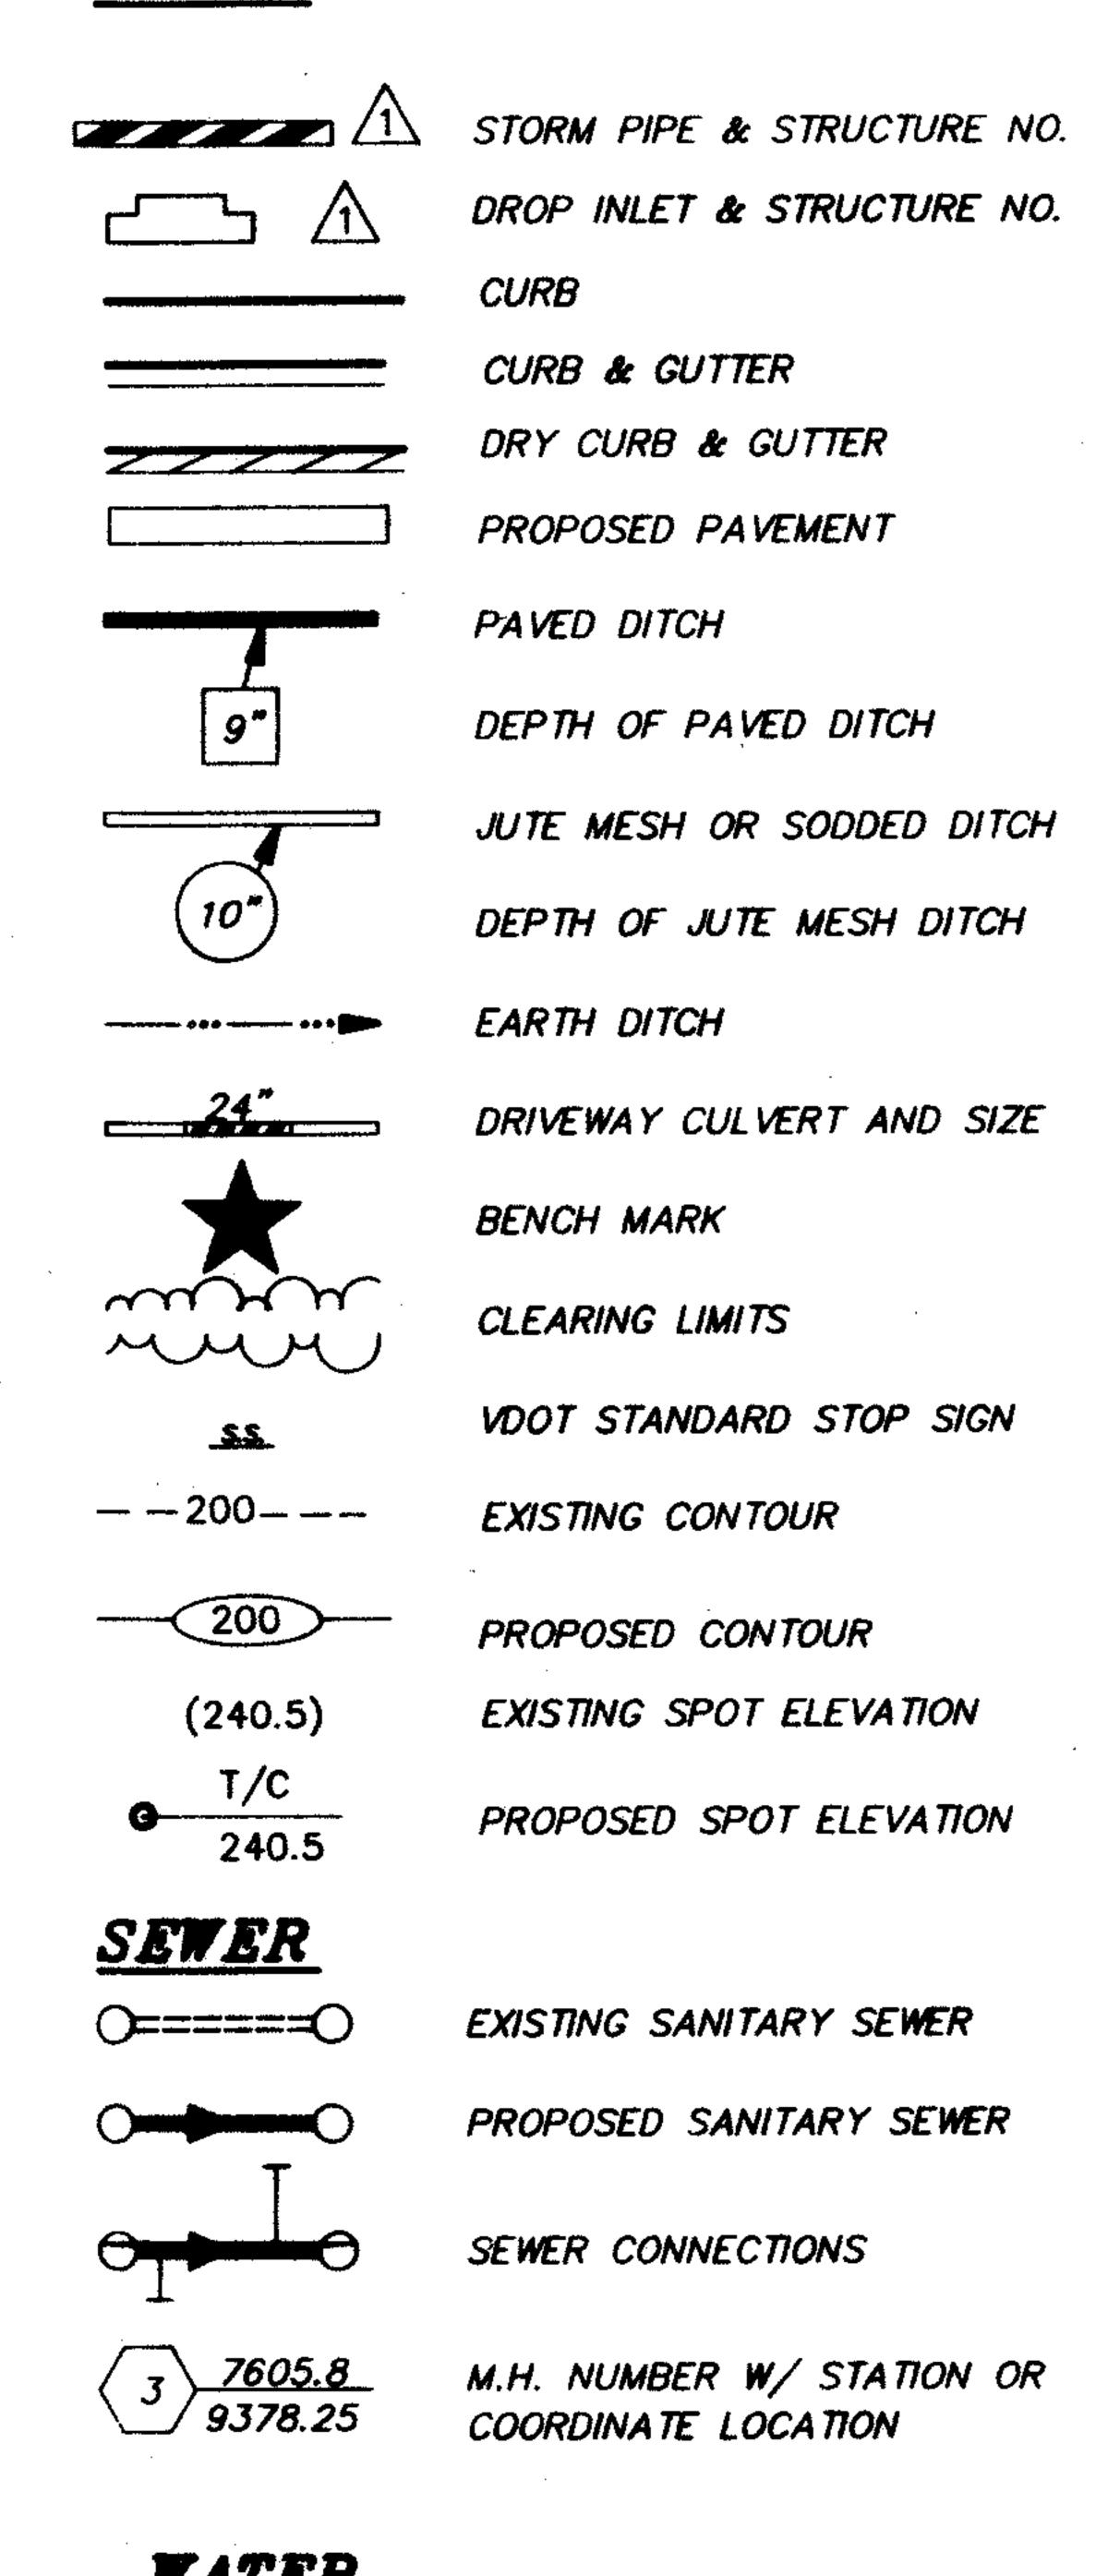

WATER

EXISTING WATER LINE PROPOSED WATER LINE SINGLE SERVICE CONNECTION

EROSION CONTROL

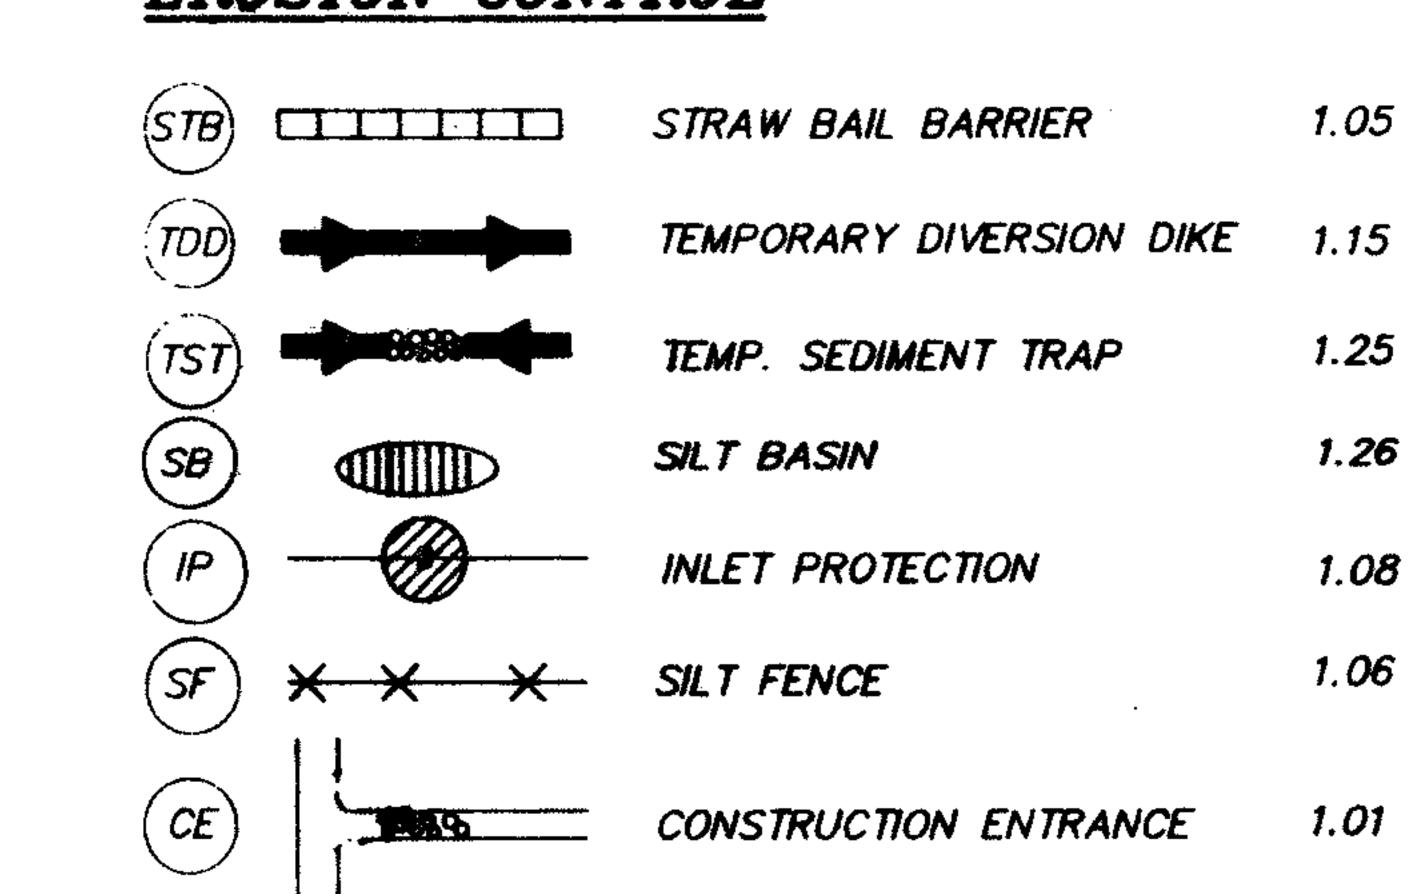

TO HOPLION DY

JRTHOUSE SINIA 232. 04) 794-