## COUNTY OF PRINCE GEORGE TEMPLE AVENUE WATER SYSTEM


LEE ACRES / COURTHOUSE ROAD WATER MAINS ADDITION TO CONTRACT I

## DRAWING INDEX

SHEET NO.		DESCRIPTION
1	• • • • • • • • • • • • • • • • • • • •	COVER SHEET
2 - 4	• • • • • • • • • • • • • • • • • • •	PLAN & PROFILE (LEE ACRES ADDITION)
5 - 7		PLAN & PROFILE (COURTHOUSE ROAD ADDITION)


## GENERAL NOTES:


- 1. THE COURTHOUSE ROAD AND LEE ACRES WATER MAINS ARE AN ADDITION TO THE TEMPLE AVENUE WATER SYSTEM 16" AND 12" WATER MAINS CONTRACT I PROJECT. THESE WATER MAIN PROJECTS ARE MADE A PART OF THE TEMPLE AVENUE WATER SYSTEM CONTRACT I BY CHANGE ORDER #1.
- 2. ALL REQUIREMENTS OF THE PLANS AND SPECIFICATIONS FOR CONTRACT I APPLY TO THE CONSTRUCTION OF THE COURTHOUSE ROAD AND LEE ACRES WATER MAINS. ALL NOTES ON SHEET 2 OF 17 AND ALL DETAILS ON SHEETS 15, 16, & 17 OF CONTRACT I APPLY.
- 3. THE CONTRACTOR SHALL BORE ALL CONCRETE DRIVEWAYS ON THE LEE ACRES
- 4. THE LOCATION OF ALL WATER SERVICES AND METER SETS IS APPROXIMATE. THE ACTUAL LOCATION SHALL BE DETERMINED IN THE FIELD DURING CONSTRUCTION BY THE COUNTY.
- 5. FIRE HYDRANTS SHALL BE SET AT THE RIGHT-OF-WAY LINE OR AT THE LOCATION DESIGNATED BY THE COUNTY.
- 6. THE CONTRACTOR SHALL PROVIDE ALL EROSION CONTROL REQUIRED BY THE PLANS, CONTRACT DOCUMENTS AND THE COUNTY DURING CONSTRUCTION OF THE WATER MAINS
- ALL RESTORATION (TOPSOIL, SEEDING, MULCHING, PAVEMENT & DRIVEWAY REPAIR, ECT...) SHALL BE AS DESCRIBED IN THE CONTRACT I PLANS AND SPECIFICATIONS.

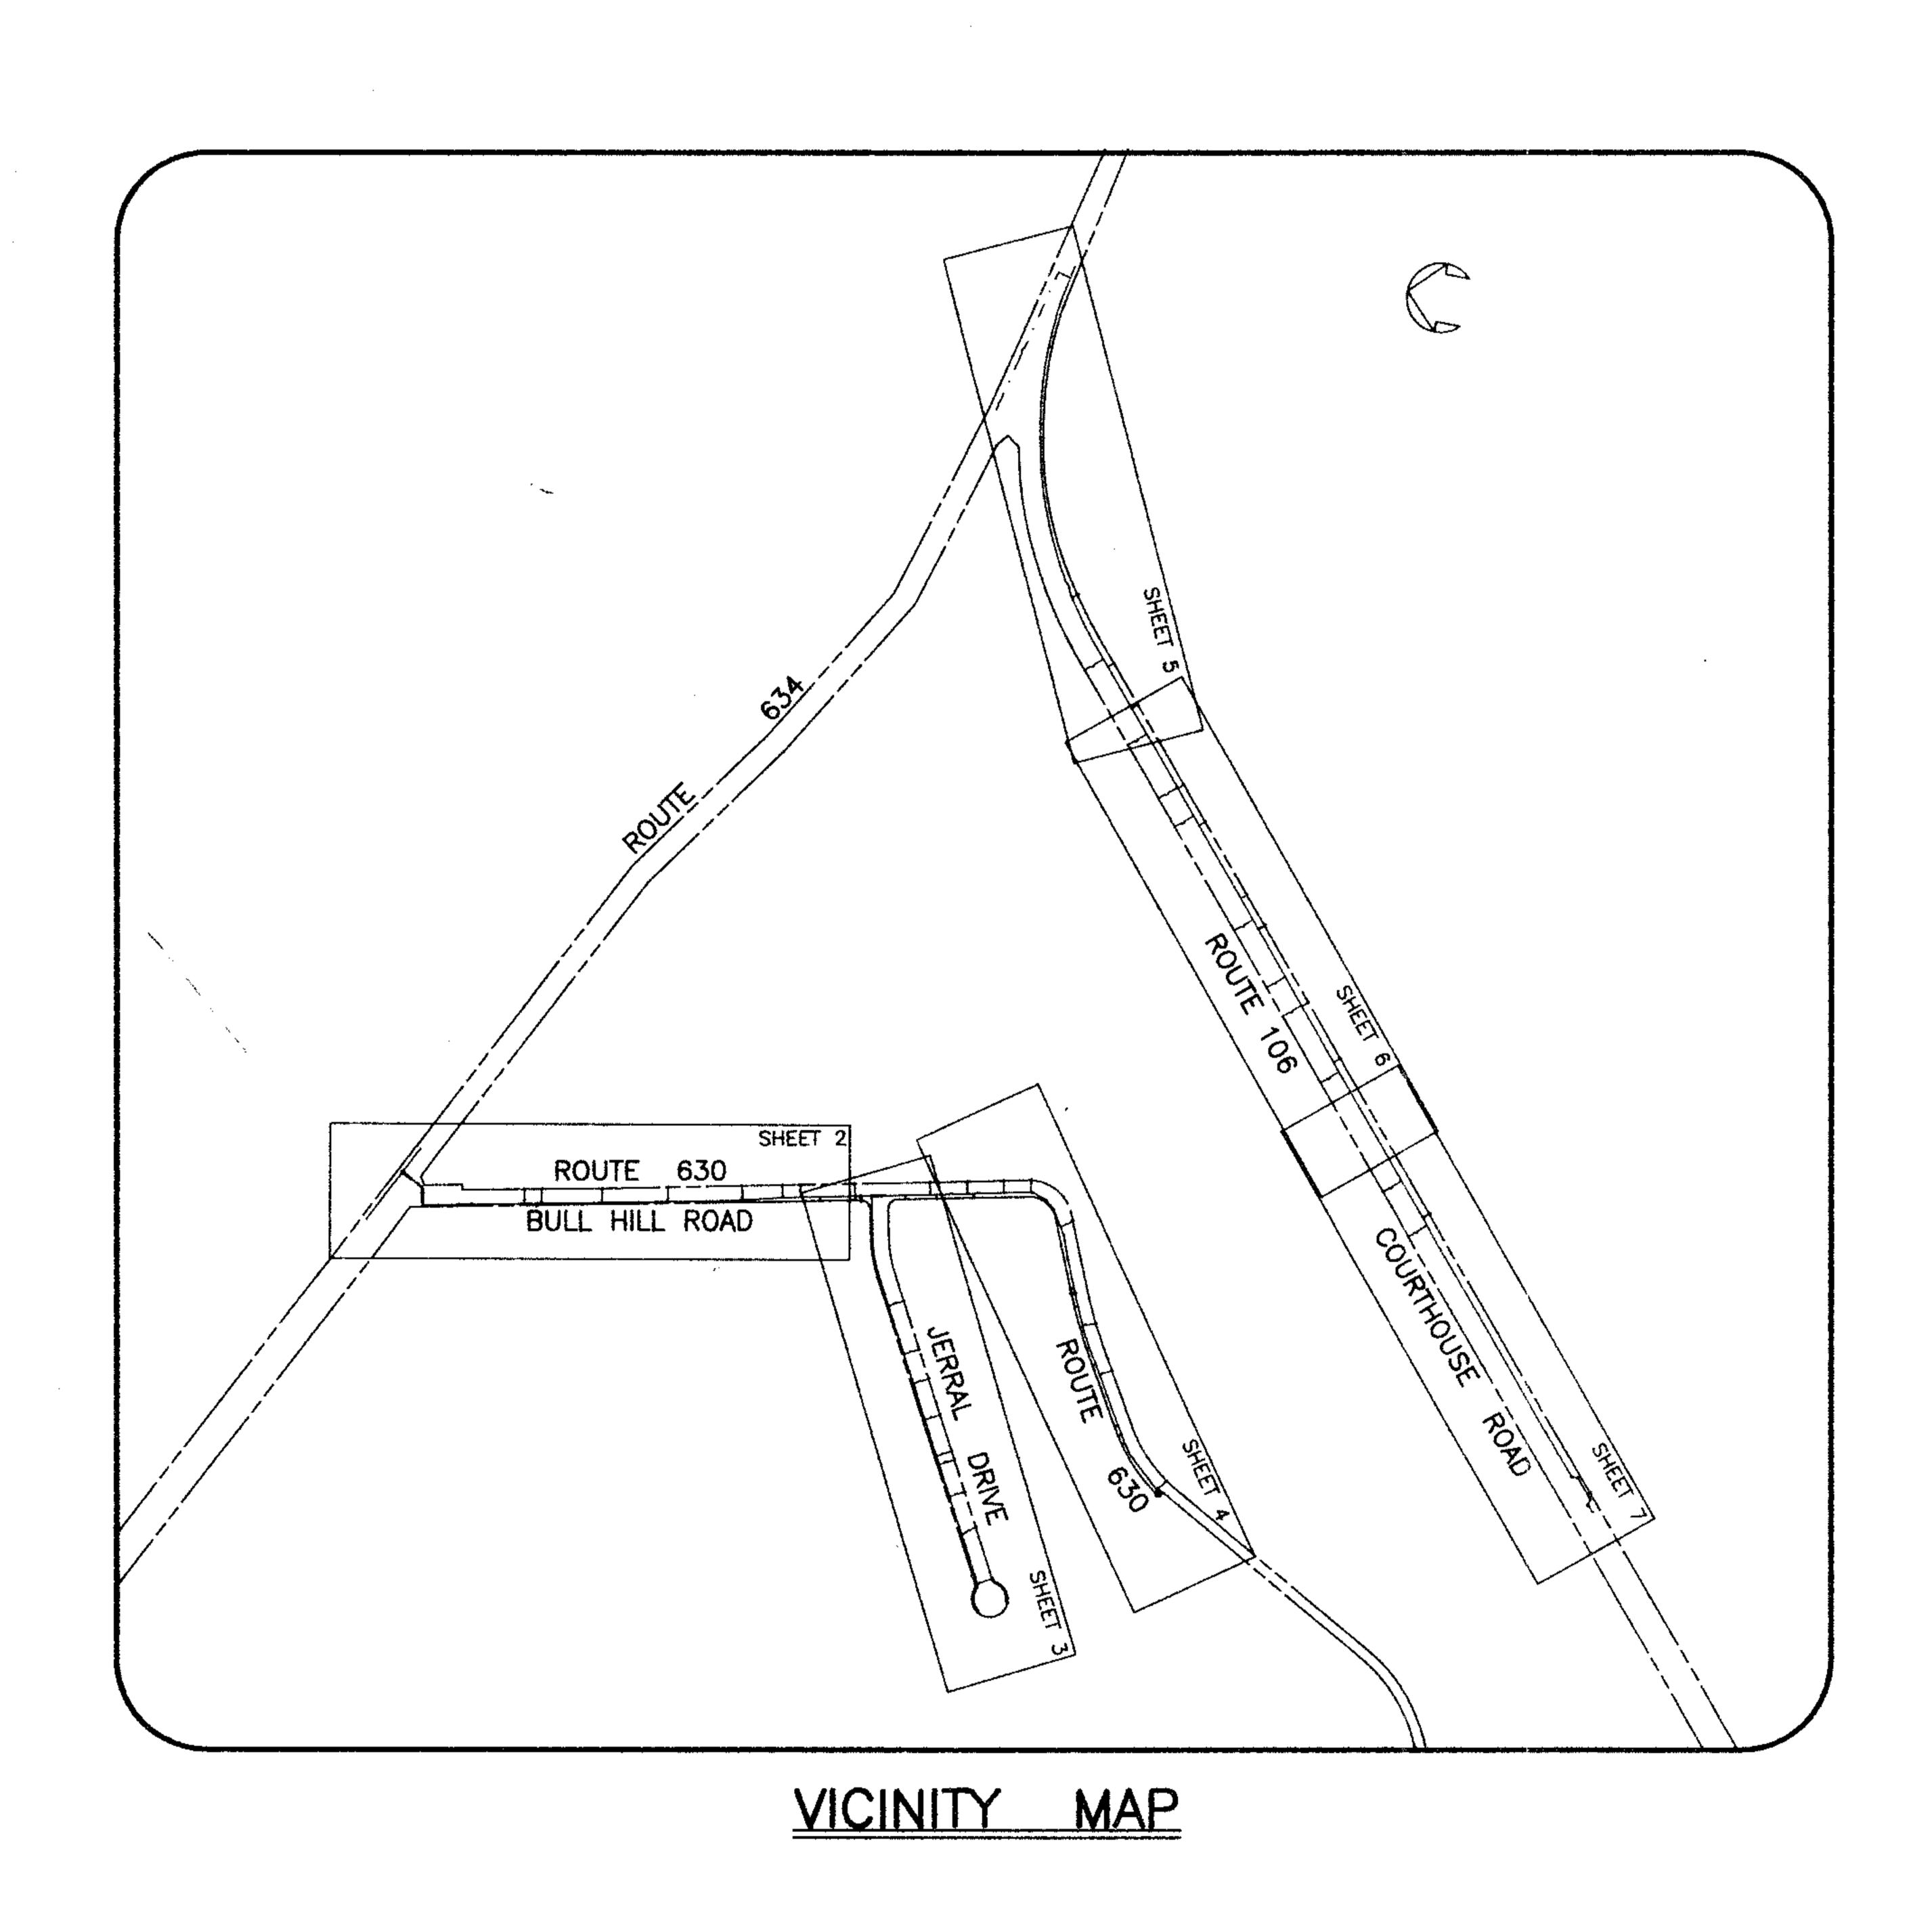

## shown herein.

EXISTING WATER LINE EXISTING UNDERGROUND ELECTRIC/ TELEPHONE LINES EXISTING SANITARY SEWER/ FORCE MAIN EXISTING STORM SEWER RIGHT-OF-WAY/ PROPERTY LINE POWER POLE TELEPHONE BOX WELL MAIL BOX/ NEWSPAPER BOX PROPOSED WATER LINE PEOPOSED SERVICE CONNECTION & METER SET PROPOSED FIRE HYDRANT ASSEMBLY PROPOSED GATE VALVE PROPOSED TEE PROPOSED BEND PROPOSED THRUST BLOCKING

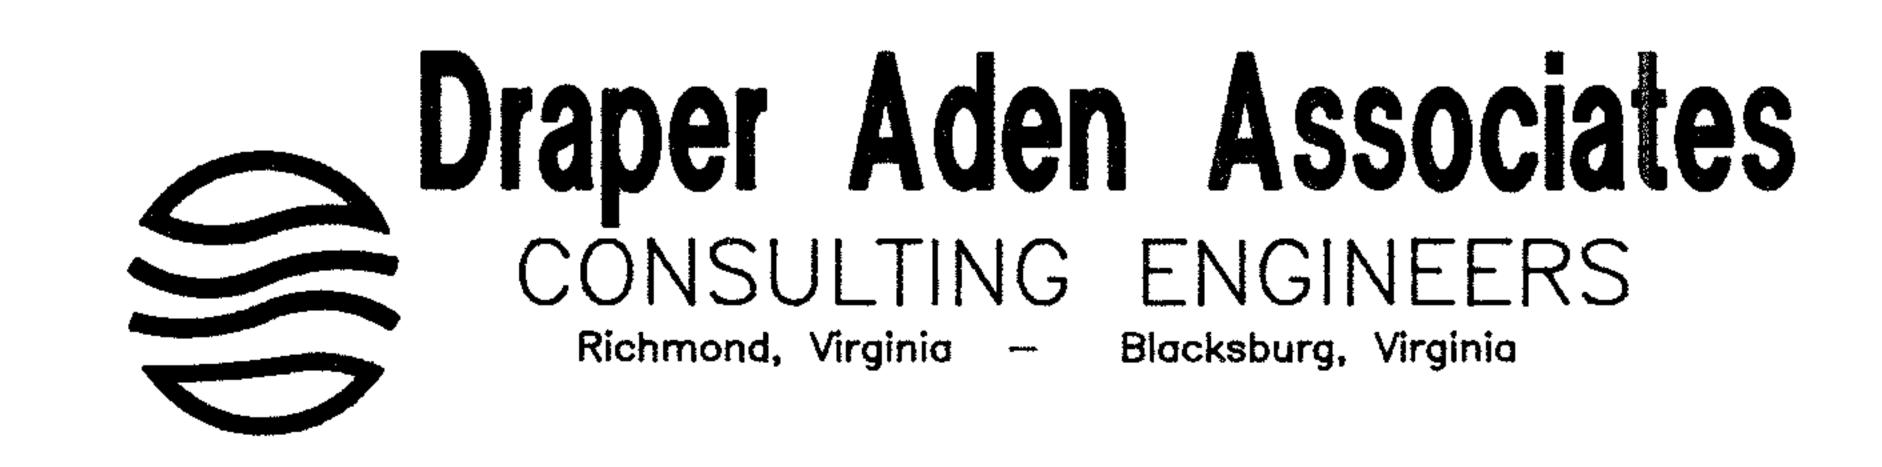

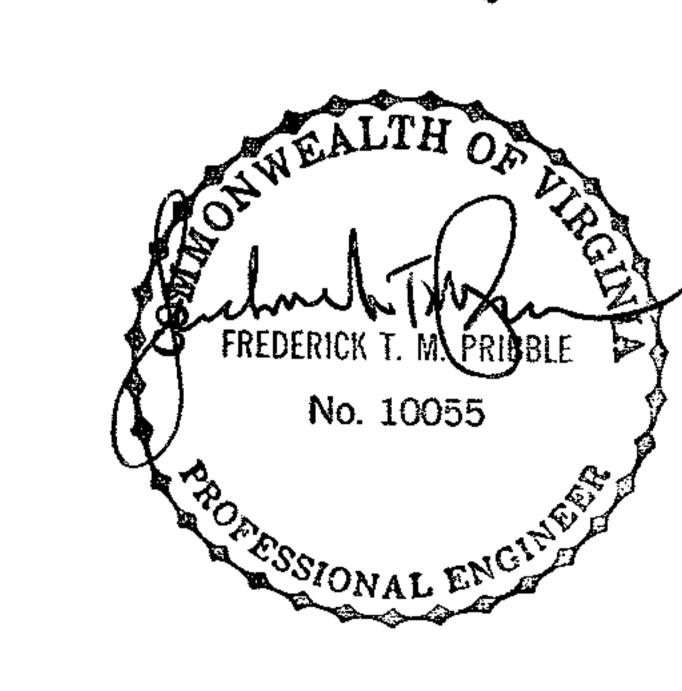

PROJECT NO. 20213

DATE: 1/6/89