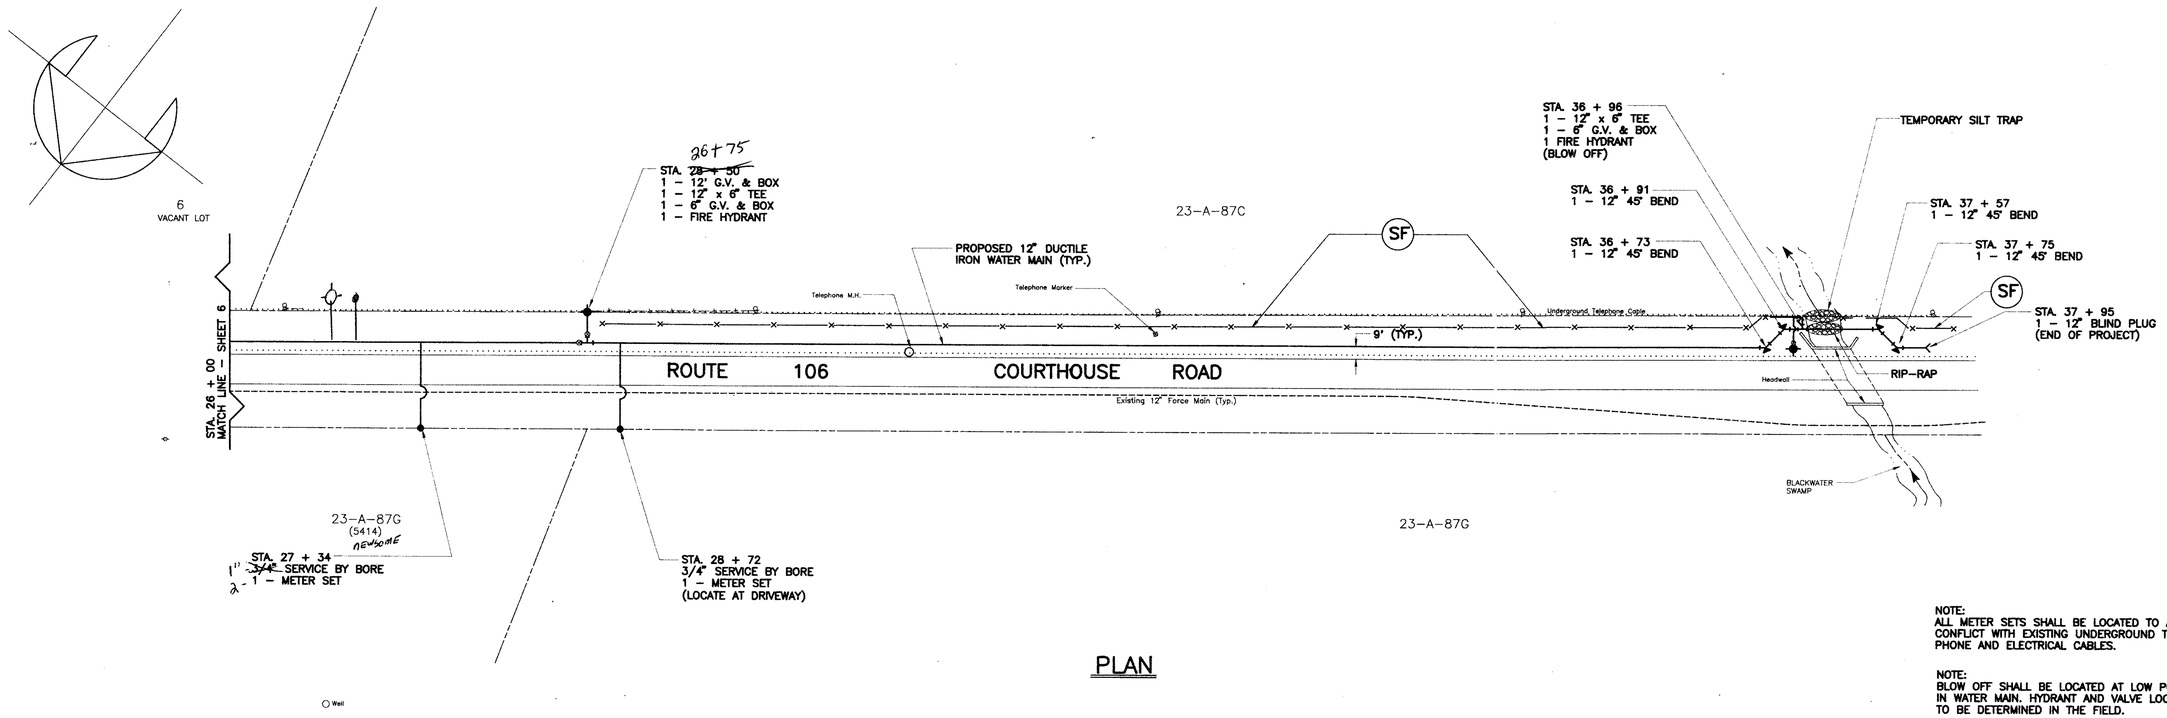

PLAN

NOTE:
ALL METER SETS SHALL BE LOCATED TO AVOID CONFLICT WITH EXISTING UNDERGROUND TELEPHONE AND ELECTRICAL CABLES.

NOTE:
BLOW OFF SHALL BE LOCATED AT LOW POINT IN WATER MAIN. HYDRANT AND VALVE LOCATION TO BE DETERMINED IN THE FIELD.

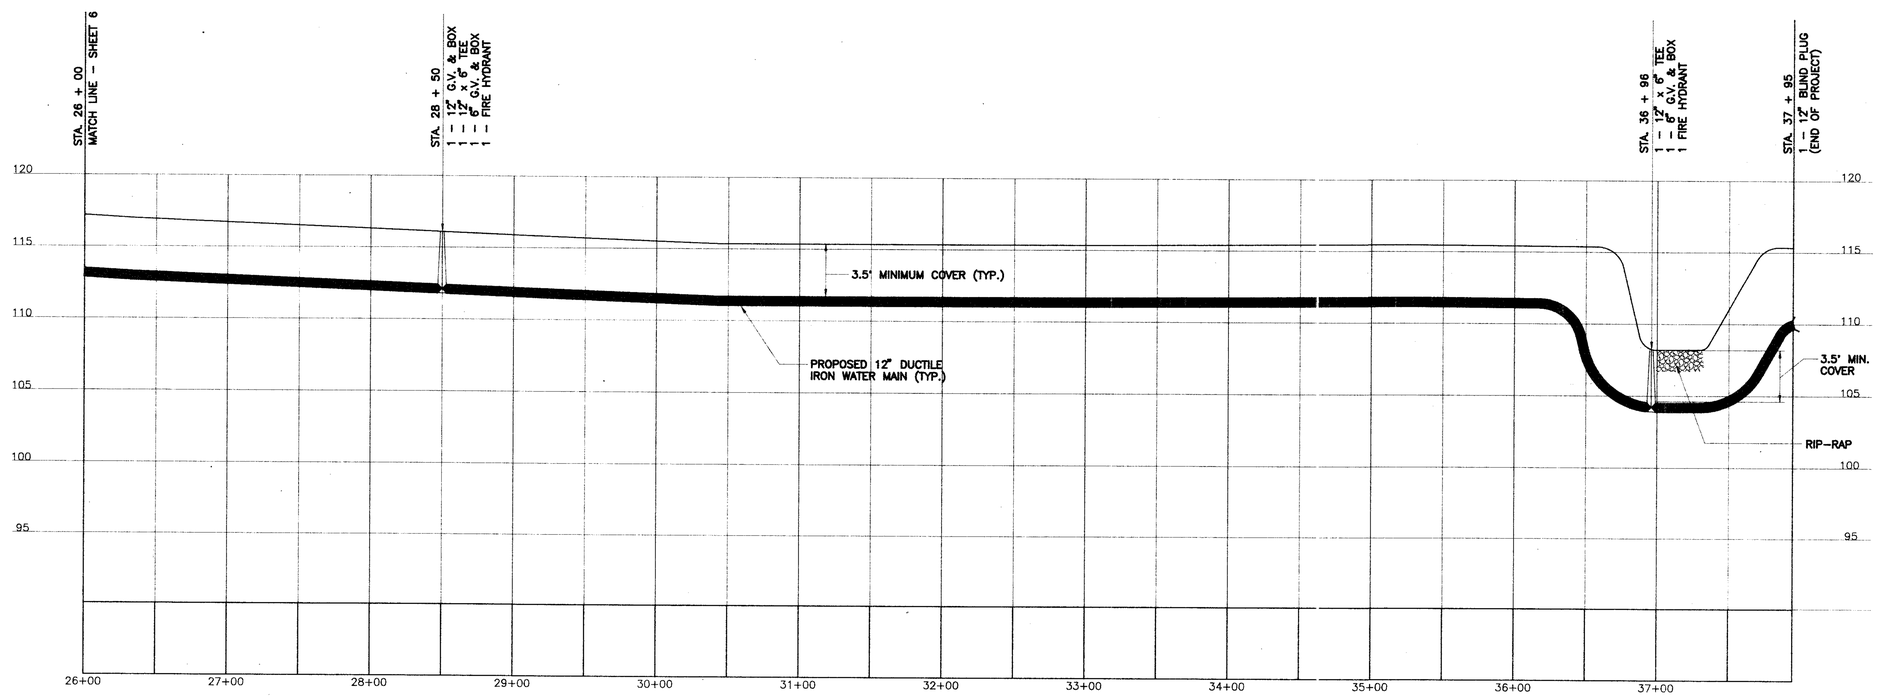

PROFILE

COMMONWEALTH OF VIRGINIA
FREDERICK T. M. PRIBBLE
No. 10055
PROFESSIONAL ENGINEER

Draper Aden Associates CONSULTING ENGINEERS Richmond, Virginia – Blacksburg, Virginia	DESIGNED FTP DRAWN HLJ CHECKED JNL DATE 1/6/89	TEMPLE AVENUE WATER LINE EXTENSION CONTRACT I COUNTY OF PRINCE GEORGE, VIRGINIA	PLAN & PROFILE COURTHOUSE ROAD ADDITION	REVISIONS	SCALE: HORZ: 1" = 50' VERT: 1" = 5' PLAN NO. T – 20213	SHEET 7 OF 7