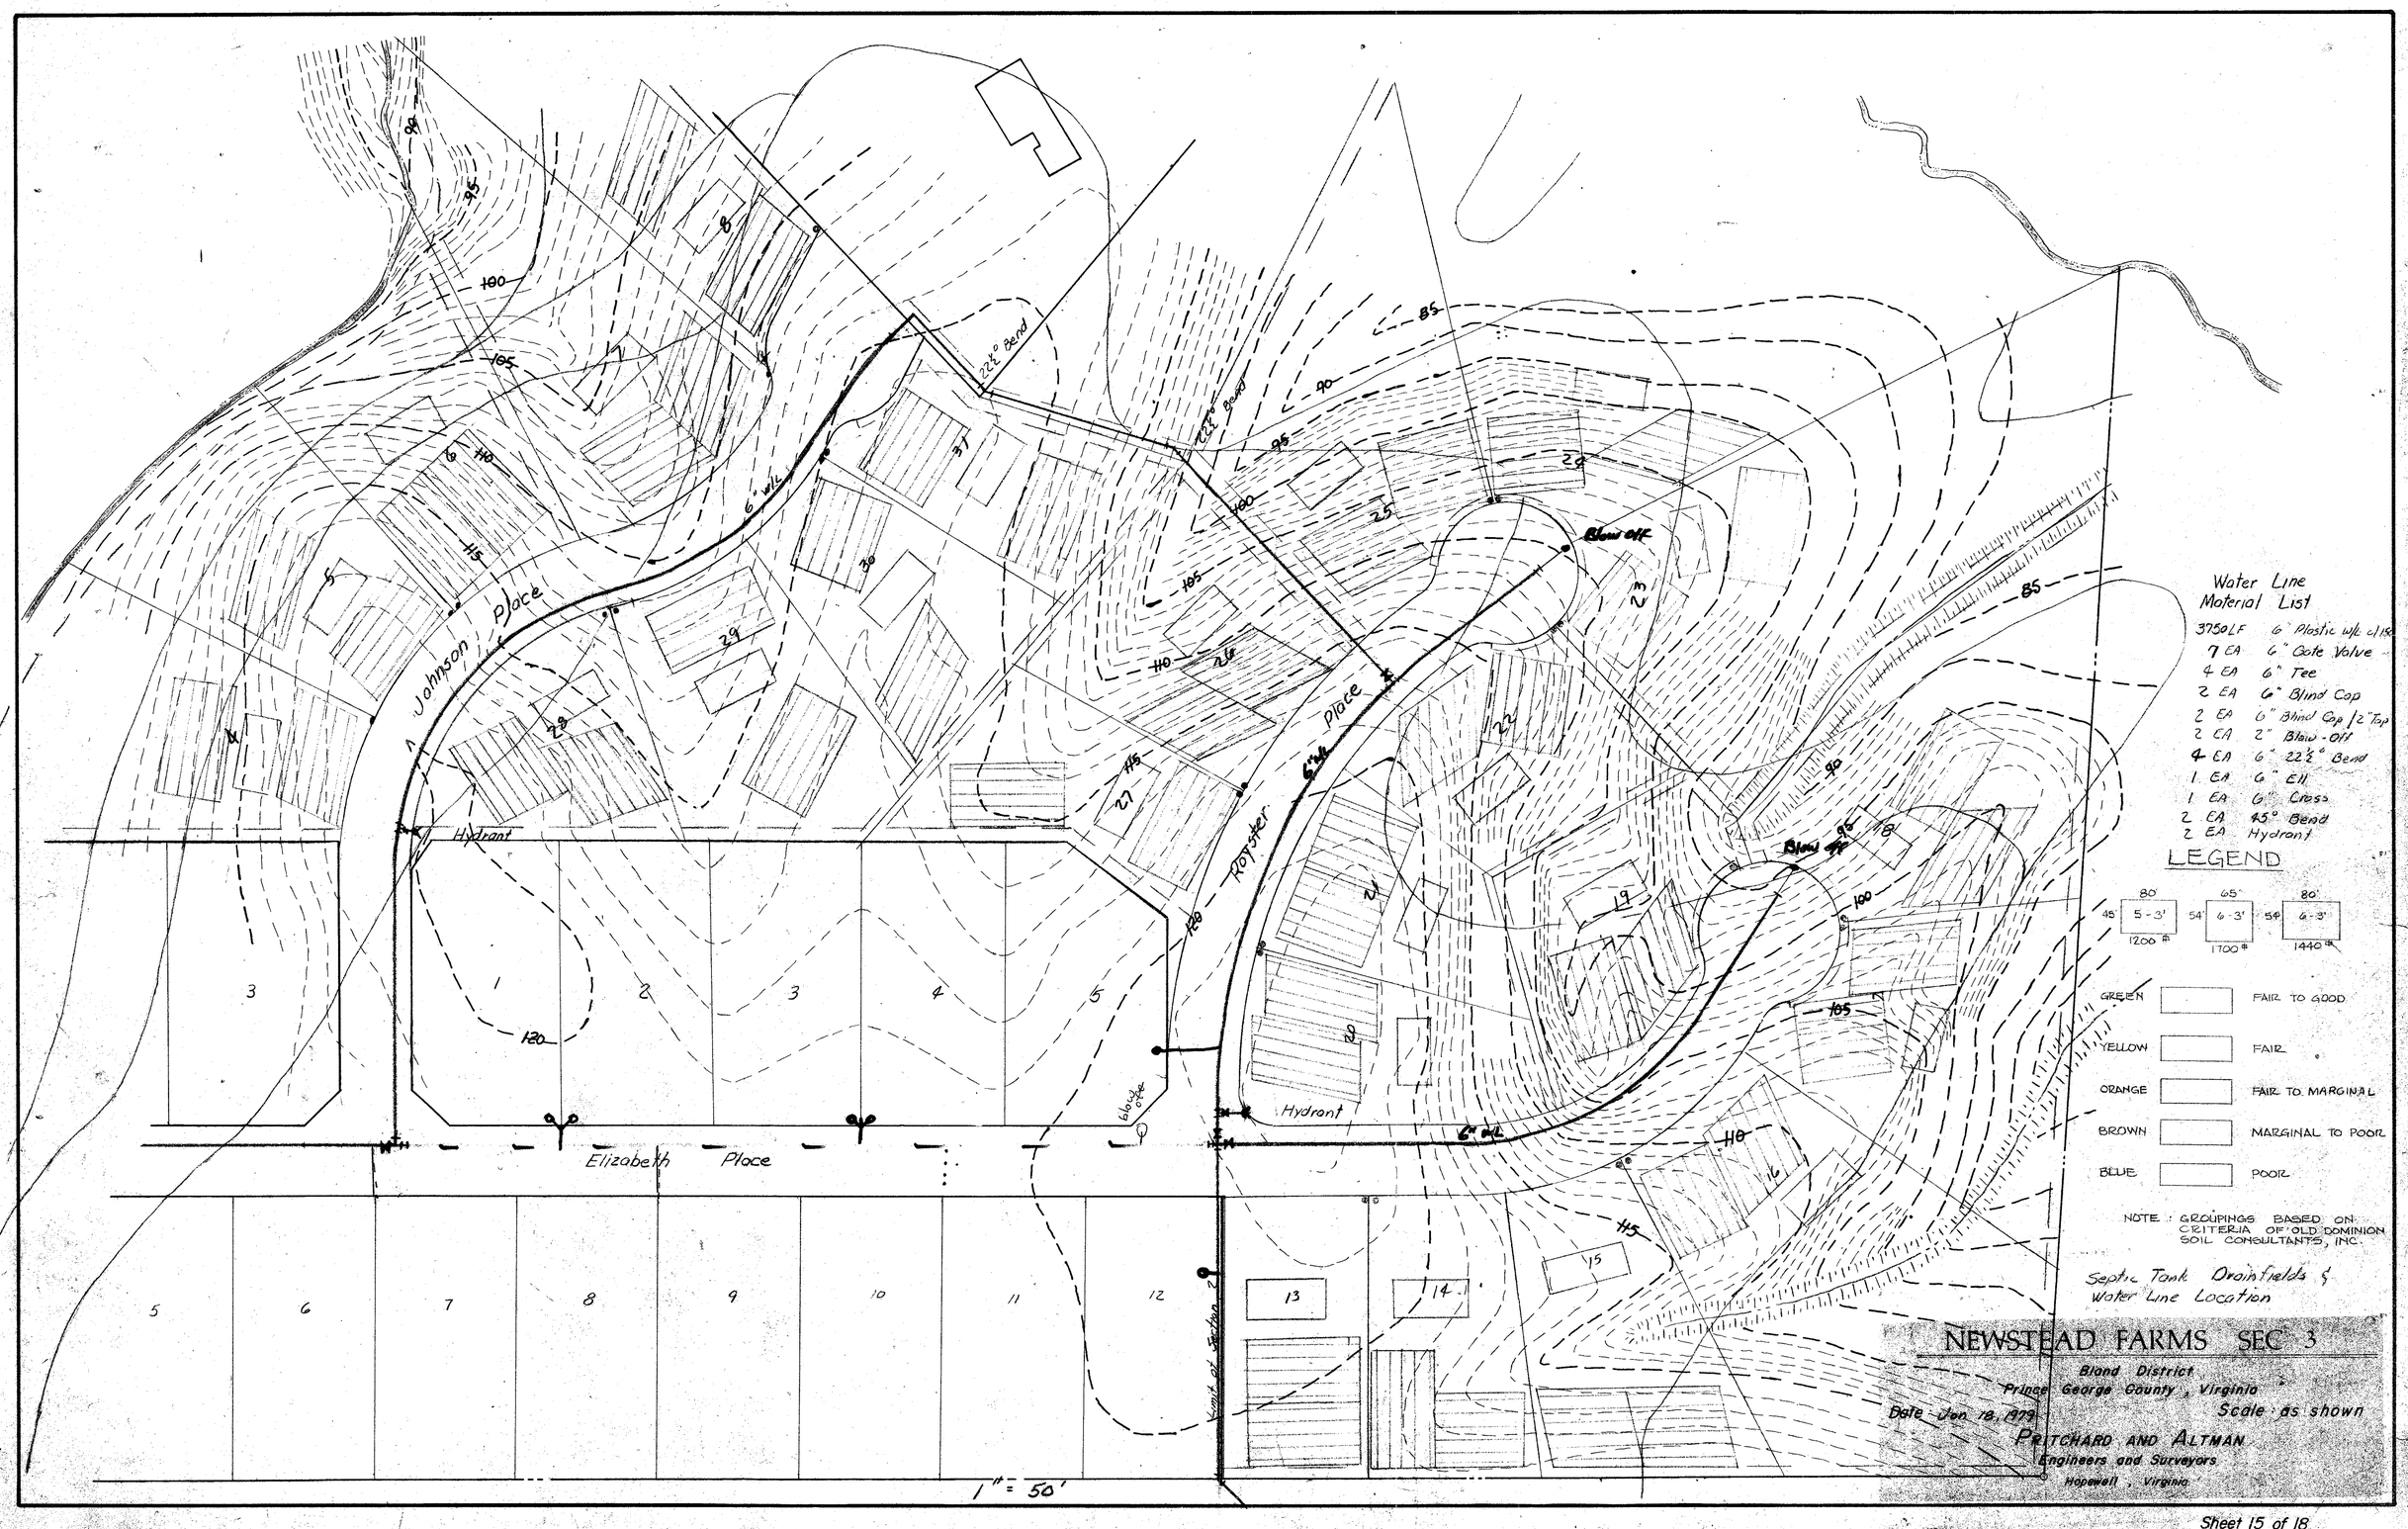
Johnson Place
Royster Place
Elizabeth Place
Hydrant
Hydrant
Hydrant
Blow off
Blow off
Blow off
22½° Bend
22½° Bend
6" wlc
6" wlc
6" wlc
Block cap
Point of Section
1" = 50'
Water Line Material List
3750 LF 6" Plastic w/c c/150
7 EA 6" Gate Valve
4 EA 6" Tee
2 EA 6" Blind Cap
2 EA 6" Blind Cap p/2" Tap
2 EA 2" Blow-Off
4 EA 6" 22½° Bend
1 EA 6" Ell
1 EA 6" Cross
2 EA 45° Bend
2 EA Hydrant
LEGEND
80' 45' 5-3' 1200#
65' 54' 6-3' 1700#
80' 54' 6-3' 1440#
GREEN FAIR TO GOOD
YELLOW FAIR
ORANGE FAIR TO MARGINAL
BROWN MARGINAL TO POOR
BLUE POOR
NOTE: GROUPINGS BASED ON CRITERIA OF OLD DOMINION SOIL CONSULTANTS, INC.
Septic Tank Drainfields & Water Line Location
NEWSTEAD FARMS SEC 3
Blond District
Prince George County, Virginia
Date Jan 18, 1979
Scale as shown
PRITCHARD AND ALTMAN
Engineers and Surveyors
Hopewell, Virginia