


- 1. MR. JOHN HARRIS, PLANT SUPERVISOR, MUST BE GIVEN 48 HOURS NOTICE OF ALL CROSSINGS.
- 2. WATER AND SEWER PIPE SHALL BE LAID AT SAME TIME AT EACH CROSSING.
- 3. ALL BACKFILL WILL BE PER DETAIL AND INCLUDES APPLYING SURFACE ASPHALT ON SAME DAY AS CROSSING. COMPACTION WILL BE BY VIBRATING PLATE.
- 4. CROSSINGS WILL OCCUR PER THE FOLLOWING SCHEDULE:

 A) NORTHERNMOST ENTRANCE: BETWEEN 1 PM SATURDAY AND 10 PM SUNDAY
- OR ON A HOLIDAY.


 B) MIDDLE ENTRANCE: SAME AS ABOVE OR BETWEEN 6 PM AND 1 AM
- C) SOUTHERNMOST ENTRANCE: SAME AS ABOVE WITH TEMPORARY ACCESS REQUIRED. TEMPORARY ACCESS MUST BE APPROVED BY MR. HARRIS


BEFORE CROSSING ENTRANCE.

5. INGRESS AND EGRESS MUST BE AVAILABLE AT ALL TIMES TO THE LOADING DOCK AND EMPLOYEE PARKING LOT.

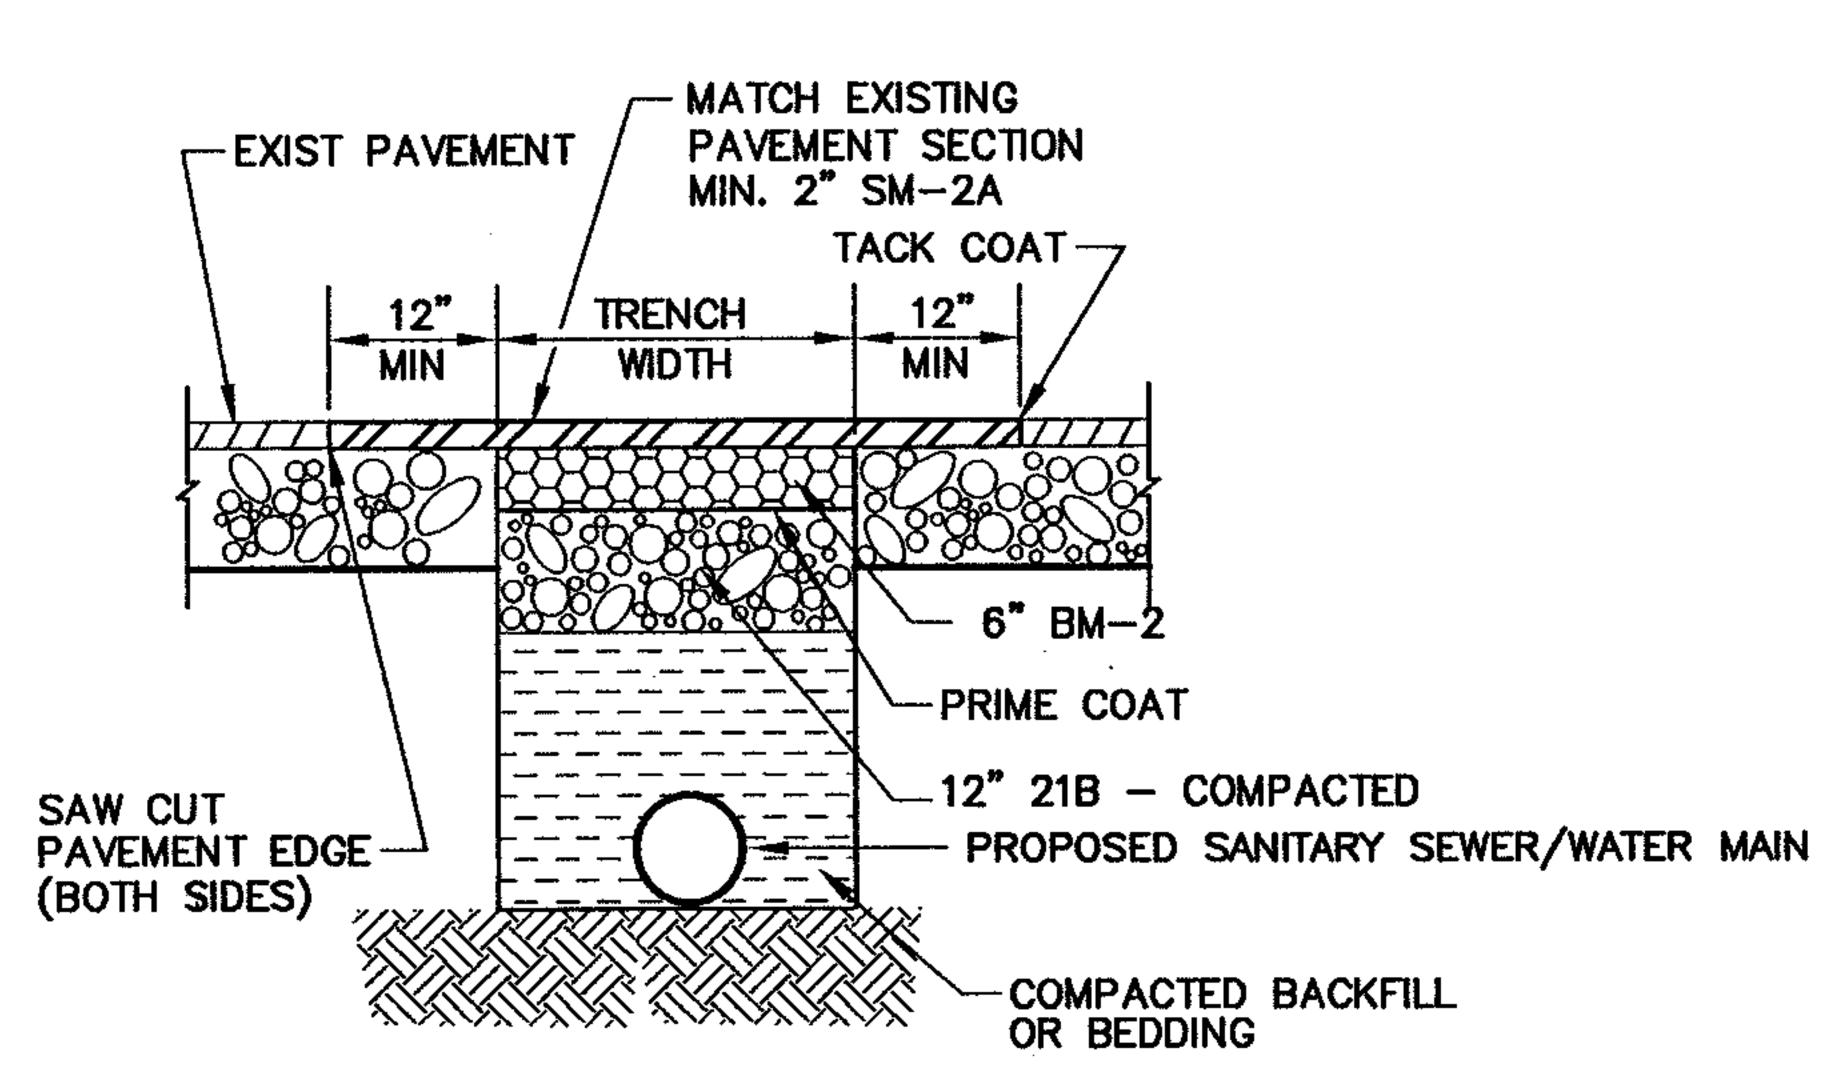

PAVEMENT PATCHING
NO SCALE

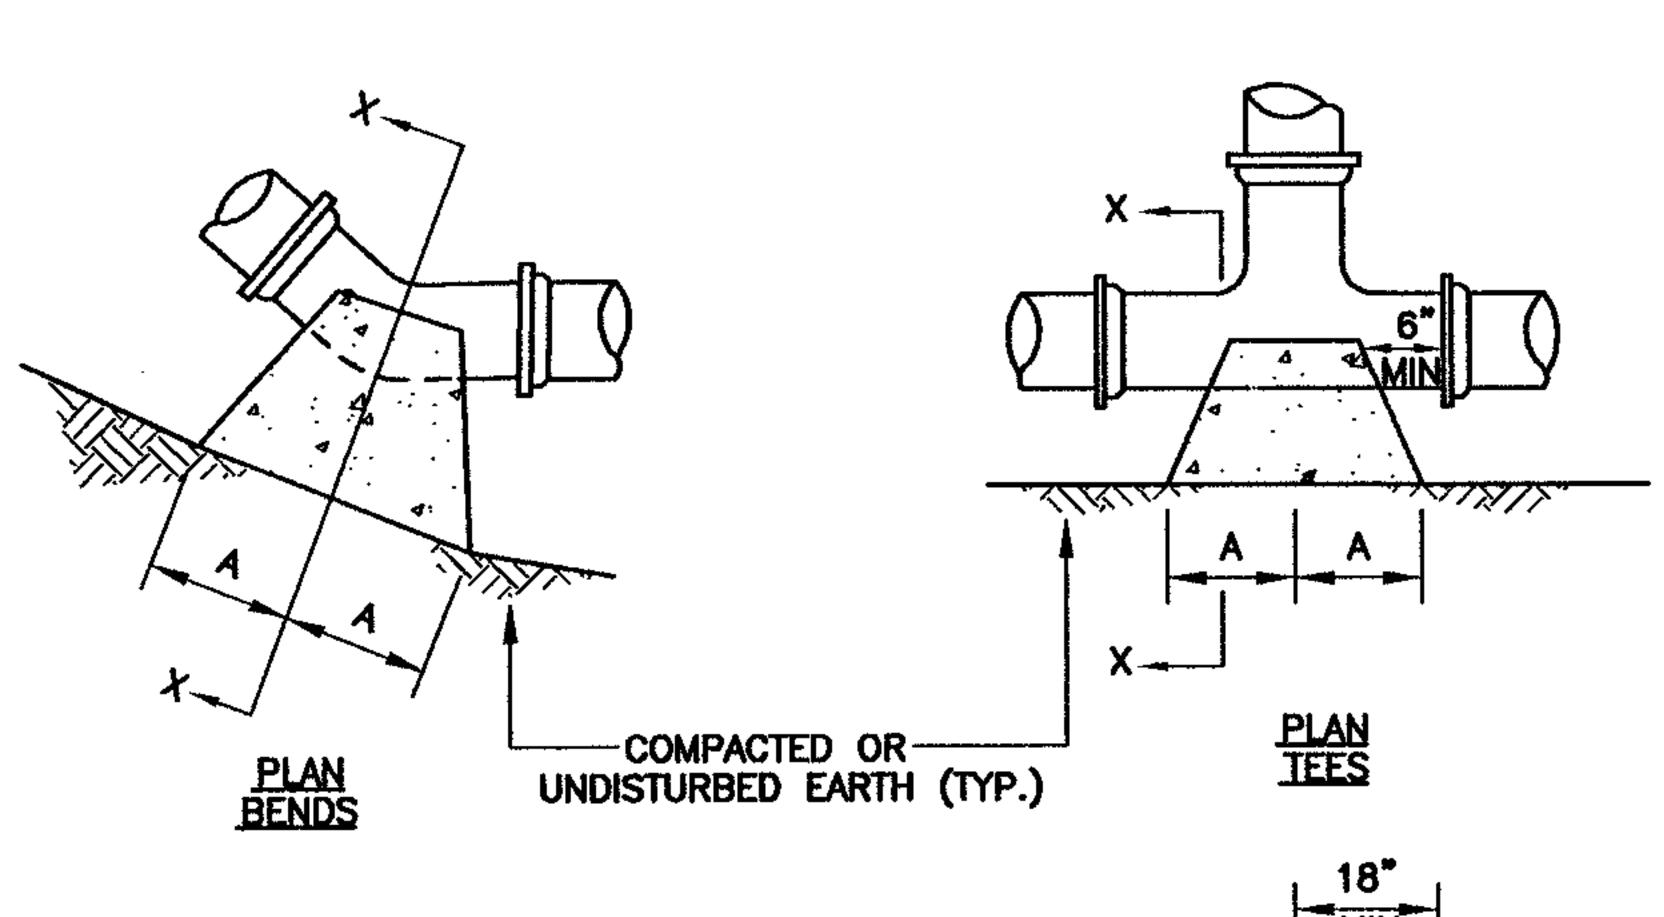


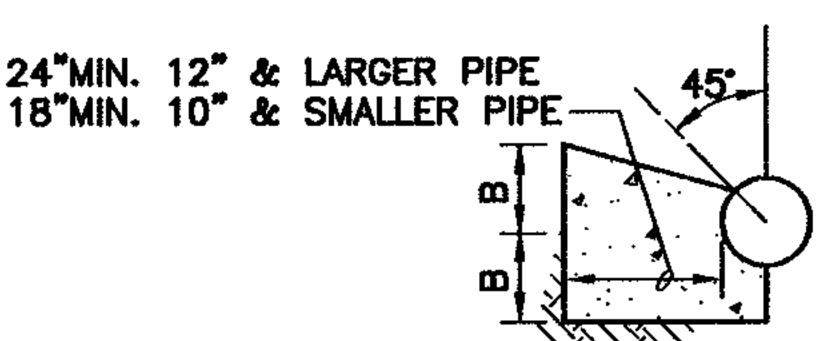




PLAN & ELEVATION PLUGS

SIZE	1/4BENDS		1/8BENDS		1/16BENDS		TEES		PLUGS	
	Α	В	Α	В	Α	В	Α	В	С	D
3"	12"	8"	6*	8"	4"	6"	8"	8"	8"	18
4"	12"	8*	6 "	8*	4"	6"	8*	8*	8"	18
6"	16"	10"	9"	10"	6*	8*	10"	12"	10"	21
8"	22"	18"	12"	13"	8"	10"	18"	16"	12"	29
10"	26"	17"	14"	17"	10"	13"	16"	20*	14"	36

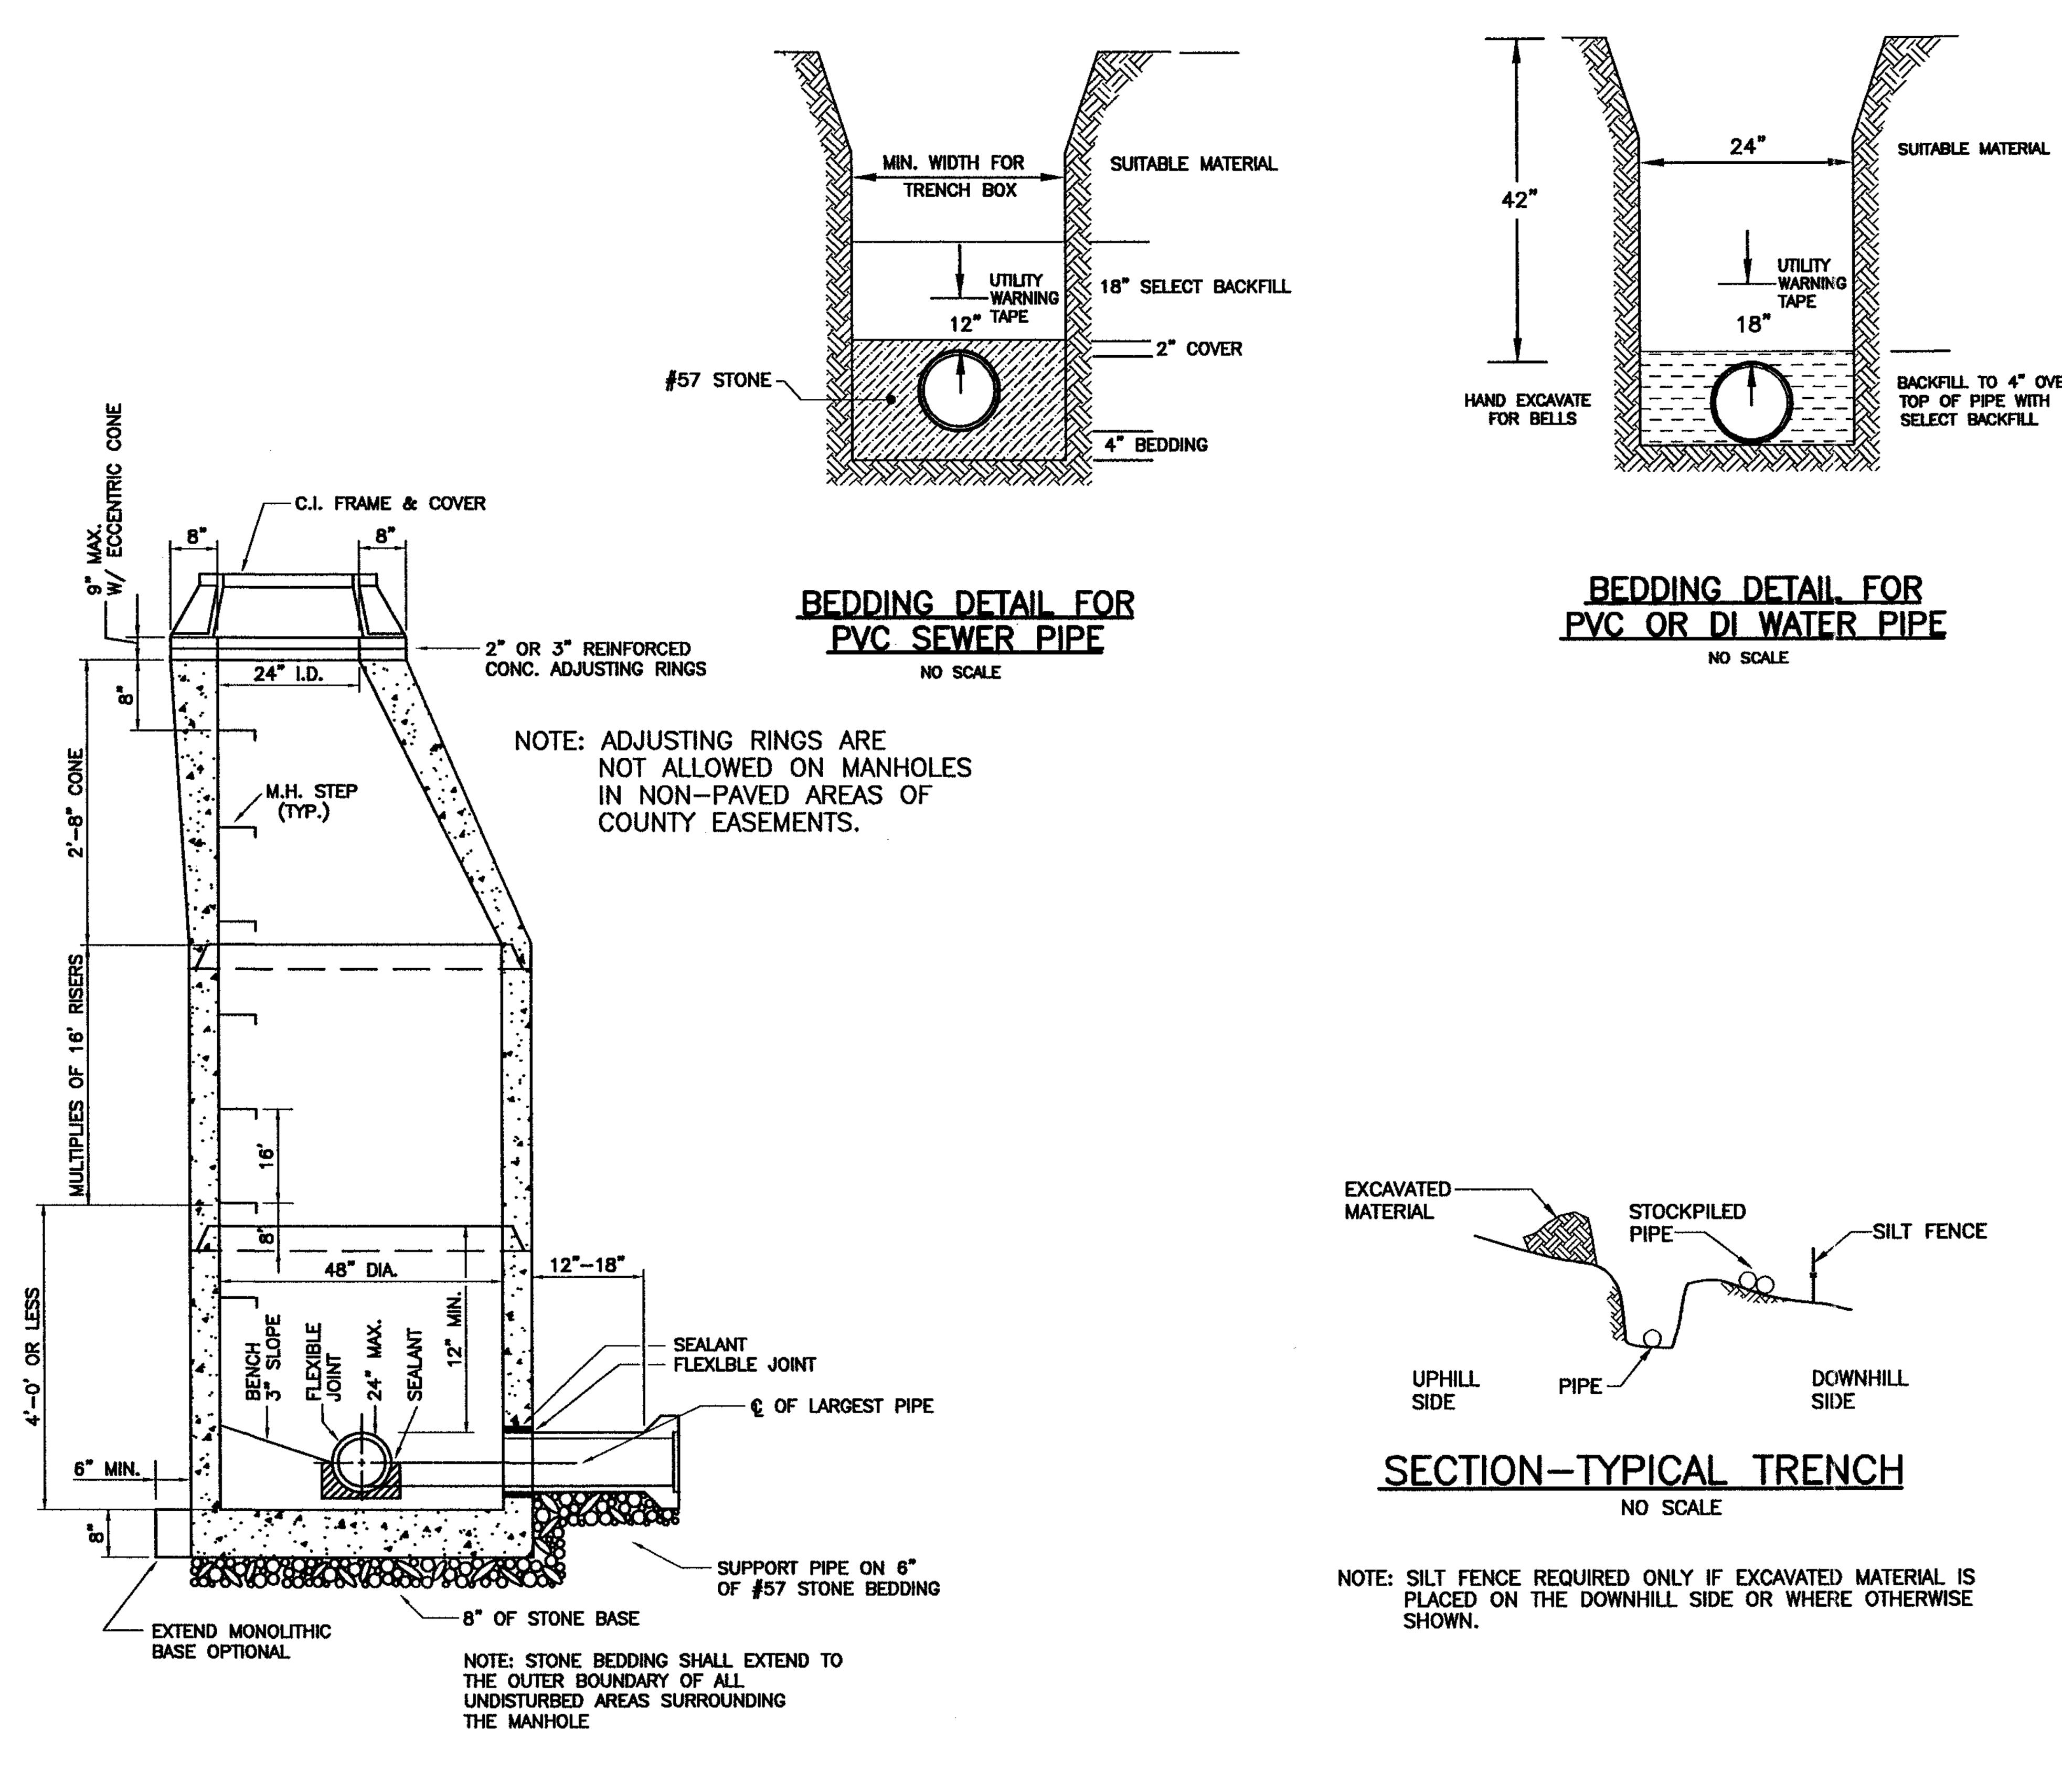


SANITARY MANHOLE DETAIL
NO SCALE

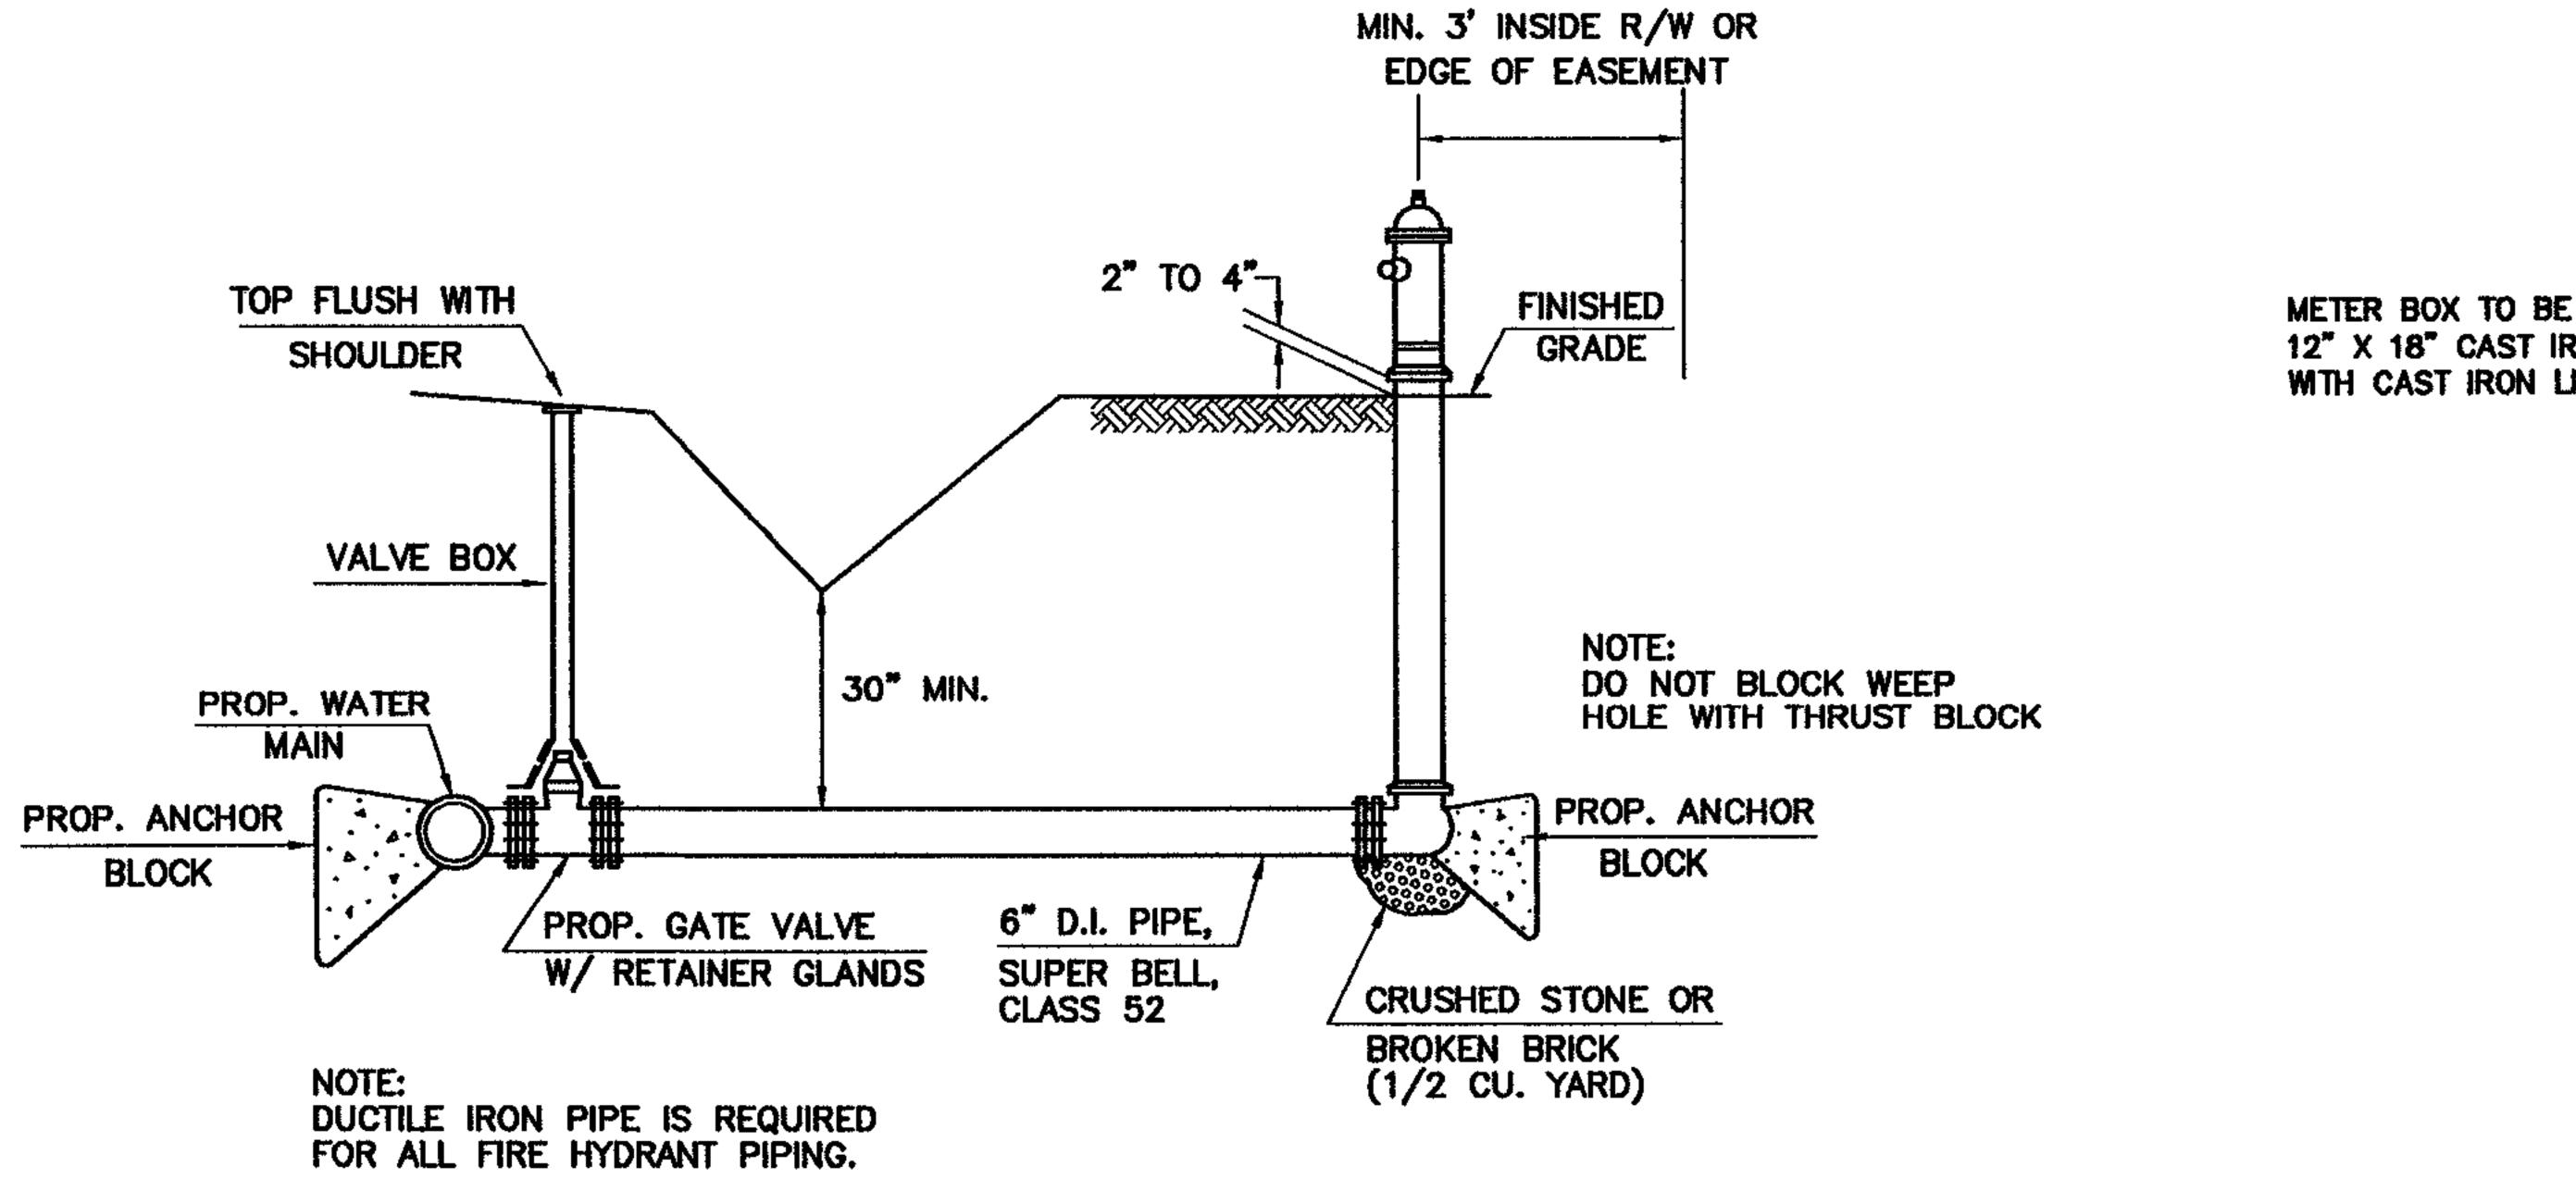


FIRE HYDRANT


NO SCALE

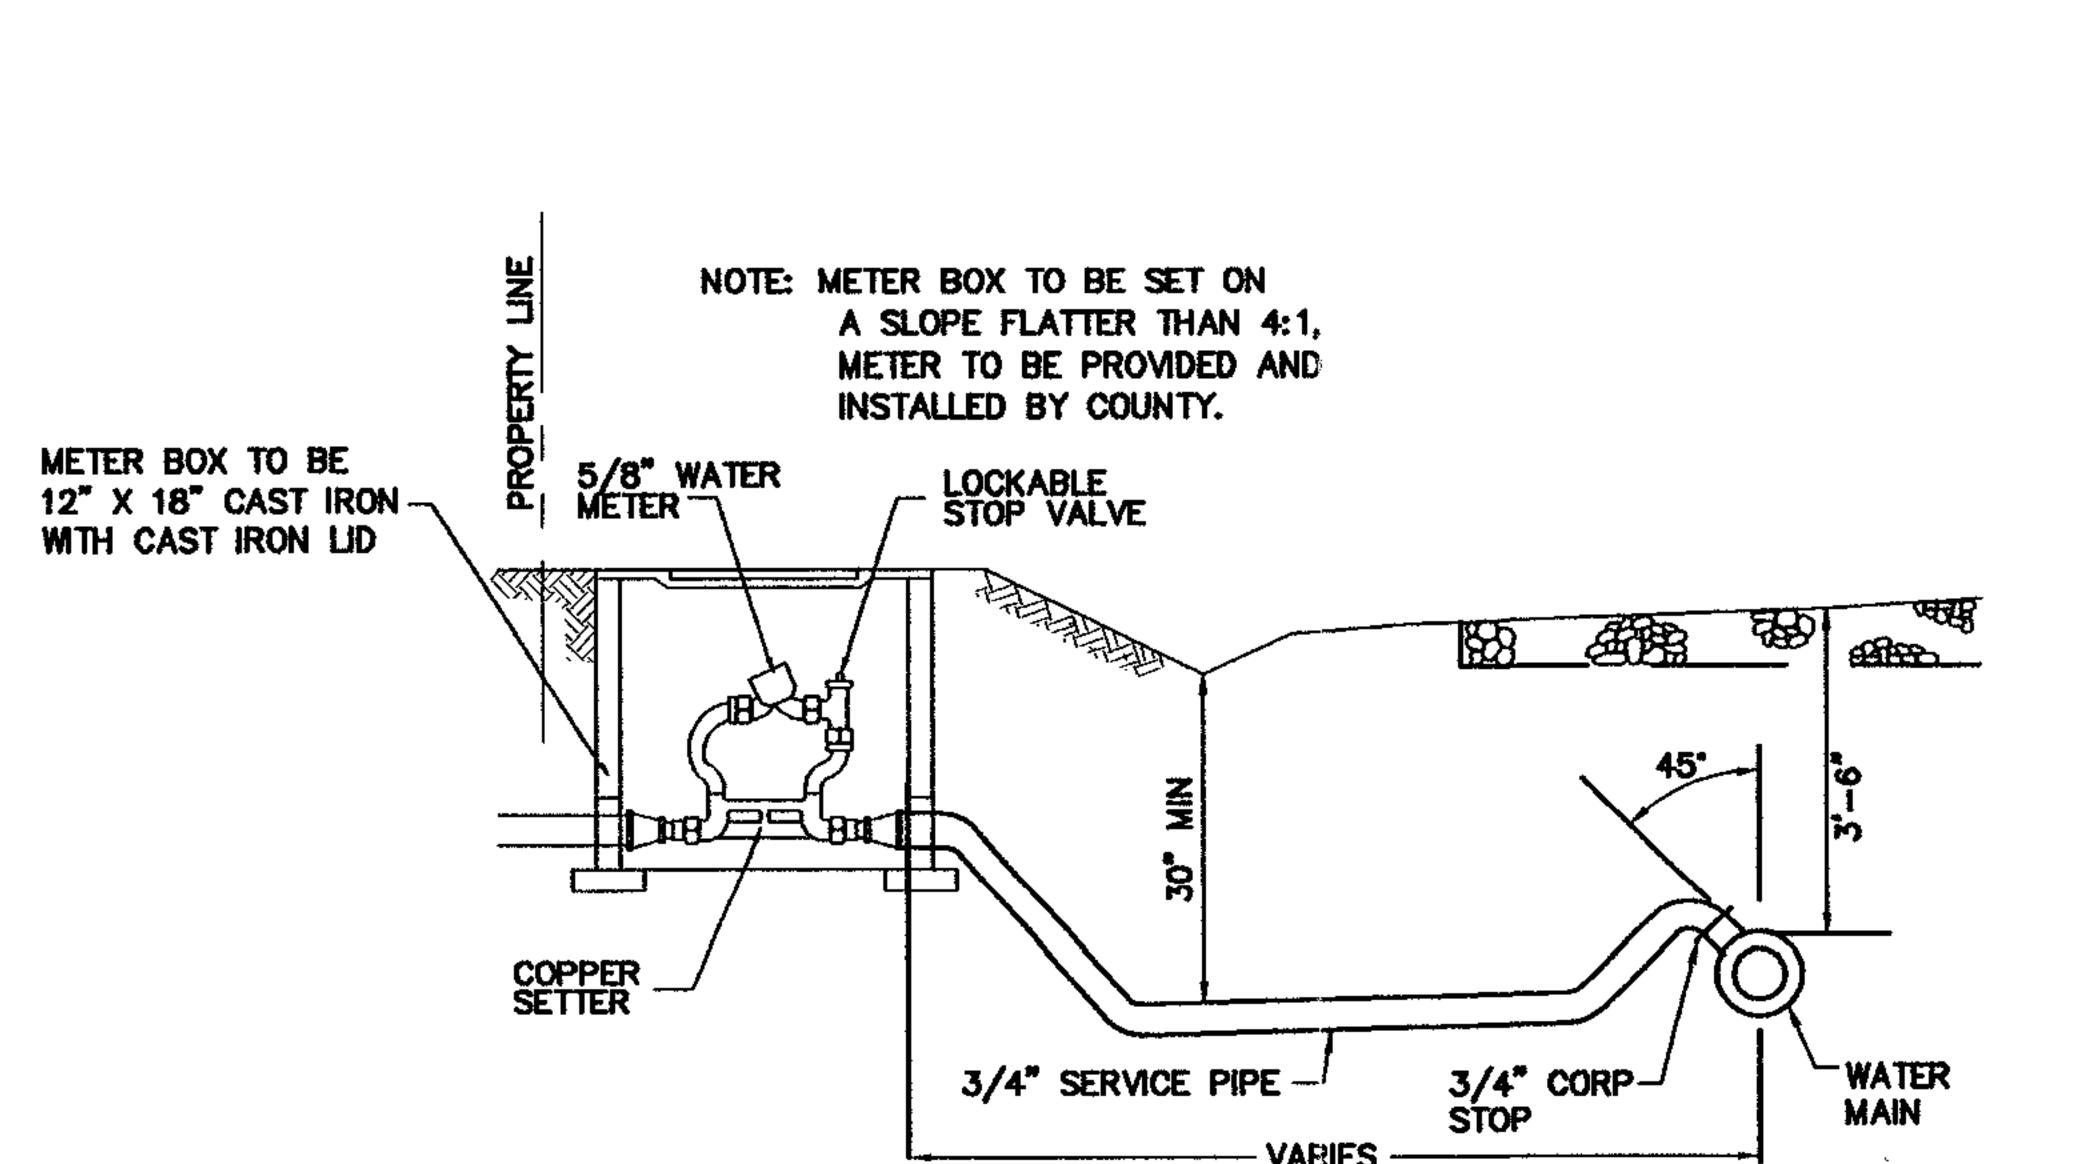


DETAIL — WATER SERVICE CONNECTION NO SCALE

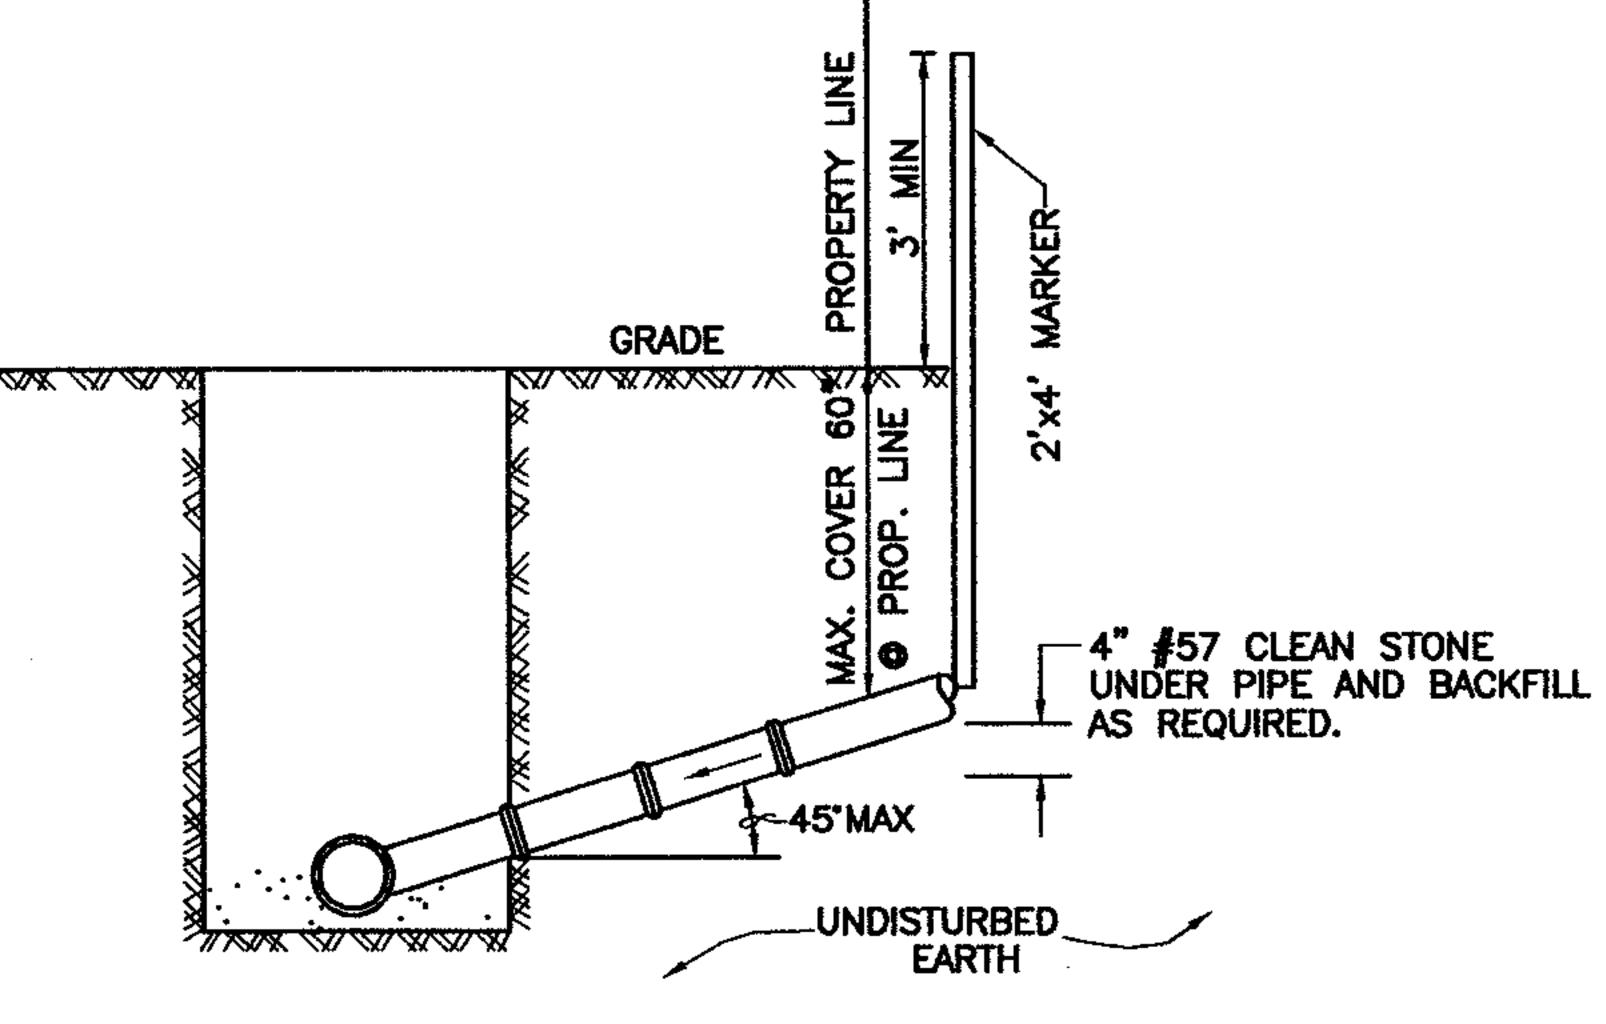

DEEP HOUSE CONNECTION

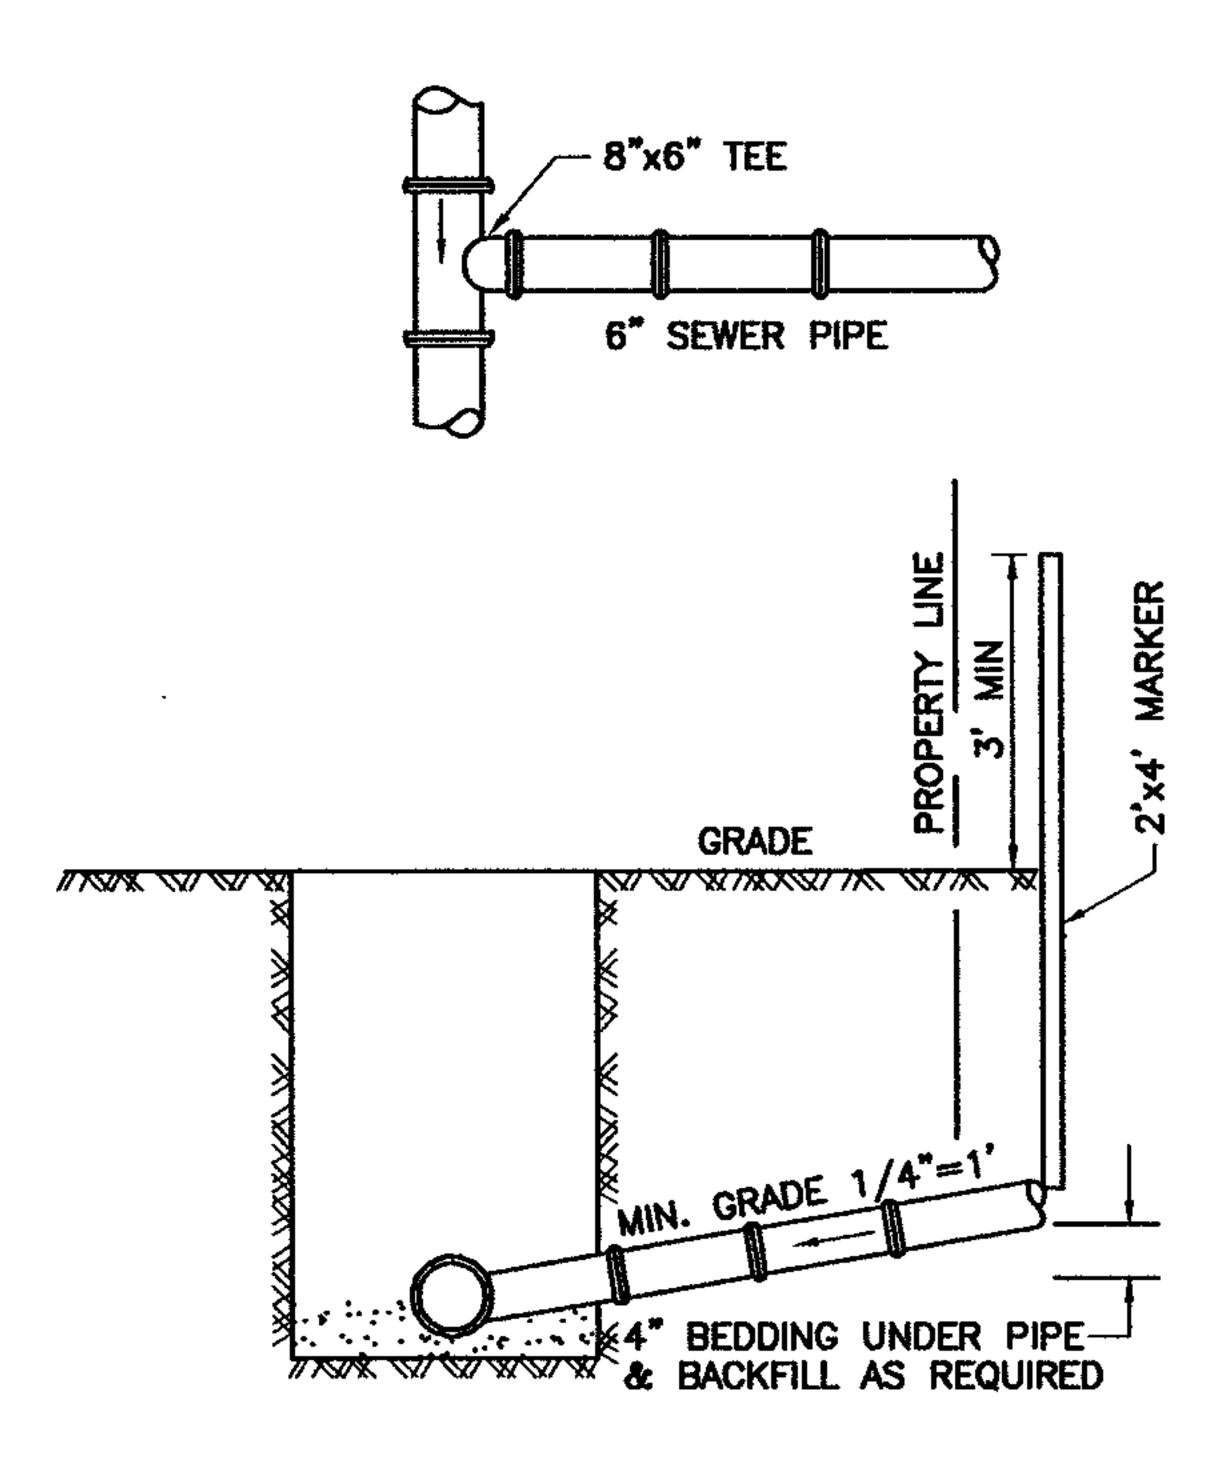

STD. HOUSE CONNECTION NO SCALE

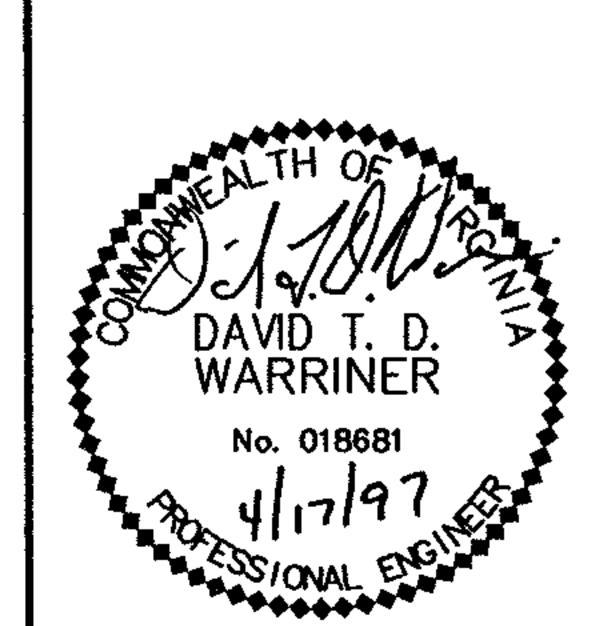

AUSTIN BROCKENBROUGH AND ASSOCIATES

CONSULTING ENGINEERS

4800 W. HUNDRED RD. CHESTER, VIRGINIA 23831
(804) 748-8746 FAX: (804) 777-9907

DATE DEC. 6, 1996 DESIGNED DTDW DRAWING NO.

REV: APRIL 17, 1997 DRAWN AB&A

JOB NO. 96-102 APPROVED DTDW

ABOUT TIME OF CHESTER, VIRGINIA 23831

CHESTER, VIRGINIA 23831

CHESTER, VIRGINIA 23831

APPROVED DTDW

DRAWING NO.

2 0F