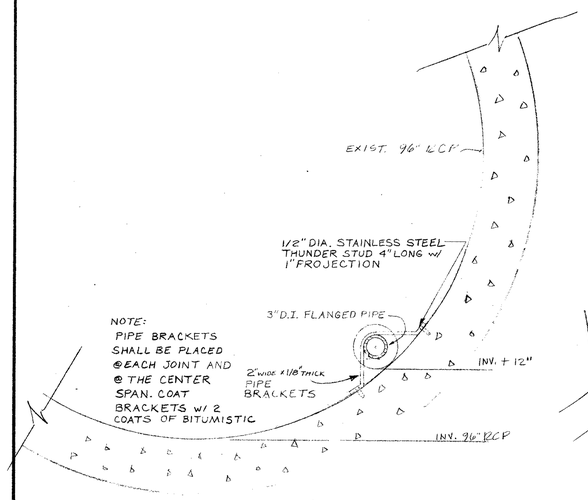

NOTE:
PIPE BRACKETS SHALL BE PLACED @ EACH JOINT AND @ THE CENTER SPAN. COAT BRACKETS w/ 2 COATS OF BITUMISTIC

SECTION THROUGH CULVERT SHOWING PROPOSED FORCED MAIN
SCALE 1"=1'

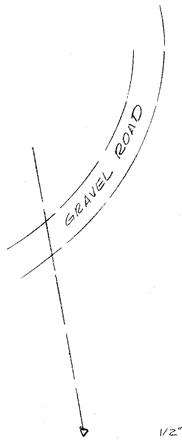

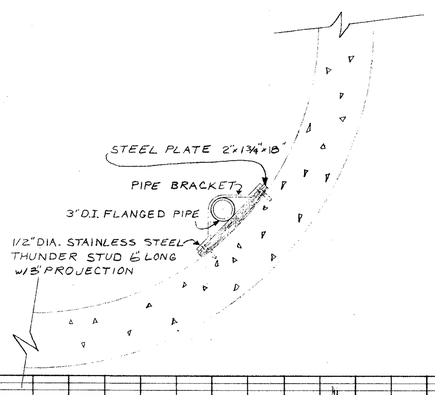

SECTION THROUGH CULVERT SHOWING SUPPORT @ CENTER SPAN OF 3" D.I FLANGED PIPE
SCALE 1"=1'

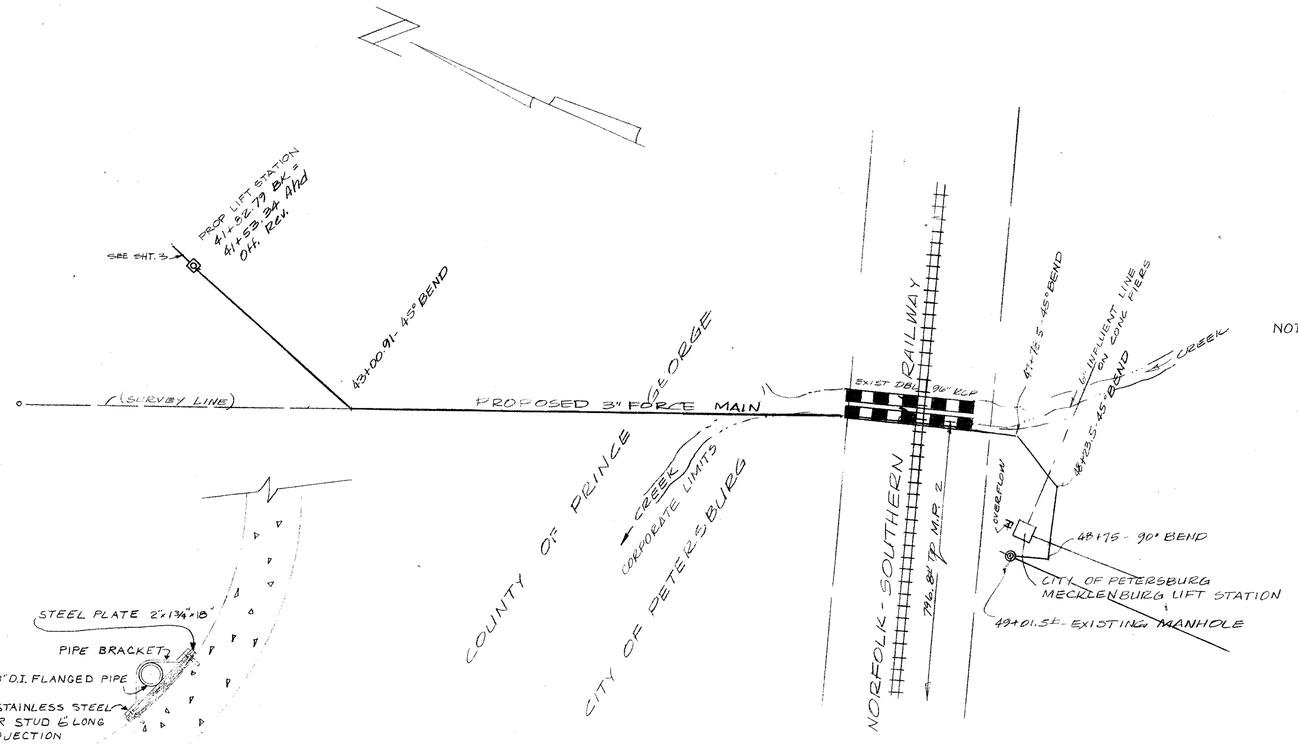

PLAN
SCALE
1" = 50'

NOTES:
1) Provide Thrust Blocks at all bends in accordance with Prince George County Standards.
2) Provide Force Main Manhole Connection in accordance with Prince George County Standards.

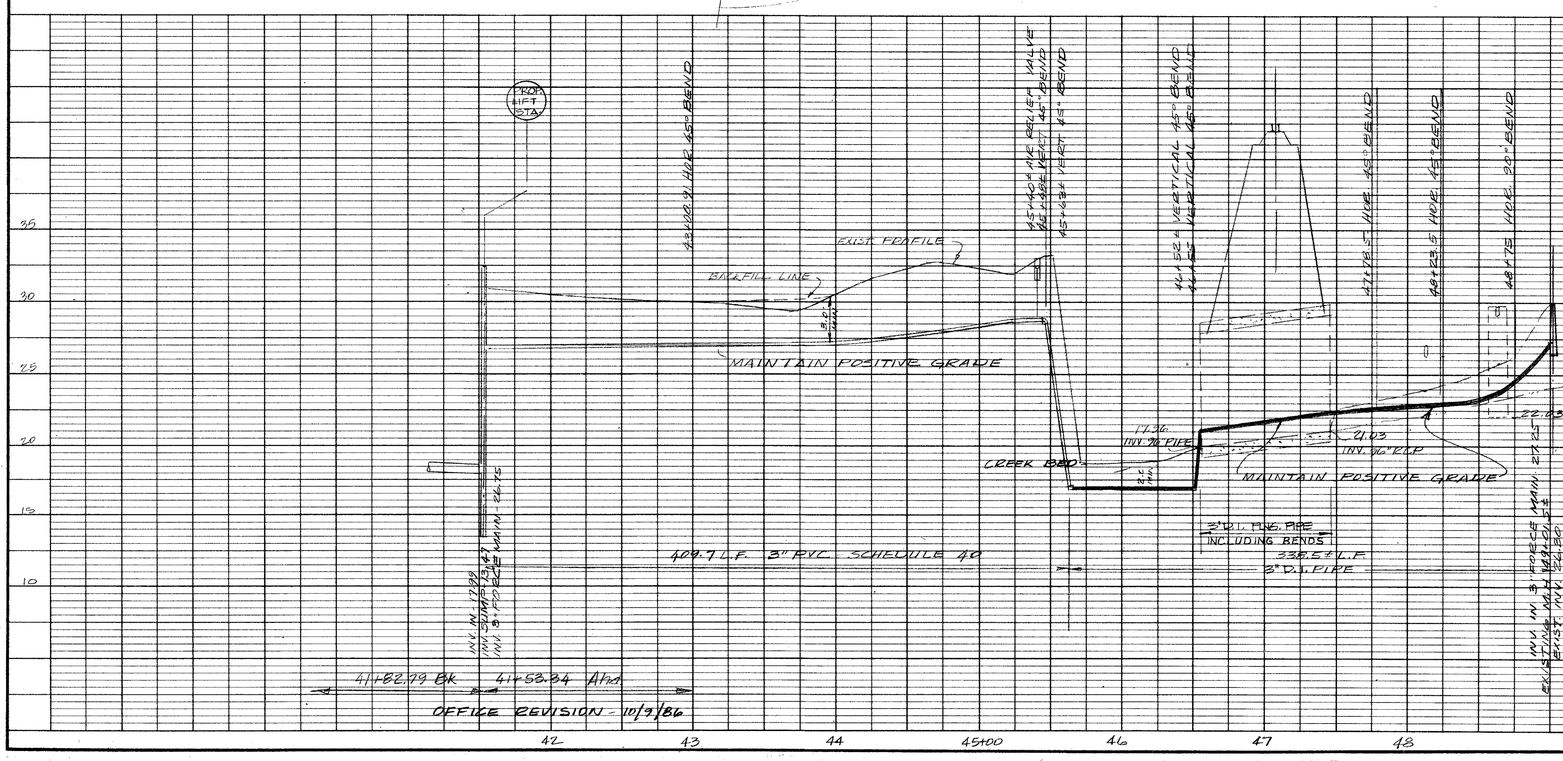

OFFICE REVISION - 10/9/86

NO.	DATE	REVISIONS
	10/9/86	REROUTE FORCE MAIN

CERTIFICATION

FORCE MAIN

PUDDLEDOCK ROAD SEWER SYSTEM
PRINCE GEORGE COUNTY, VIRGINIA

B & B Consultants, Inc.
CONSULTING ENGINEERS - SURVEYORS - LAB. ANALYSTS
CHASE CITY, SOUTH HILL, VA. & OXFORD, N. C.

COMMISSION NO. E06086-853-D
DESIGNED BY R.D.H.
DRAWN BY R.D.H.
CHECKED BY H.M.B.
ISSUE DATE 8/12/86

SHEET NO. 5 OF 6 SHEETS

SOUTHERN PHOTO - GREENSBORO N-1957