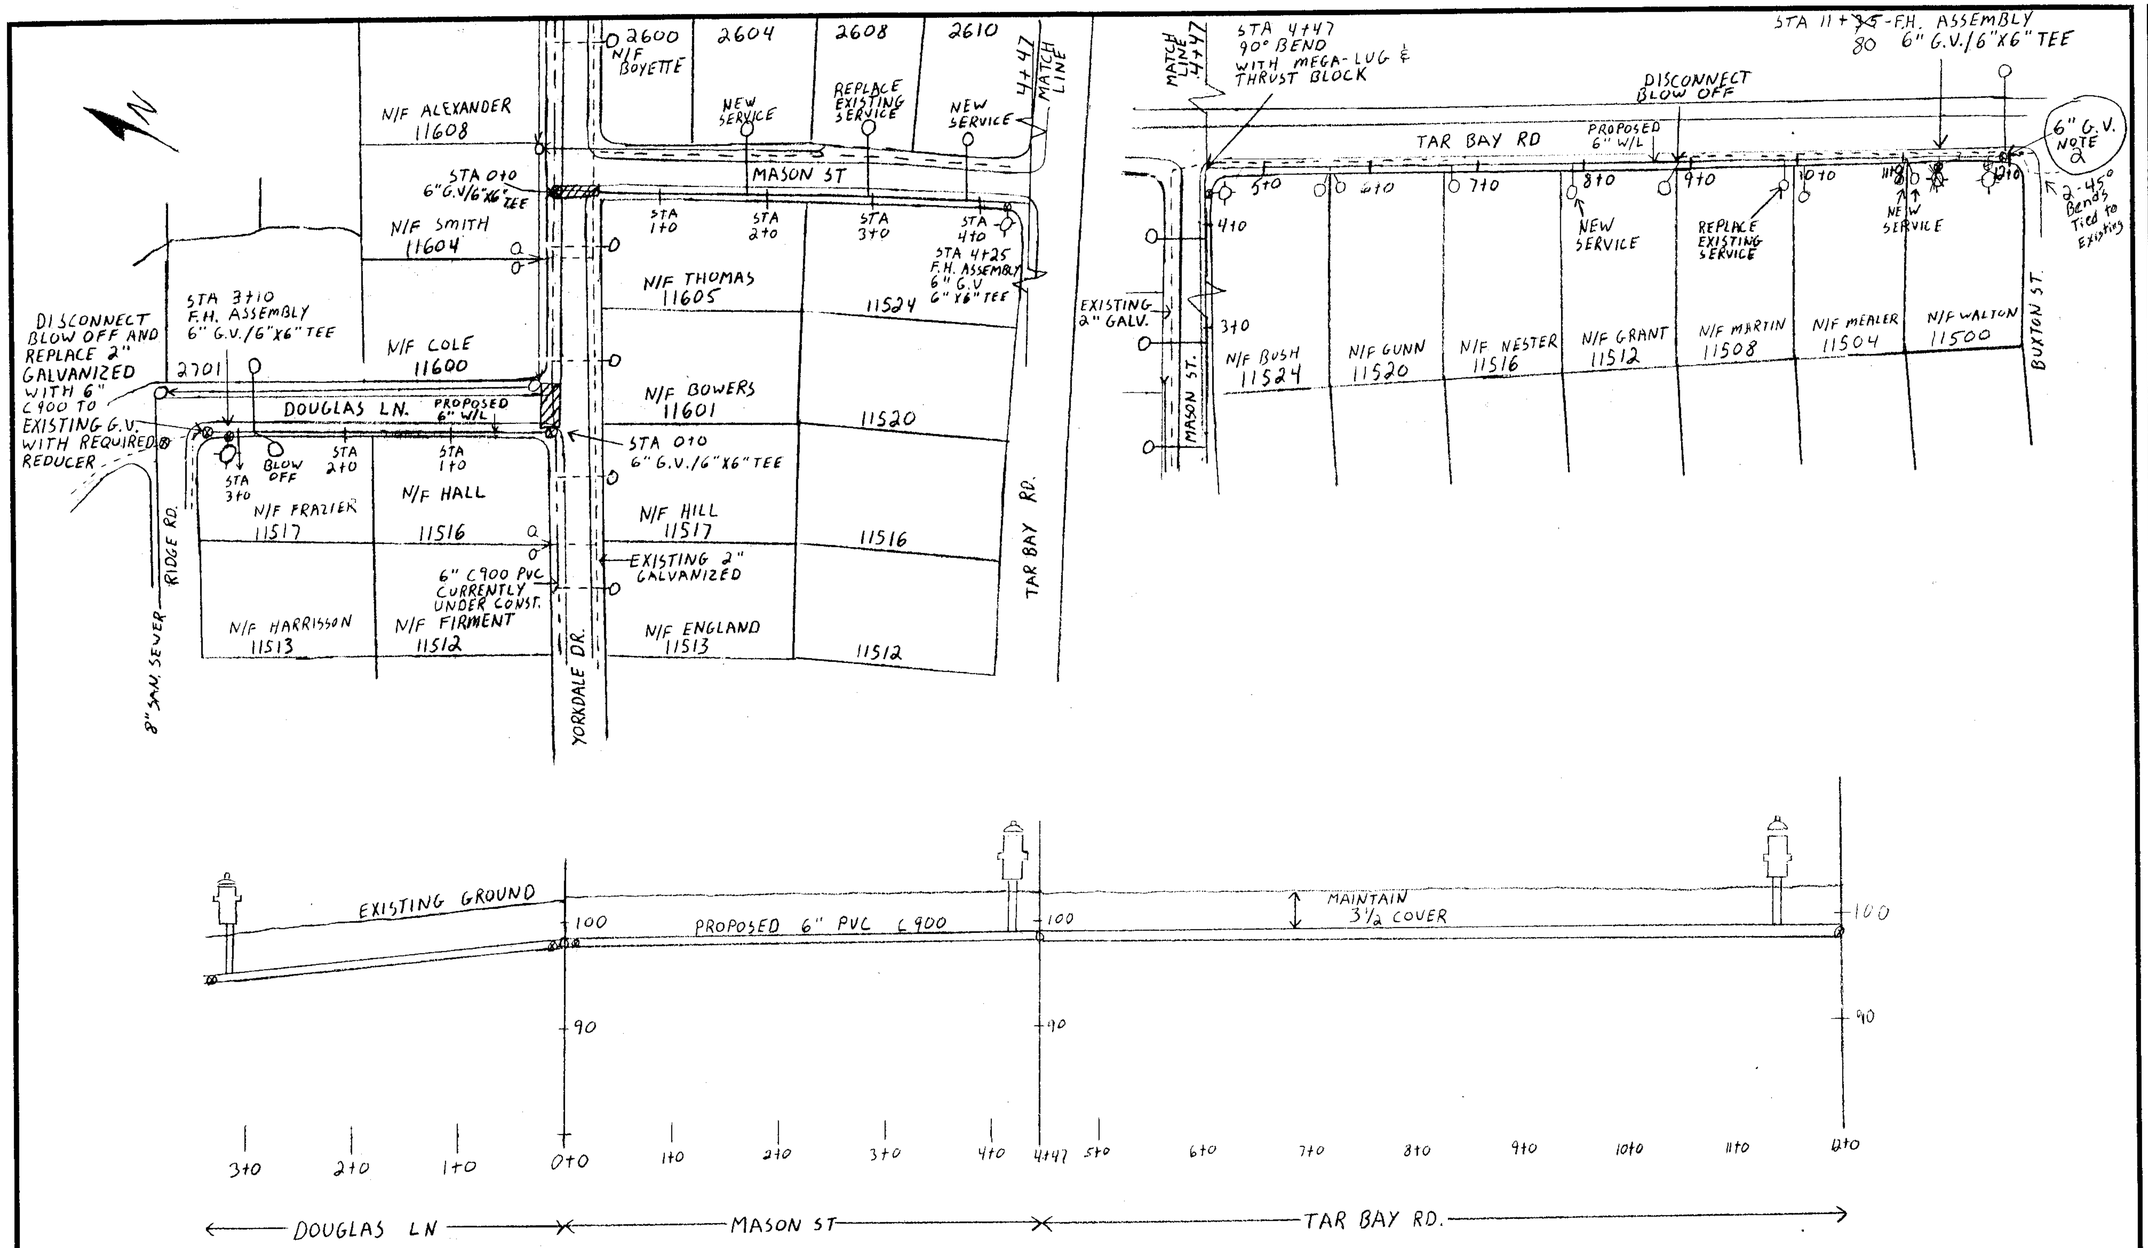

NOTES

1) ALL FITTINGS REQUIRE MEGA-LUG & THRUST BLOCKS

2) STA 12+0, CONNECT TO EXISTING 4" A/C PIPE WITH 6" G.V. AND REQUIRED REDUCER

REVISIONS	BY

RIVER'S EDGE WATER MAIN REPLACEMENT
COUNTY OF PRINCE GEORGE, VA.
DEPARTMENT OF ENGINEERING
PRINCE GEORGE, VA.

Date 6-20-02

Scale 1" = 100 FT

Drawn M. ELLIS

Job

Sheet 2 of 2

Of Sheets