NOTES

1.) WATER SERVICE CONNECTIONS ARE TO BE BORED UNDER ROAD AND CONNECTED TO EXISTING WATER SERVICE YOKE, COPPER PIPE (TYPE K), WITH COMPRESSION FITTINGS TO BE USED FOR SERVICE LINE.

2.) ALL WORK TO BE IN ACCORDANCE WITH PRINCE GEORGE COUNTY STANDARD SPECIFICATIONS AND STATE HEALTH DEPARTMENT WATERWORKS REGULATIONS.

3.) SERVICE DOUBLE BAND STAINLESS STEEL EPOXY COATED.

4.) ALL FITTINGS REQUIRE MEGA-LUG + THRUST BLOCKS

5.) ALL SERVICE CONNECTIONS APPROXIMATE.

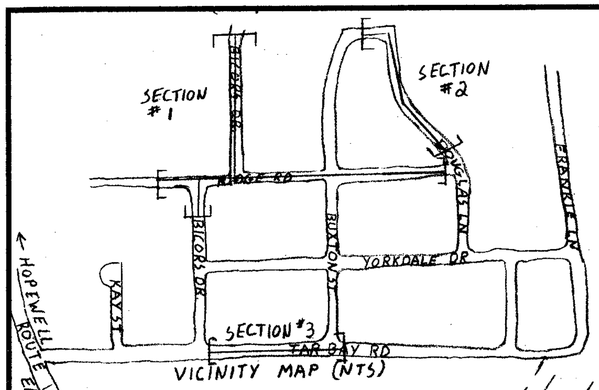

VICINITY MAP (NTS)

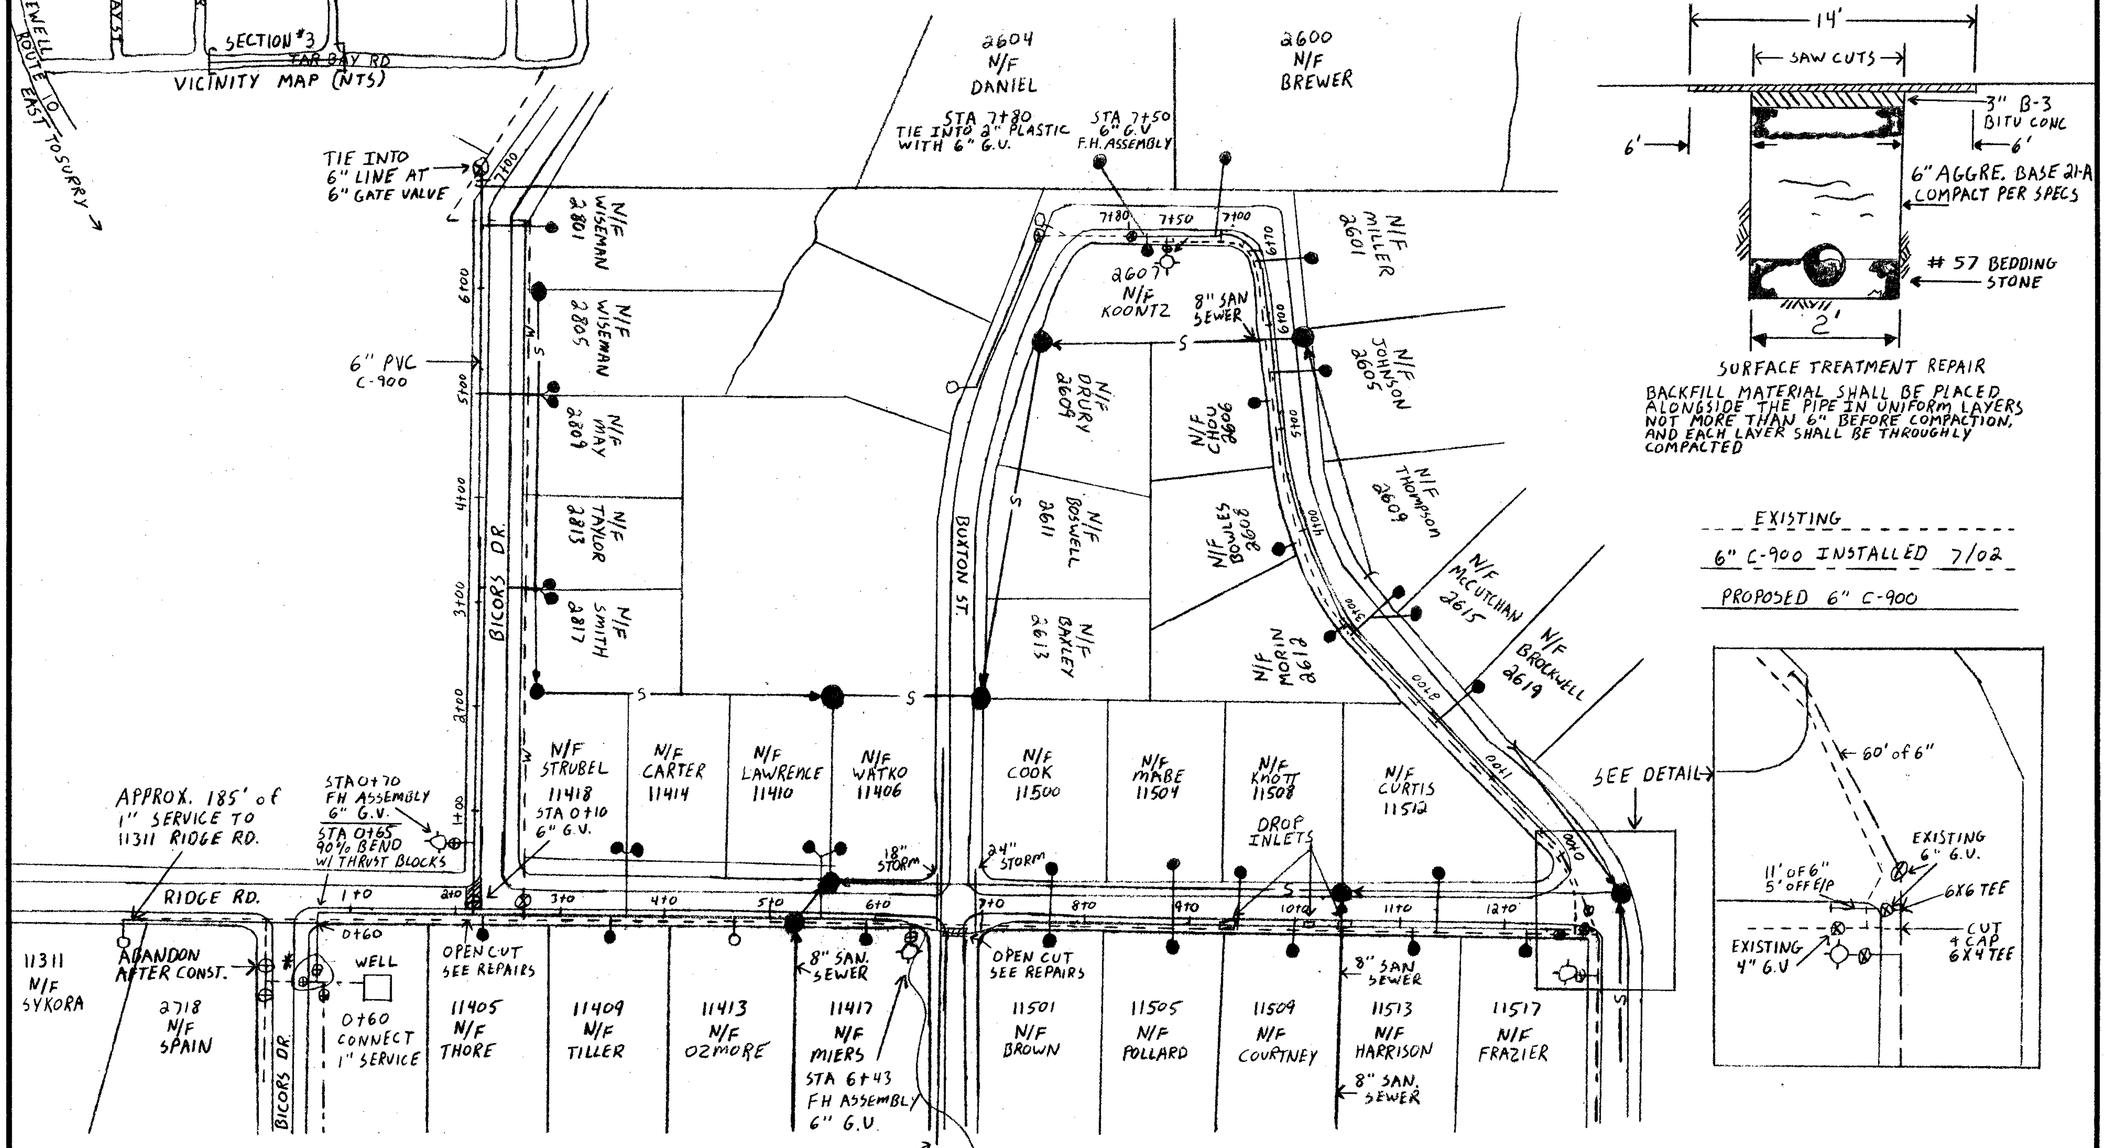

SURFACE TREATMENT REPAIR

BACKFILL MATERIAL SHALL BE PLACED ALONGSIDE THE PIPE IN UNIFORM LAYERS NOT MORE THAN 6" BEFORE COMPACTION, AND EACH LAYER SHALL BE THROUGHLY COMPACTED

EXISTING

6" C-900 INSTALLED 7/02

PROPOSED 6" C-900

REVISIONS	BY

RIVER'S EDGE WATERMAIN REPLACEMENT
PHASE - 2
COUNTY OF PRINCE GEORGE
DEPARTMENT OF ENGINEERING
PRINCE GEORGE, VA.

Date 3-12-03

Scale 1" = 100 FT

Drawn M. ELLIS

Job

Sheet 1 of 2

Of Sheets

18X24 PRINTED ON NO. 1000R-