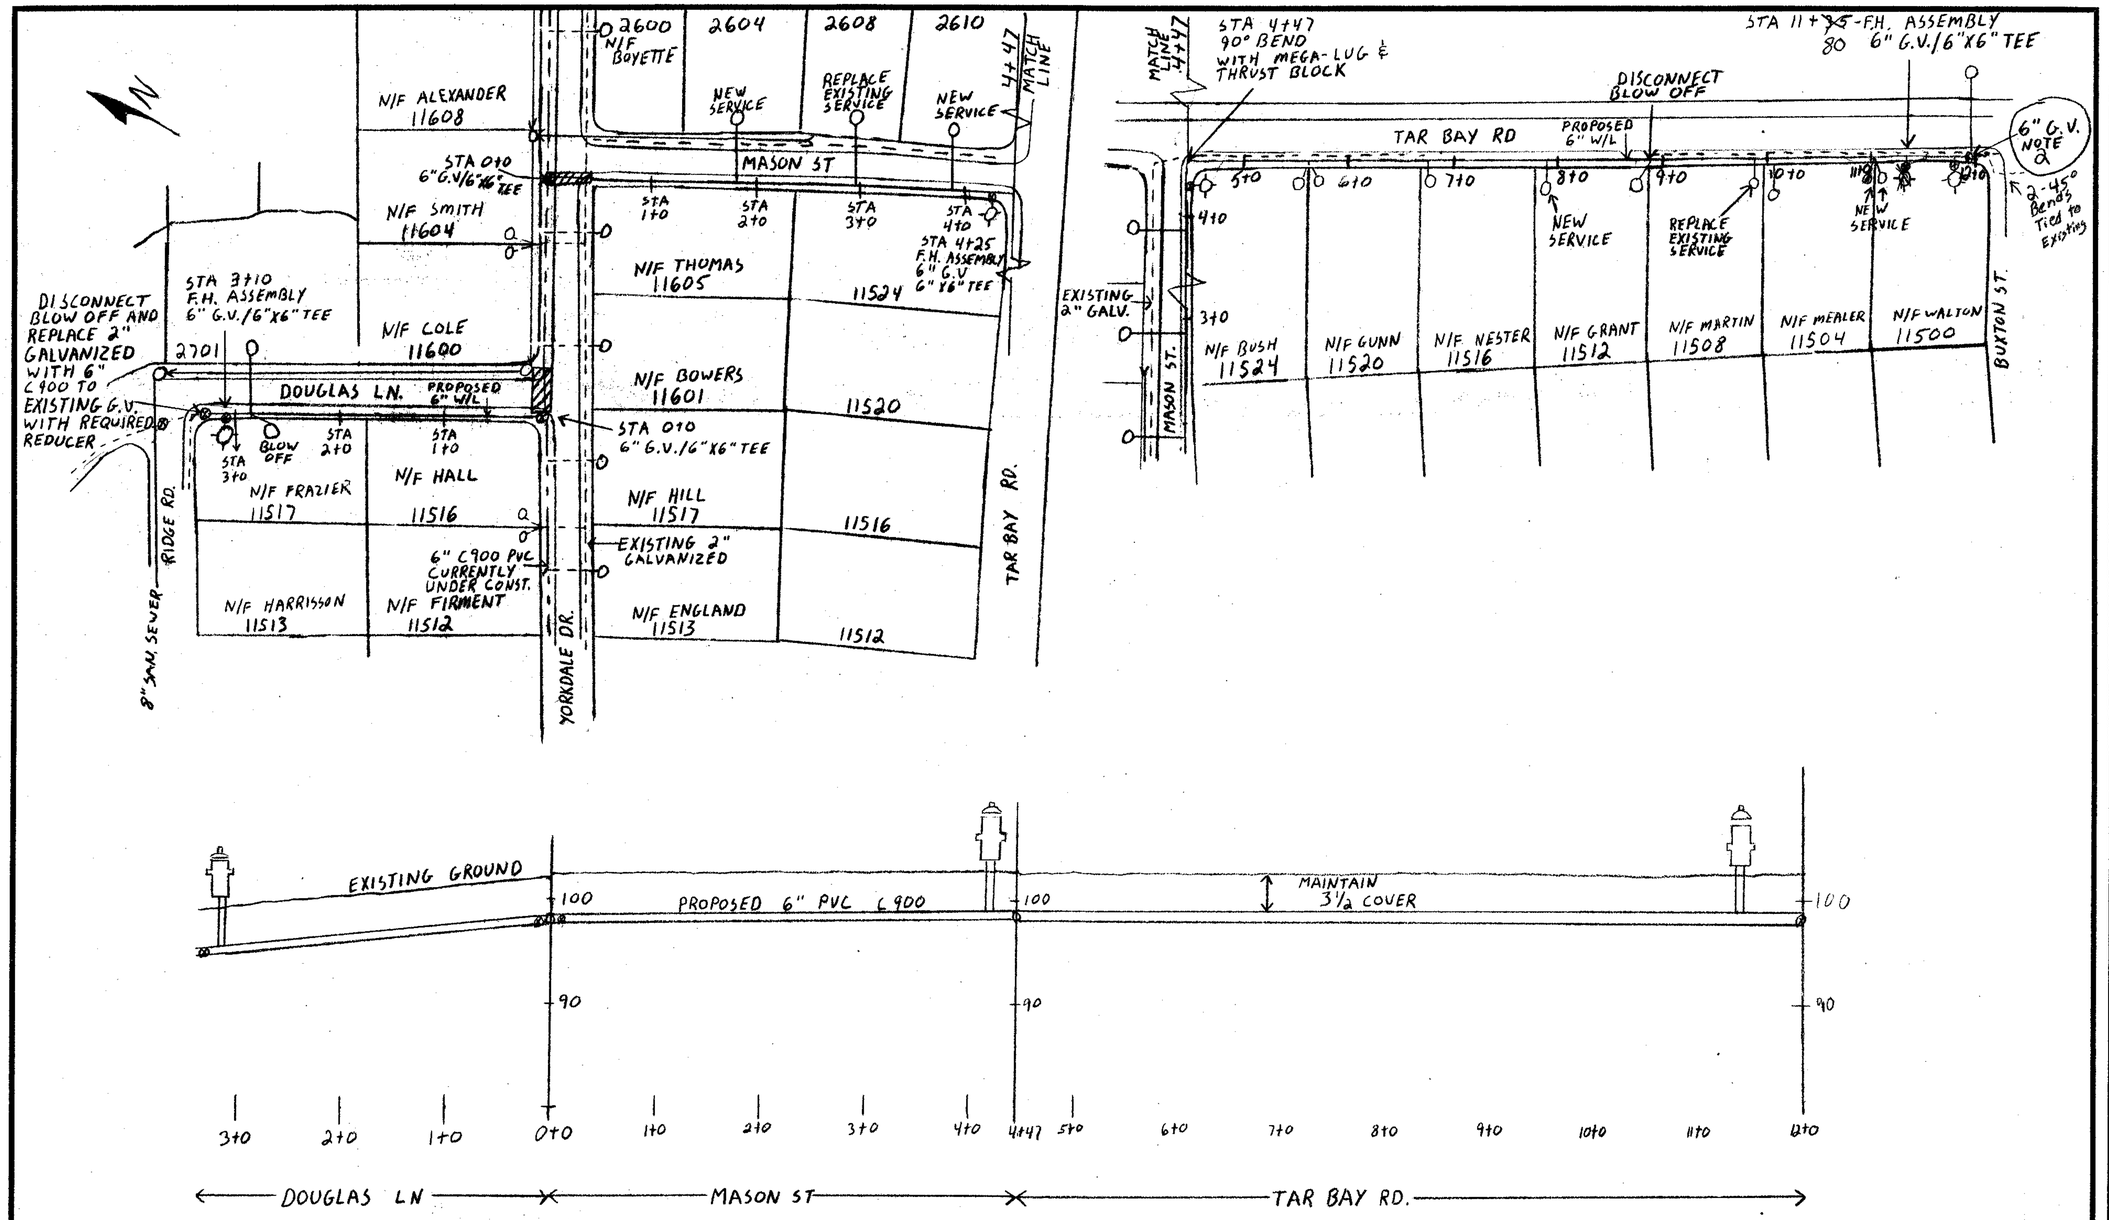

NOTES

1) ALL FITTINGS REQUIRE MEGA-LUG & THRUST BLOCKS

2) STA 12+0, CONNECT TO EXISTING 4" A/C PIPE WITH 6" G.V. AND REQUIRED REDUCER

REVISIONS	BY

RIVER'S EDGE WATER MAIN REPLACEMENT
COUNTY OF PRINCE GEORGE, VA.
DEPARTMENT OF ENGINEERING
PRINCE GEORGE, VA.

Date 6-20-02
Scale 1" = 100 FT
Drawn M. ELLIS
Job
Sheet 2 of 2
Of Sheets

18X24 PRINTED ON NO. 1000H-8 CLEARPRINT FADE-OUT