ROUTE 301/INTERSTATE 95 WATER SYSTEM PRINCE GEORGE COUNTY, VIRGINIA

GENERAL NOTE

OWNER: COUNTY OF PRINCE GEORGE
PO BOX 68
PRINCE GEORGE, VA 23875
COUNTY ENGINEER: STEVE McBRIDE
804-733-2625

2. ENGINEER: DRAPER ADEN ASSOCIATES
8090 VILLA PARK DRIVE
RICHMOND, VIRGINIA 23228
CONTACT: MIKE HAGGERTY
804-264-2228

3. BOUNDARY INFORMATION IS APPROXIMATE.

4. VERTICAL DATUM IS BASED UPON NAVD88 AND HORIZONTAL DATUM IS BASED UPON NAD83.

5. ALL CONSTRUCTION MATERIALS AND INSTALLATION SHALL BE SUPPLIED AND INSTALLED ACCORDING TO THE CONTRACT DOCUMENTS FOR THE PRINCE GEORGE COUNTY ROUTE 301/1-95 WATER SYSTEM PROJECT.

6. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING THE ENGINEER TO SCHEDULE A PRE-CONSTRUCTION MEETING AT LEAST 72 HOURS PRIOR TO THE START OF ANY CONSTRUCTION ON THE PROJECT.

ALL WORK SHALL BE SUBJECT TO INSPECTION BY THE COUNTY AND ITS AGENTS.

7. ALL BOUNDARY OR PROPERTY LINE MARKERS DISTURBED SHALL BE REPLACED IN THEIR ORIGINAL LOCATION AT NO ADDITIONAL

8. THE CONTRACTOR SHALL NOTIFY MISS UTILITY TELEPHONE NO. 1—800—552—7001 AT LEAST 72 HOURS PRIOR TO CONSTRUCTION START—UP FOR EXACT LOCATION OF EXISTING UNDERGROUND UTILITIES.

9. THE LOCATION, DESCRIPTION AND ELEVATION OF ALL EXISTING UTILITIES ACROSS AND ALONG THE ROUTE OF THE PROPOSED PROJECT ARE NOT NECESSARILY SHOWN ON THE PLANS, AND WHERE SHOWN, ARE ONLY APPROXIMATE. THE CONTRACTOR SHALL, ON HIS OWN INITIATIVE AND AT NO EXTRA COST, LOCATE ALL UNDERGROUND LINES AND STRUCTURES AS REQUIRED FOR THE CONSTRUCTION OF THE PROPOSED PROJECT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DAMAGE TO ANY UNDERGROUND LINE OR STRUCTURE. THE CONTRACTOR SHALL NOTIFY THE COUNTY IMMEDIATELY IF THE LOCATION, DESCRIPTION, OR ELEVATION IS DIFFERENT FROM THAT SHOWN ON THE PLAN, OR IF THERE APPEARS TO BE A CONFLICT UPON THE DISCOVERY OF THE EXACT LOCATION, DESCRIPTION, AND ELEVATION OF ANY UNDERGROUND LINE OR STRUCTURE.

10. STAKE-OUT OF WORK SHALL BE PERFORMED BY A LAND SURVEYOR LICENSED IN THE STATE OF VIRGINIA.

11. THE CONTRACTOR IS REQUIRED TO APPLY FOR AND OBTAIN ALL PERMITS; INCLUDING VDOT, EROSION CONTROL, LAND DISTURBANCE, ETC. ALL TEMPORARY AND PERMANENT EASEMENTS SHALL BE OBTAINED BY THE OWNER.

12. ALL MATERIALS AND WORK PERFORMED WITHIN EXISTING VDOT RIGHT-OF-WAY SHALL BE IN ACCORDANCE WITH THE VIRGINIA DEPARTMENT OF HIGHWAYS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING PERMITS AND PERMISSIONS BEFORE WORK IS BEGUN, AND A COPY OF SUCH PERMITS OR PERMISSIONS SHALL BE FILED WITH THE COUNTY ADMINISTRATOR BEFORE WORK IS BEGUN. THE CONTRACTOR SHALL ALSO FURNISH A RELEASE FROM THE VIRGINIA DEPARTMENT OF TRANSPORTATION BEFORE FINAL ACCEPTANCE OF THE WORK BY THE COUNTY.

13. FOR WATERLINE INSTALLATION WITHIN AN EXISTING VDOT RIGHT-OF-WAY; UTILITY CONTRACTORS MUST NOTIFY VDOT WHEN DISTURBING AREAS.

14. WATERLINE SHALL BE INSTALLED WITH A MINIMUM COVER OF 3.5 FEET UNLESS OTHERWISE INDICATED ON THE PLANS.

15. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST EDITION OF THE VIRGINIA WATERWORKS REGULATIONS.

16. WHERE ROCK IS ENCOUNTERED AT THE BOTTOM OF THE TRENCH, BEDDING SHALL BE A MINIMUM OF 8 INCHES APPROVED GRANULAR MATERIAL.

17. ALL WATER MAINS SHALL BE PRESSURE TESTED IN ACCORDANCE WITH AWWA C600 SECTION 4 AND COUNTY REQUIREMENTS, DISINFECTED IN ACCORDANCE WITH AWWA C601 AND THE REQUIREMENTS OF THE VIRGINIA DEPARTMENT OF HEALTH, AND FLUSHED PRIOR TO BEING PLACED INTO SERVICE.

18. ALL VALVES ARE TO BE RODDED AND BLOCKED AS CLOSE TO TEES AND CROSSES AS POSSIBLE PER THE DETAILS IN THE PLAN DRAWINGS. ALL BENDS, FITTINGS, ETC. SHALL BE RESTRAINED BY MEGA-LUGS AND CONCRETE THRUST BLOCKS.

19. ALL BURIED FITTINGS SHALL BE DUCTILE IRON MECHANICAL JOINT TYPE (MIN. CLASS 52). ALL BURIED DUCTILE IRON WATER MAIN SHALL BE MINIMUM CLASS 52. ALL BENDS, FITTINGS, ETC. SHALL BE RESTRAINED BY MEGA—LUGS AND CONCRETE THRUST BLOCKS.

20. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH THE COUNTY'S EROSION AND SEDIMENT CONTROL STANDARDS.

EROSION CONTROL NOTES

1. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE IN ACCORDANCE WITH THE "VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK" (VE&SCH), LATEST EDITION. THE CONTRACTOR SHALL OBTAIN A COPY OF THE HANDBOOK, IN WHICH THE SPECIFIC MEASURES ARE DESCRIBED IN THE MANNER THEY ARE TO BE APPLIED TO THE PROJECT.


2. ALL TEMPORARY EROSION CONTROL MEASURES SHALL BE INSTALLED PRIOR TO OR DURING CLEARING, GRUBBING, AND/OR ROUGH GRADING ACTIVITIES.

3. GRADED PORTIONS OF THE SITE NOT TO BE CONSTRUCTED UPON SHALL BE TOPSOILED AND SEEDED WITHIN 7 DAYS OF INITIAL GRADING.

4. WHEREVER POSSIBLE, NATURAL VEGETATION SHALL REMAIN INTACT TO AID IN EROSION CONTROL.

5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IMPLEMENTATION AND MAINTENANCE OF ALL EROSION CONTROL MEASURES.

6. AT COMPLETION OF CONSTRUCTION THE CONTRACTOR SHALL REMOVE ALL TEMPORARY EROSION CONTROL MEASURES, AND SEED DISTURBED AREAS.

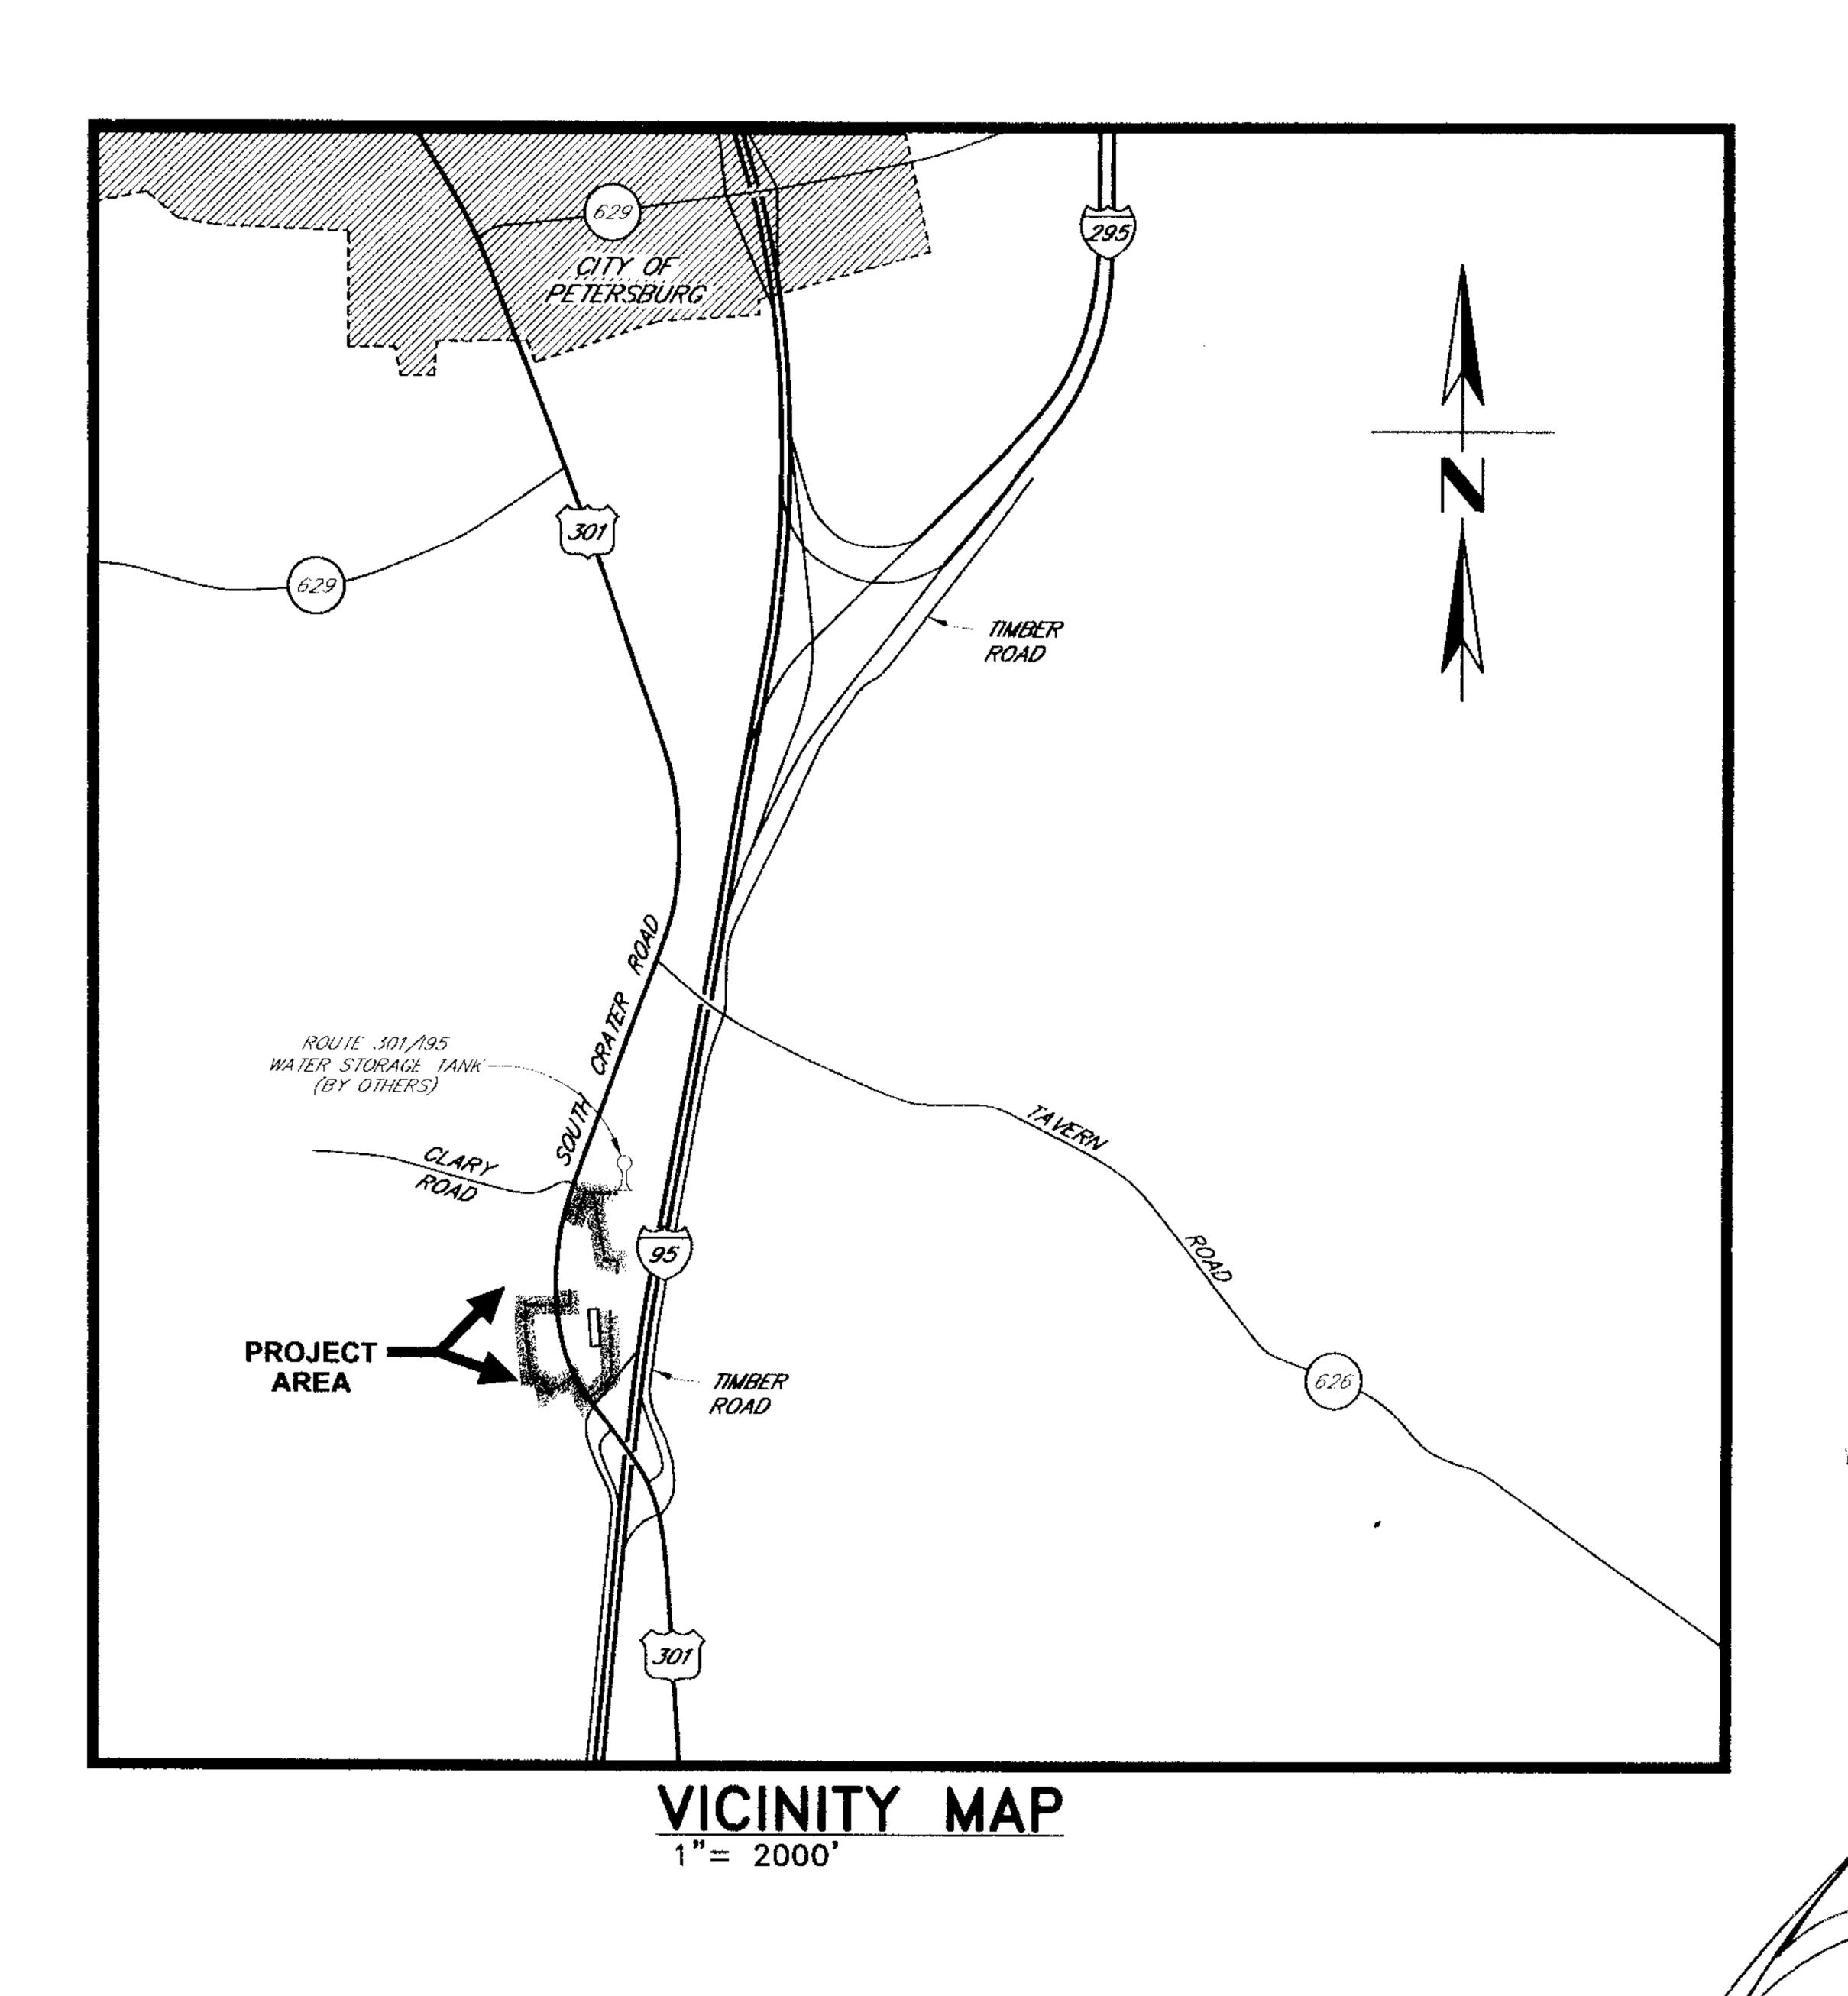



NOTE: CONTRACTOR TO CONTACT

MISS UTILITY (1-800-552-7001)

AT LEAST 48 HOURS PRIOR TO

ANY EXCAVATION ON THE SITE.

These documents, including drawings, specifications, reports, and studies were prepared by Draper Aden Associates, Consulting Engineers, pursuant to a contract by and between Draper Aden Associates and Prince George County with respect to the project described in said contract. Any reuse of said documents without written verification or adaptation by Draper Aden Associates for the specific purpose intended will be at the sole risk of the individual or entity utilizing said documents, drawings, specifications, reports, and studies and such use is without the authorization of Draper Aden Associates. Draper Aden Associates, Consulting Engineers, shall have no legal liability resulting from any and all claims, damages, losses, and expenses, including attorney's fees arising out of the unauthorized use of these documents, drawings, specifications, reports, and studies prepared as a result of the aforesaid contract.

DRAWING LIST

DETAILS

NO.	DESCRIPTION
1	COVER SHEET
2	PLAN & PROFILE-WATERLINES "A" & "B"
3	PLAN- WATERLINE "C"
4	PROFILE- WATERLINE "C"

LEGEND:					
EXISTING FEATURES: DROP INLET & STORM SEWER STORM SEWER MANHOLE SANITARY SEWER & MANHOLE CLEANOUT WATERLINE WATER VALVE WATER METER CHECK VALVE FIRE HYDRANT WELL (POTABLE)		PROPOSED FEATURES WATERLINE WATER VALVE FIRE HYDRANT SILT FENCE	\$		
GAS LINE GAS VALVE GAS DRIP POWER POLE LIGHT POLE / STREET LAMP MONITORING WELL POWER/TELEPHONE LINE CONTOUR LINE TREE LINE UNDERGROUND TELEPHONE					
OVERHEAD POWER EDGE OF PAVEMENT BORE HOLE BENCHMARK					

DRAPER ADEN ASSOCIATES REVIEW

THESE PLANS HAVE BEEN SUBJECTED TO TECHNICAL AND QUALITY REVIEWS BY:

MICHAEL S. HAGGERTY	Diel S. Hyd	3/30/07
NAME: PRINTED PROJECT DESIGNER	SIGNATURE	DATE
Jeffrey P. Kapinos	Jeffy Polassin	3/30/07
NAME: PRINTED / PROJECT MANAGER	BIGNATIORE	DATE
Jeffrey P. Kapinos	Jeffy P Classin	3/30/07
NAME: PRINTED ' QUALITY REVIEWER	SIGNATURE	DATE

2120107

nmental Services
Blacksburg, VA
Charlottesville, VA

DOI TAUCILL AND Seering + Surveying + Environment, VA

Richmond, No. 1911 Park ERIchmond, VA 804-264-2228 Fax: 804

TERSTATE 95 WATER SYSTEM

ROUTE 301/INTERINGE GEORGE COUNTY VI

REVISIONS
5/26/06PER COUNTY COMMENTS

DESIGNED BY:

MSH

DRAWN BY:

HLJ

CHECKED BY:

JPK

SCALE:

AS SHOWN

SCALE:
AS SHOWN
DATE:
05/26/06

05/26/06
PROJECT NUMBER:
R05274-01F

1