EROSION CONTROL NOTES

NOTES

1. All erosion control and sediment control measures shall be in accordance with the "Virginia Erosion and Sediment Control Handbook" (VE&SCH), latest edition. The Contractor shall obtain a copy of the handbook, on which the specific measures are described in the manner they are to be applied to the project.
2. All temporary erosion control measures shall be installed prior to or during clearing, grubbing, and/or rough grading activities.
3. Graded portions of the site not to be constructed upon shall be topsoiled and seeded within 15 days of initial grading.
4. Wherever possible, natural vegetation shall remain intact to aid in erosion control.
5. All water and sanitary lines not in the pavement are to be mulched and seeded within fifteen days after backfill.
6. The contractor shall be responsible for implementation and maintenance of all erosion control measures. Any necessary repair and/or cleanup to maintain the effectiveness of the erosion control devices shall be made immediately.
7. During construction, should the County of Prince George Engineer or Inspector reveal the need for additional erosion control devices, they should be installed at the County's direction.
8. At completion of construction the contractor shall remove all temporary erosion control measures, and seed disturbed areas.

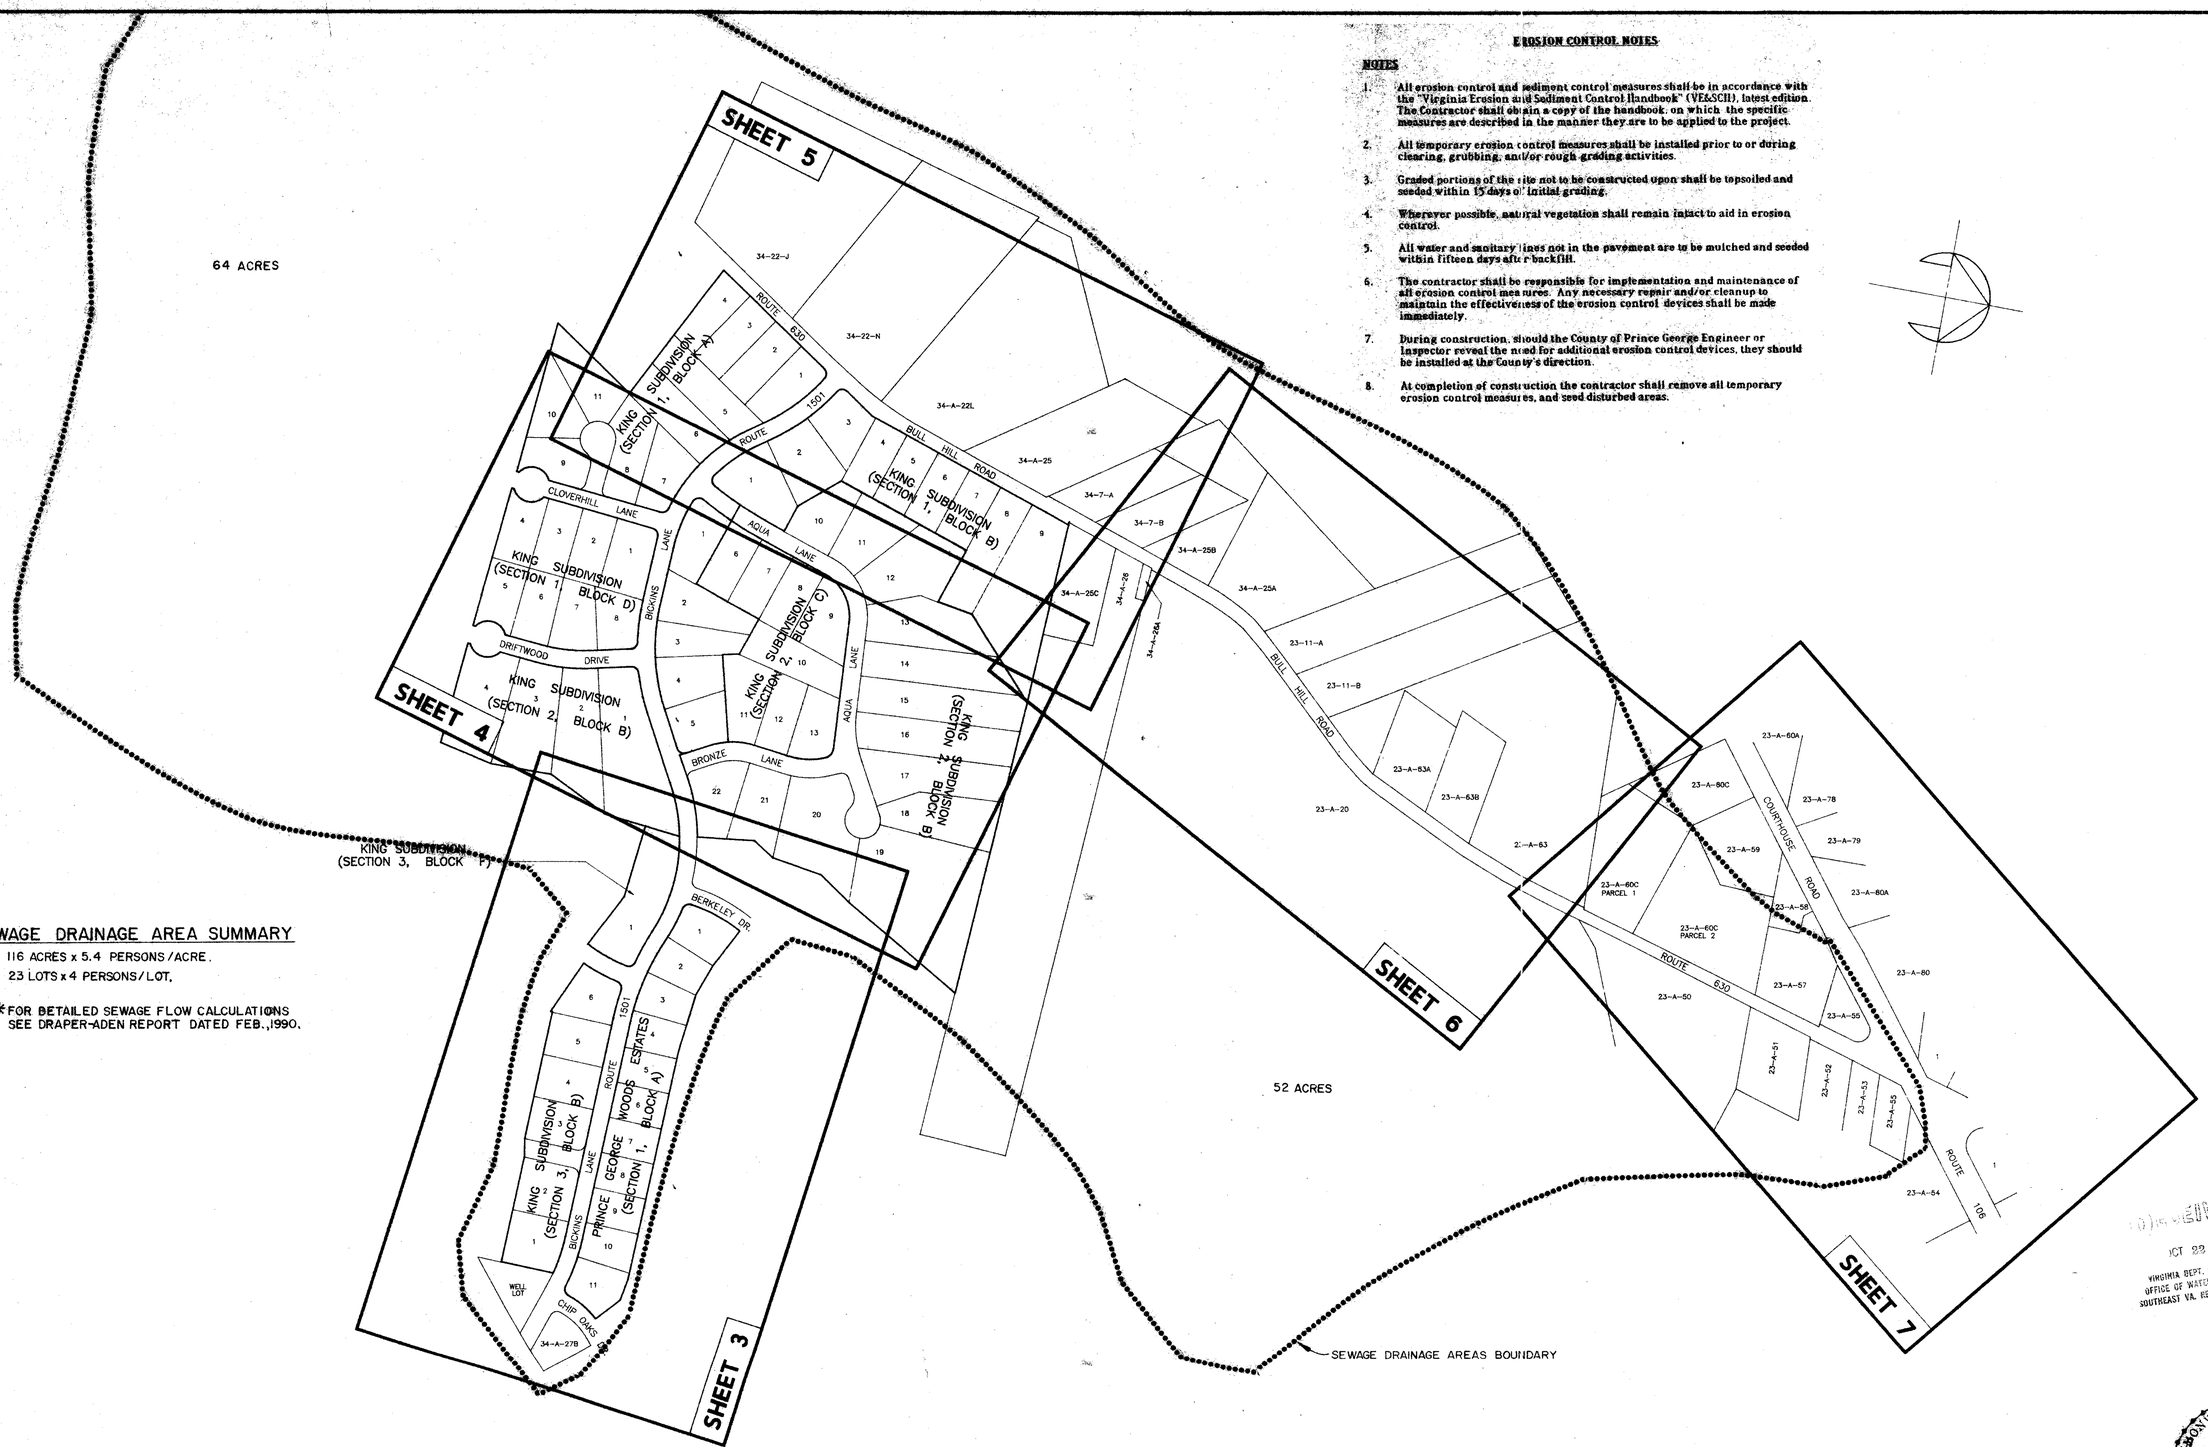

SEWAGE DRAINAGE AREA SUMMARY

116 ACRES x 5.4 PERSONS/ACRE.
23 LOTS x 4 PERSONS/LOT.

*FOR DETAILED SEWAGE FLOW CALCULATIONS SEE DRAPER-ADEN REPORT DATED FEB.,1990.

RECEIVED
OCT 22 1991
VIRGINIA DEPT. OF HEALTH
OFFICE OF WATER PROGRAMS
SOUTHEAST VA. REGIONAL OFFICE

COMMONWEALTH OF VIRGINIA
FREDERICK T. M. PRIBBLE
No. 10055
PROFESSIONAL ENGINEER

20213-4F.DWG

Draper Aden Associates CONSULTING ENGINEERS Richmond, Virginia – Blacksburg, Virginia	DESIGNED: FTP DRAWN: HLJ CHECKED: JNL DATE: 10/ /89	PRINCE GEORGE WATER & SEWER EXTENSIONS RTE. 630 / KING SUBDIVISION ADDITION COUNTY OF PRINCE GEORGE, VIRGINIA	PLAN SHEET INDEX	REVISIONS	SCALE: 1" = 200' PLAN NO. T – 20213	SHEET 2 OF 13