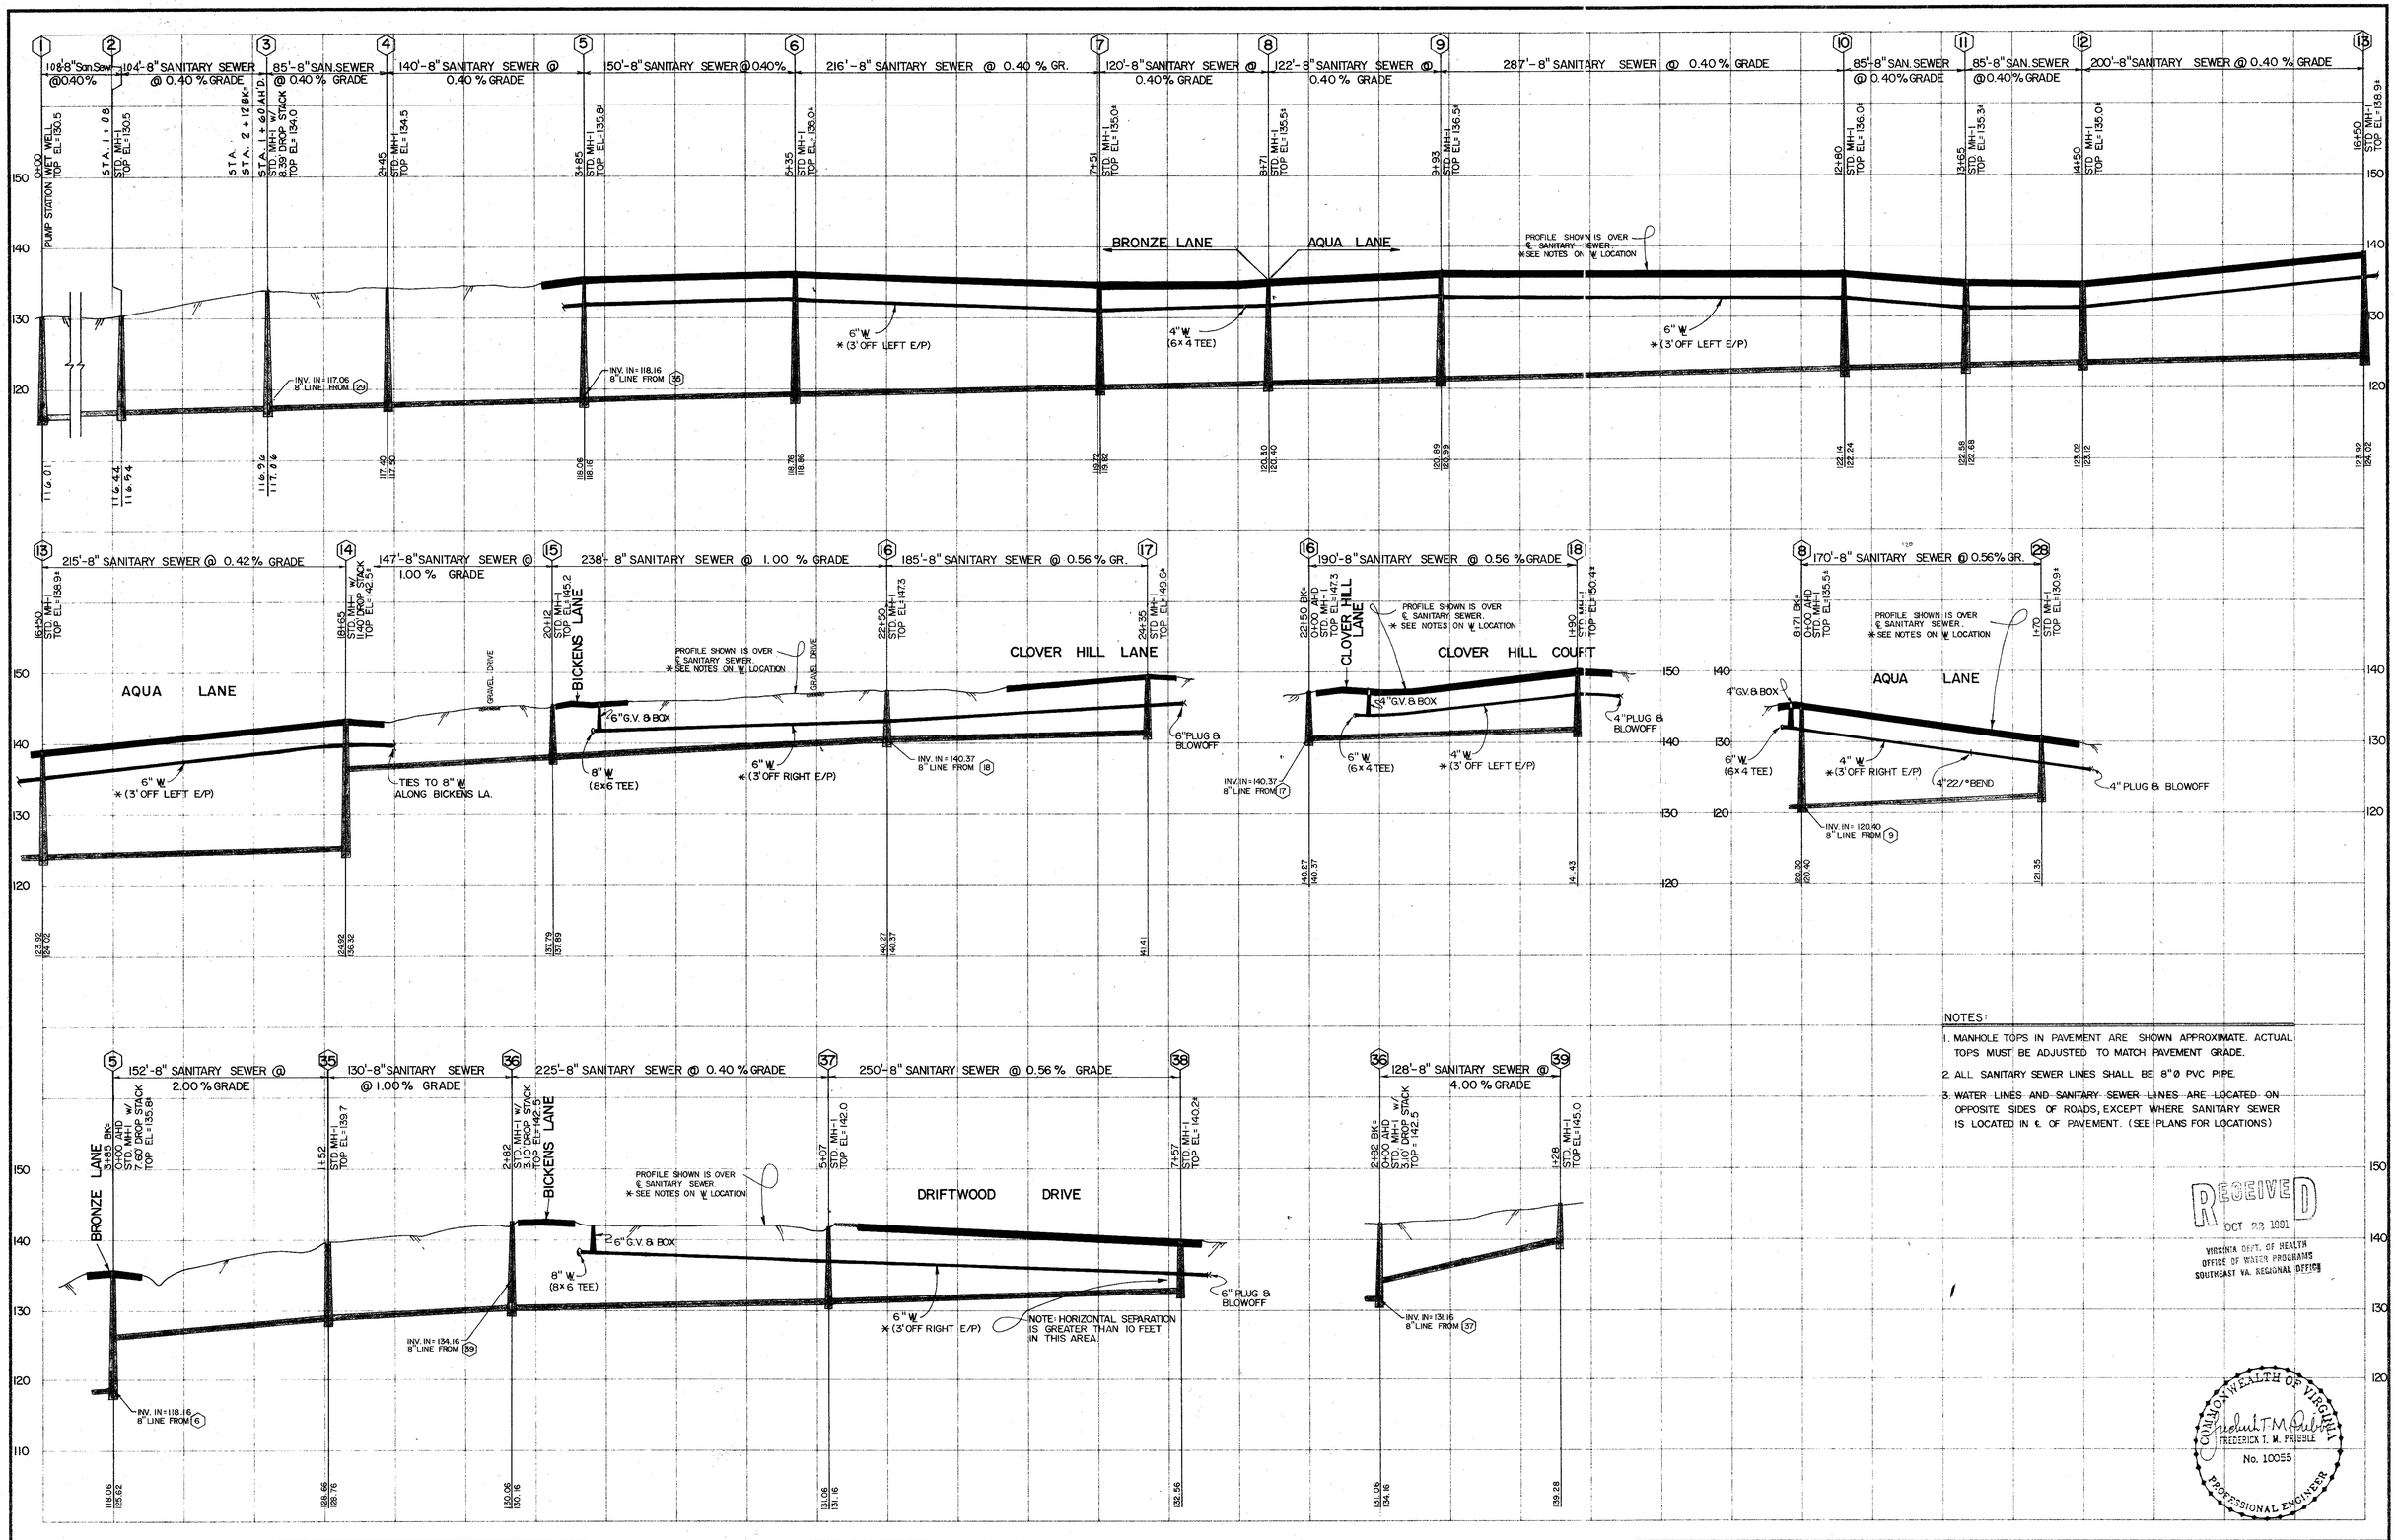

NOTES:

1. MANHOLE TOPS IN PAVEMENT ARE SHOWN APPROXIMATE. ACTUAL TOPS MUST BE ADJUSTED TO MATCH PAVEMENT GRADE.
2. ALL SANITARY SEWER LINES SHALL BE 8"Ø PVC PIPE.
3. WATER LINES AND SANITARY SEWER LINES ARE LOCATED ON OPPOSITE SIDES OF ROADS, EXCEPT WHERE SANITARY SEWER IS LOCATED IN ℄ OF PAVEMENT. (SEE PLANS FOR LOCATIONS)

RECEIVED
OCT 22 1991
VIRGINIA DEPT. OF HEALTH
OFFICE OF WATER PROGRAMS
SOUTHEAST VA. REGIONAL OFFICE

COMMONWEALTH OF VIRGINIA
FREDERICK T. M. PRIBBLE
No. 10055
PROFESSIONAL ENGINEER

Draper Aden Associates CONSULTING ENGINEERS Richmond, Virginia Blacksburg, Virginia	DESIGNED: PCB DRAWN: PCB CHECKED: FTP DATE: 1/31/90	PRINCE GEORGE WATER & SEWER EXTENSIONS RTE. 630 / KING SUBDIVISION ADDITION COUNTY OF PRINCE GEORGE, VIRGINIA	PROFILES	REVISIONS 9/4/91	SCALE: HORZ: 1" = 50' VERT: 1" = 10' PLAN NO. T – 20213	SHEET 9 OF 13