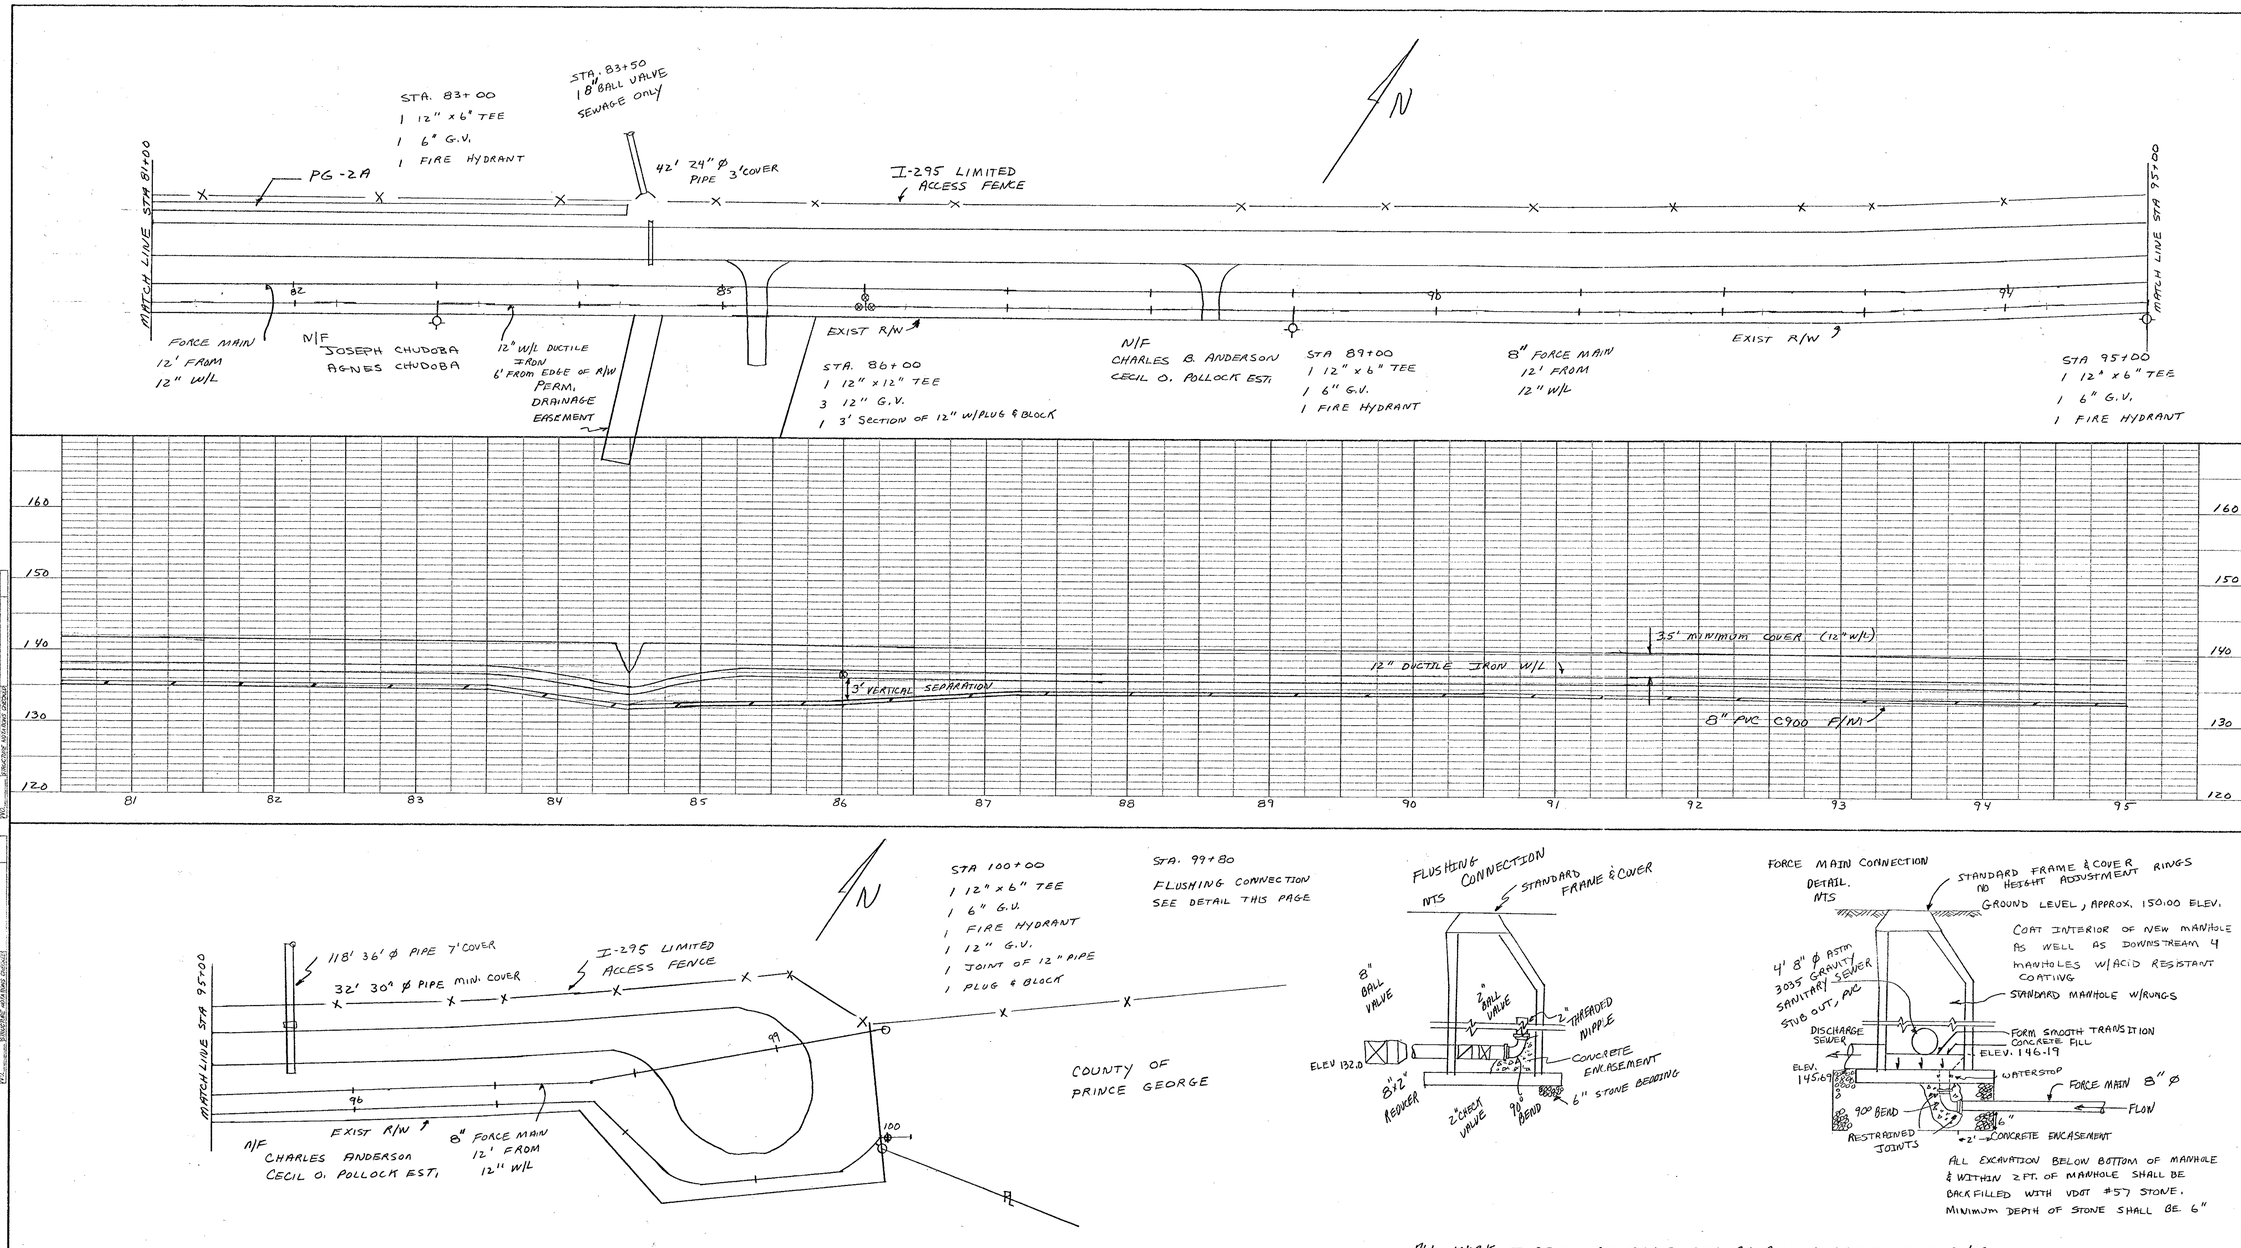

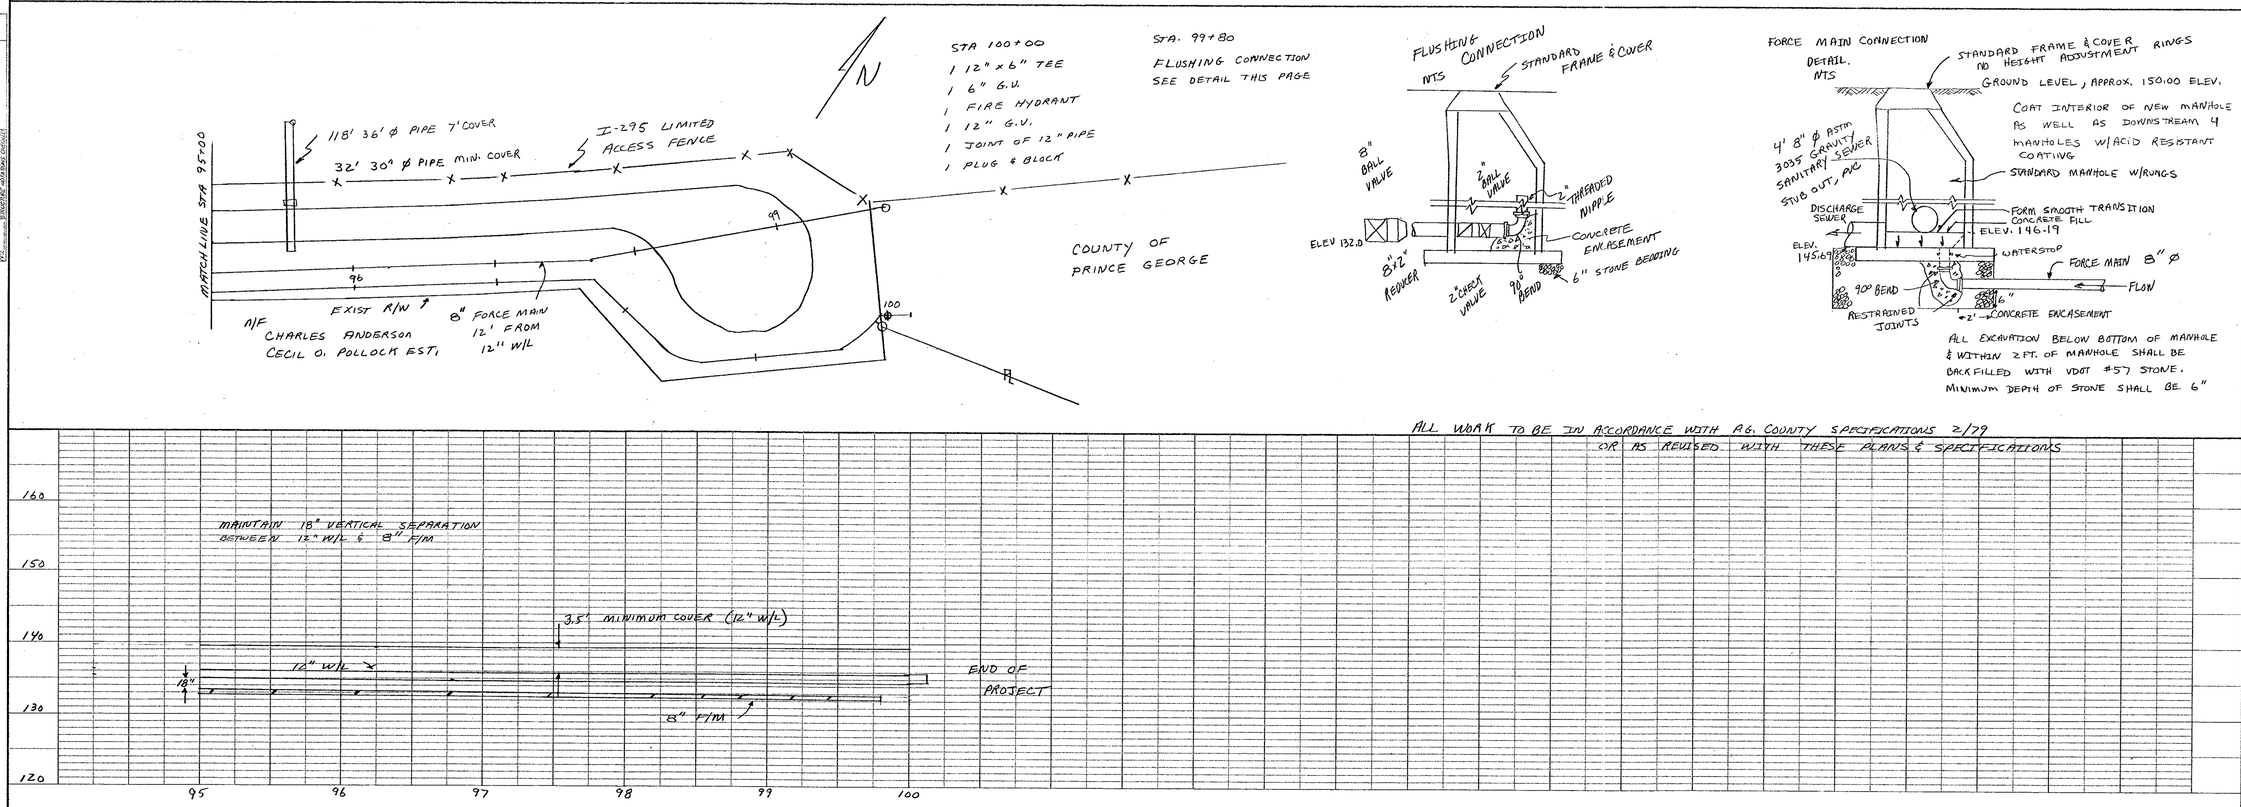

ALL WORK TO BE IN ACCORDANCE WITH PG. COUNTY SPECIFICATIONS 2/79 OR AS REVISED WITH THESE PLANS & SPECIFICATIONS

I-295 INDUSTRIAL LAND
WATER & SEWER
12" DUCTILE IRON WATERLINE
8" PVC C900 SANITARY FORCE MAIN

COUNTY OF PRINCE GEORGE, VIRGINIA
DEPARTMENT OF ENGINEERING
PRINCE GEORGE, VA. 23875

DATE	DESCRIPTION REVISIONS	BY

COMMONWEALTH OF VIRGINIA
STEPHEN E. MUNDIE
(LICENSE) No. #14599
PROFESSIONAL ENGINEER

DATE: 12/1/96
SCALE: HORIZ. 1" = 50'
VERT. 1" = 10'
DESIGNED: SEM
DRAWN: SEM
CHECKED: SEM

PROJECT NUMBER

SHEET 4 OF 4 SHEETS

PLAN
SURVEYED
DRAWN
DESIGNED
WATERCOURSE
VEL.
DATE
BY
SHEET
DIRECTOR OF DEVELOPMENT SERVICES

PROFILE
SURVEYED
DRAWN
DESIGNED
WATERCOURSE
VEL.
DATE
BY
SHEET
DIRECTOR OF DEVELOPMENT SERVICES