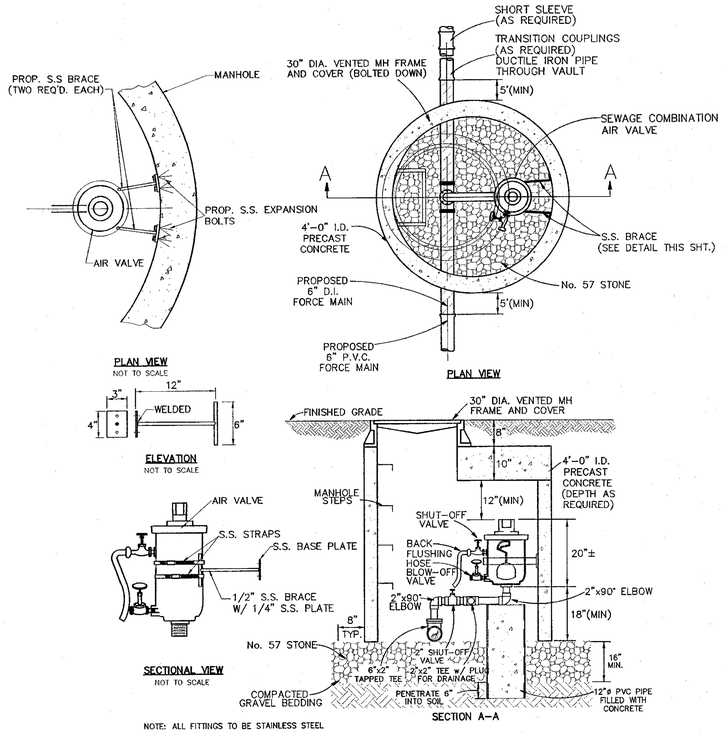

NOTE: ALL FITTINGS TO BE STAINLESS STEEL

TYPICAL PIT INSTALLATION
DETAIL FOR SEWERAGE COMBINATION
AIR VALVE AND VAULT
NOT TO SCALE

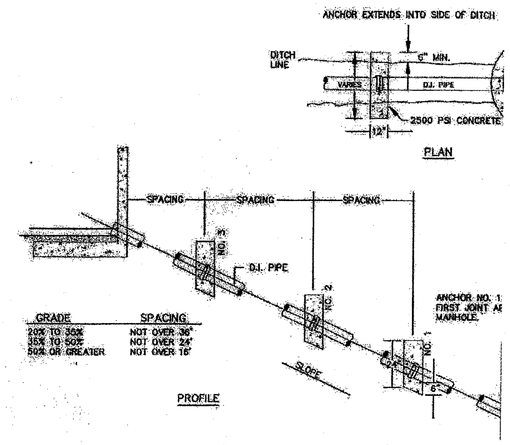

GRADE	SPACING
20% TO 35%	NOT OVER 36"
35% TO 50%	NOT OVER 24"
50% OR GREATER	NOT OVER 16"

TYPICAL ANCHOR DETAIL FOR
SEWERS ON GRADES 20% AND GREATER
N.T.S.
FIG. S-4

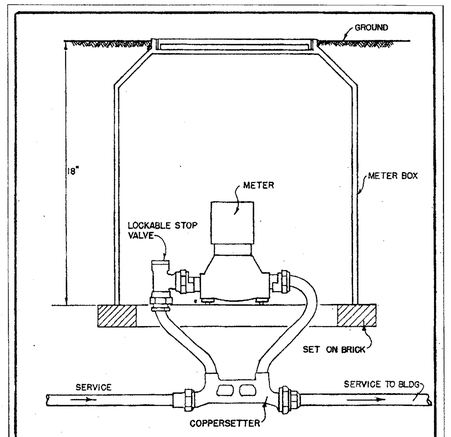

NOTE
DETAIL IS FOR 5/8" THRU
1" DISC METERS

METER SETTING

STANDARDS FOR
WATER AND WASTEWATER SYSTEMS
COUNTY OF PRINCE GEORGE
VIRGINIA

DATE 7-78 PLATE NO.: 8

FINAL REVIEW

COMMONWEALTH OF VIRGINIA
JUDY DING
No. 041360
1-18-06
PROFESSIONAL ENGINEER

THIS DRAWING PREPARED AT THE
CORPORATE OFFICE
1001 Boulders Parkway, Suite 300 | Richmond, VA 23225
TEL 804.200.6500 FAX 804.560.1016 www.timmons.com

YOUR VISION ACHIEVED THROUGH OURS.

Site Development | Residential | Infrastructure | Technology

DATE	REVISION DESCRIPTION
11/10/05	REVISED PER COMMENTS
1/12/06	REVISED PER COMMENTS

DATE	8/04/05
DRAWN BY	B. WALKER
DESIGNED BY	B. WALKER
CHECKED BY	J. DING
SCALE	AS NOTED

TIMMONS GROUP

THE MEADOWS OFFSITE WATER & SEWER
PRINCE GEORGE COUNTY, VA
GENERAL DETAILS

JOB NO. 21950
SHEET NO. G4