NOTES

1. Contractor to verify location and depth of lateral prior to construction. Percent of grade to be held such that a minimum 3' of cover is maintained on proposed sewer.
2. Pipe bedding shall be Class C crushed stones Prince George County specifications.
3. The exact location and depth of all existing underground utility lines is unknown. Before any excavation the contractor shall contact "Miss Utility" 1-800-552-7001.
4. Trenching and backfill shall conform to Prince George County sewer specifications, Section X.
5. Topsoil and seeding shall conform to Prince George County sewer specifications, Section F.
6. Erosion and sediment control shall conform to Prince George County sewer specifications, Section 7.
7. Sewer material shall be PVC conforming to ASTM D 3034, with minimum SDR of 35, Johns-Manville pipe with "Ring-Tite" rubber gasket joint or equal.
8. Sewer cleanouts shall conform to Prince George County specifications, Section 3-71.

PLAN — SURVEYED ___ PLOTTED ___ ALIGNMENT CHECKED ___ R/W OF WAY CHECKED ___ NOTE BOOK ___ NO. ___ BY ___ DATE ___

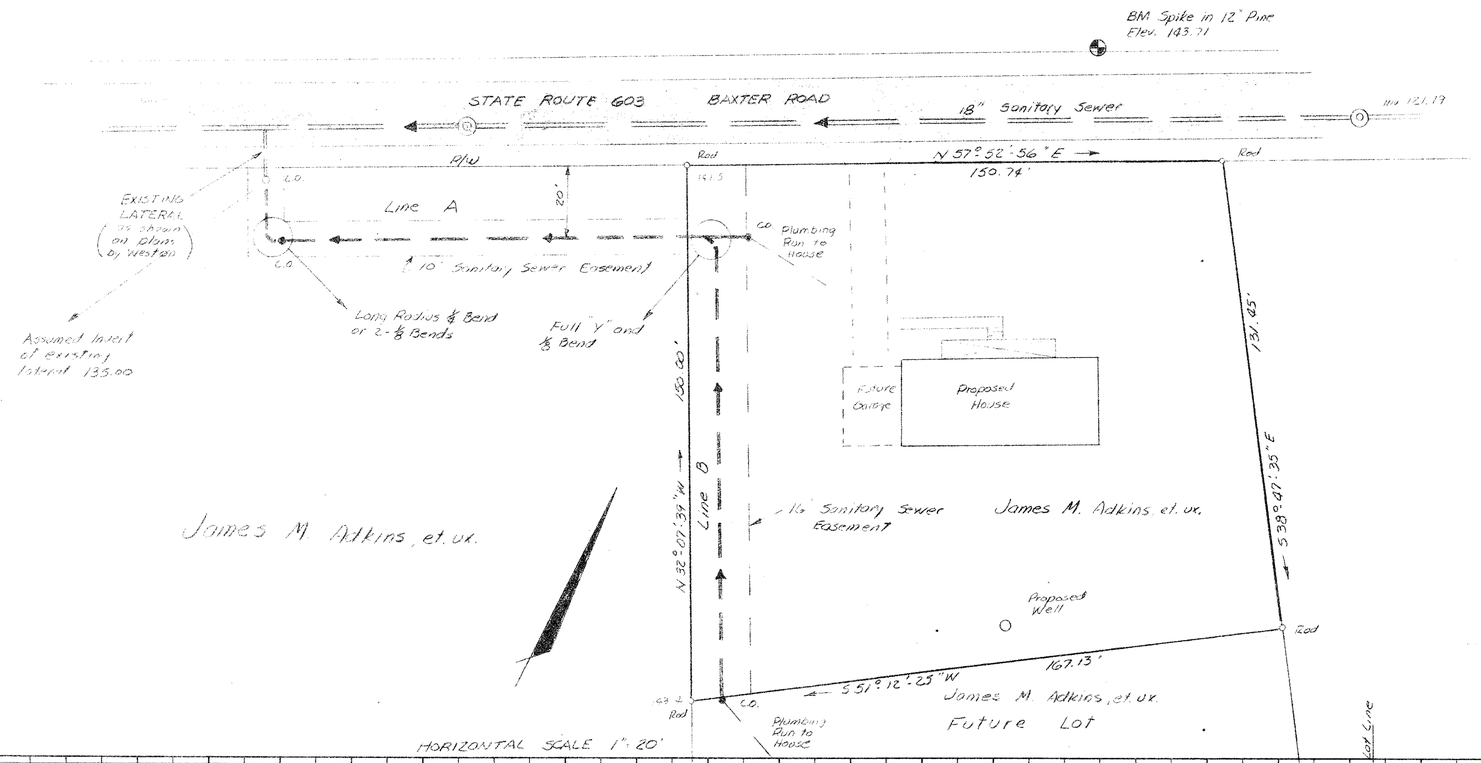

PROFILE — SURVEYED ___ PLOTTED ___ GRADES CHECKED ___ R/W OF WAY CHECKED ___ STRUCTURE NOTATIONS CH'KD. ___ NOTE BOOK ___ NO. ___ BY ___ DATE ___

NO.	DATE	REVISION	BY

SHEET TITLE: Plan Profile Sewer Line

PROJECT: James Adkins Property

PROJECT NO. 86-103
SCALE As Shown
DATE Feb 6, 1987
DRAWN BY
CHECKED BY
DRAWING NO.
1 OF 1 SHTS

LEGAT AND ASSOCIATES, INC.
Consulting Engineers and Surveyors
HOPEWELL, VIRGINIA

PLATE 1 - PLAN - PROFILE - F.A.S.
CLEARPRINT PAPER CO., S. F. CAL.
NO. 1000H-1