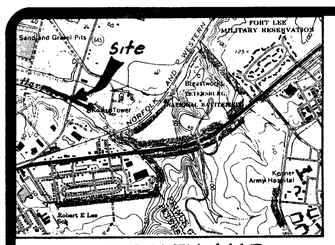

VICINITY MAP
1" = 2000'

Material and Construction shall Conform to the latest specifications of the County of Prince George for the construction of sewage Improvements.



BM
Top Hydrant
el 33.69

Coca Cola
Distribution Plant
(Estimate 10 on site employees
10 people x 25 gpd = 250 gpd)



PVC PIPE
Bedding

Note: Coat with Epoxy Coating
(4 mil Thick)

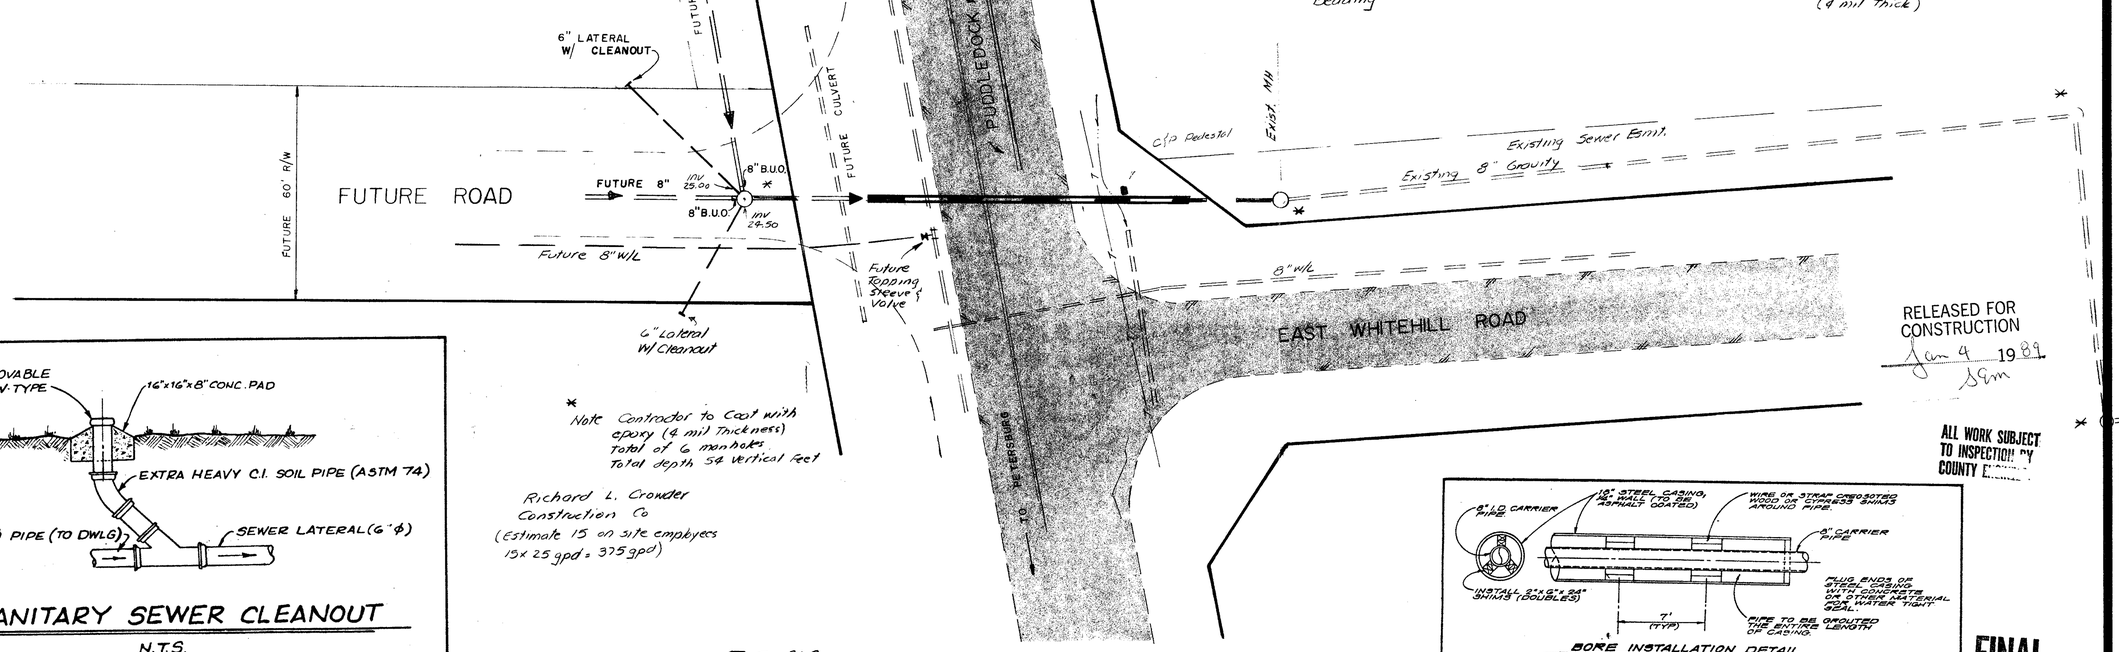

RELEASED FOR CONSTRUCTION
Jan 4 1989
SGM

ALL WORK SUBJECT TO INSPECTION BY COUNTY ENGINEER

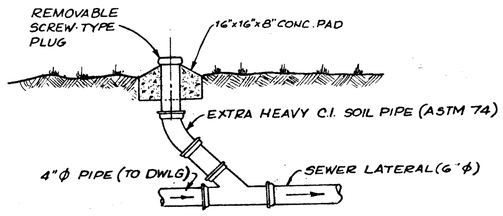

SANITARY SEWER CLEANOUT
N.T.S.

* Note Contractor to Coat with epoxy (4 mil Thickness)
Total of 6 manholes
Total depth 54 vertical feet

Richard L. Crowder
Construction Co
(Estimate 15 on site employees
15 x 25 gpd = 375 gpd)

BORE INSTALLATION DETAIL
NO SCALE

FINAL

1" = 20'

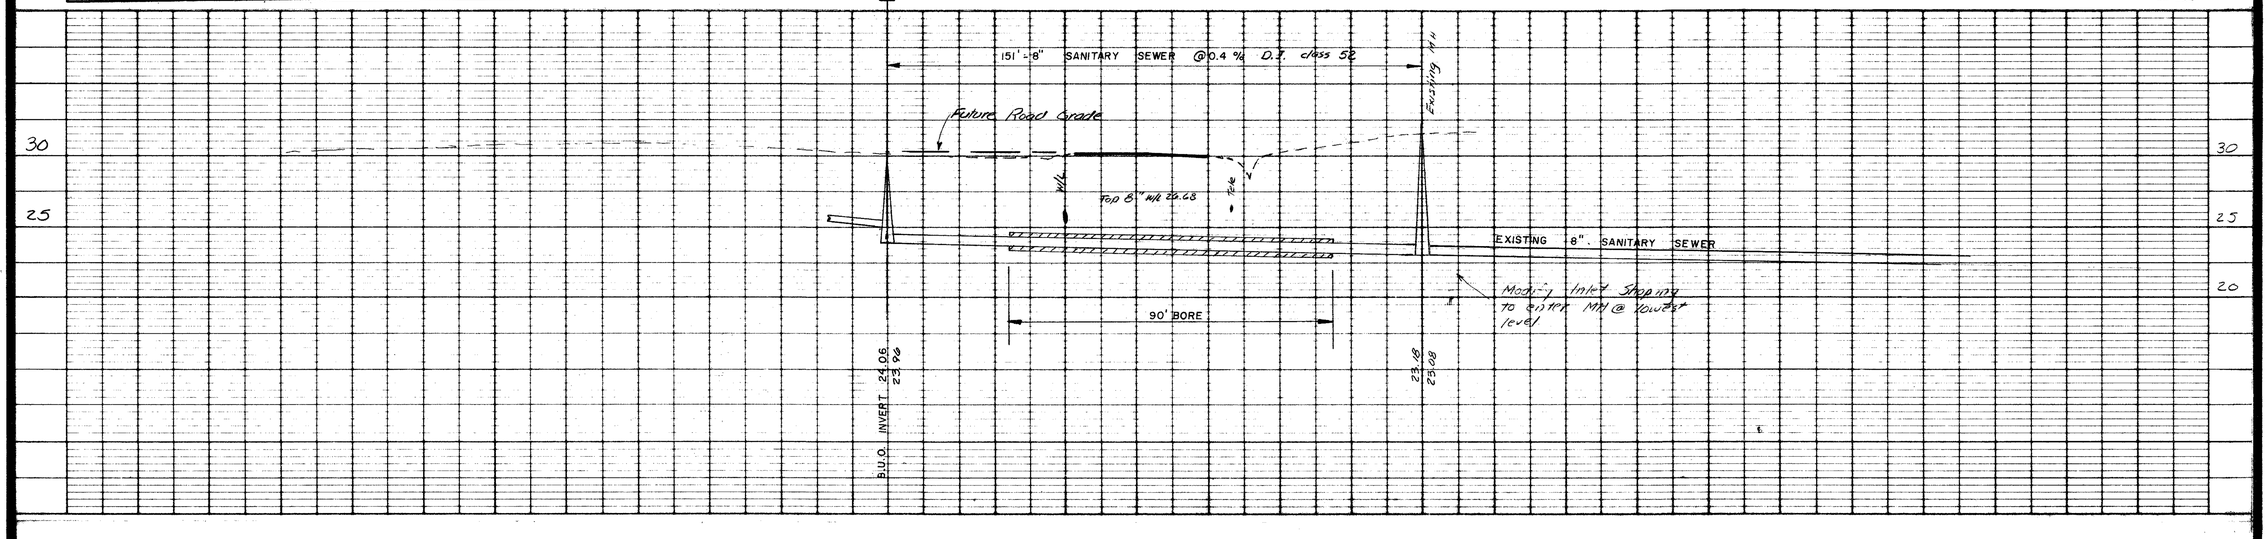

J. K. TIMMONS & ASSOCIATES, P.C.
ENGINEERS · SURVEYORS · PLANNERS

711 NORTH COURTHOUSE ROAD
RICHMOND, VIRGINIA 23235
TELEPHONE: (804) 794-3500

8803 STAPLES MILL ROAD
RICHMOND, VIRGINIA 23228
TELEPHONE: (804) 262-7396

411 EAST BROADWAY
HOPEWELL, VIRGINIA 23860
TELEPHONE: (804) 458-8685

WHITEHILL INDUSTRIAL PARK
PRINCE GEORGE CO., VIRGINIA

PLAN PROFILE

12/30/88

REVISIONS

COMMONWEALTH OF VIRGINIA
WALTER M. ALTMAN III
LICENSE No. 11039
PROFESSIONAL ENGINEER

STAMP
1" = 20'
SCALE
WMA III
DRAWN BY
11-17-88
DATE DRAWN
WMA III
DESIGNED
WMA III
CHECKED
1 OF 1
SHEET NUMBER
8611-09
JOB NUMBER